



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Area
CHEMOUR
 Machine Id
201311260062
 Component
Air Compressor
 Fluid
SULLAIR SULLUBE (3 GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	SFA0000208	---	---
Sample Date	Client Info	17 May 2024	---	---
Machine Age	hrs Client Info	7568	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	2	---	---
Chromium ppm ASTM D5185m	>4	0	---	---
Nickel ppm ASTM D5185m	>4	<1	---	---
Titanium ppm ASTM D5185m		0	---	---
Silver ppm ASTM D5185m		0	---	---
Aluminum ppm ASTM D5185m	>10	<1	---	---
Lead ppm ASTM D5185m	>20	0	---	---
Copper ppm ASTM D5185m	>40	0	---	---
Tin ppm ASTM D5185m	>5	1	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m	745	594	---	---
Molybdenum ppm ASTM D5185m	0.0	0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m	0.0	2	---	---
Calcium ppm ASTM D5185m	1	4	---	---
Phosphorus ppm ASTM D5185m	3	4	---	---
Zinc ppm ASTM D5185m	0.1	6	---	---
Sulfur ppm ASTM D5185m	240	369	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	2	---	---
Sodium ppm ASTM D5185m		23	---	---
Potassium ppm ASTM D5185m	>20	6	---	---
Water % ASTM D6304	>0.6	0.539	---	---
ppm Water ppm ASTM D6304	>6000	5390	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647	>10000	▲ 27065	---	---
Particles >6µm ASTM D7647	>2500	● 3265	---	---
Particles >14µm ASTM D7647	>320	147	---	---
Particles >21µm ASTM D7647	>80	34	---	---
Particles >38µm ASTM D7647	>20	1	---	---
Particles >71µm ASTM D7647	>4	0	---	---
Oil Cleanliness ISO 4406 (c)	>20/18/15	▲ 22/19/14	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	.06	0.083	---	---

OIL ANALYSIS REPORT

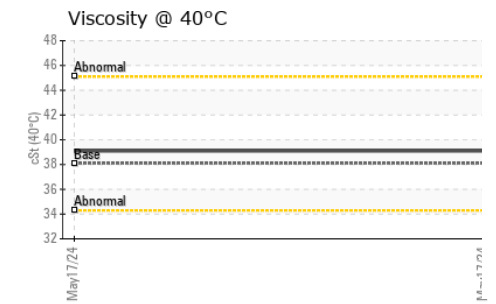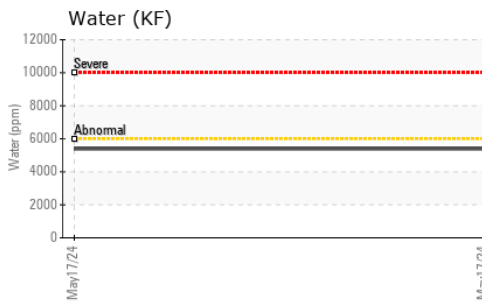
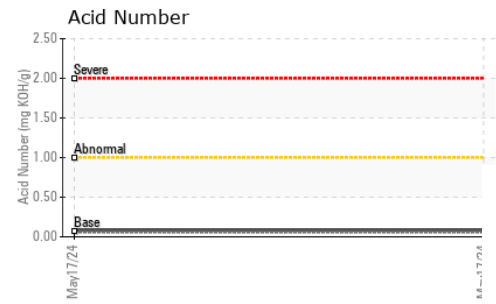
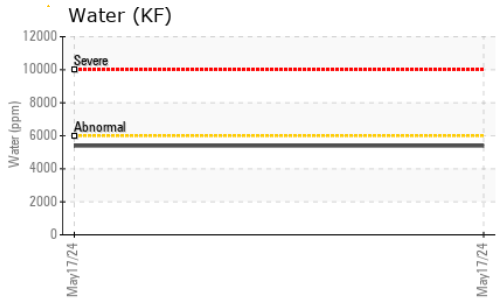
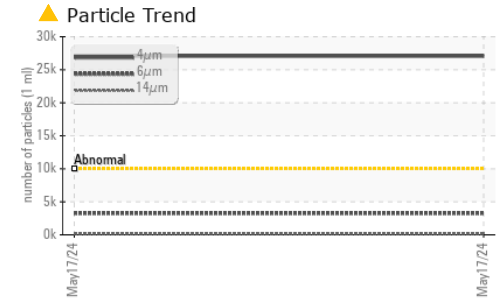


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.6	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	38.1	39.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color				no image	no image
Bottom				no image	no image

GRAPHS

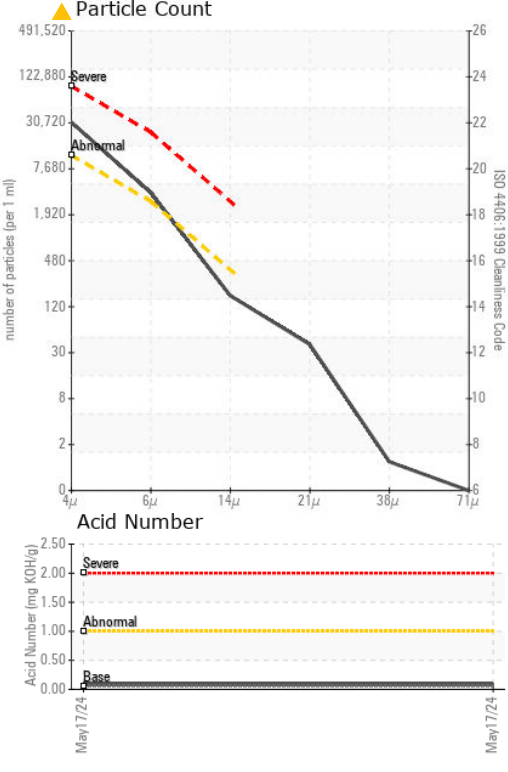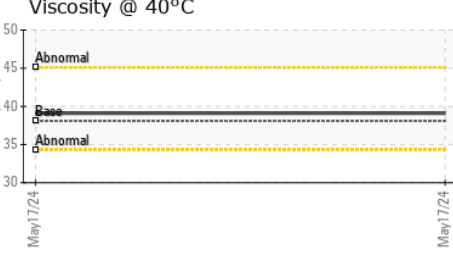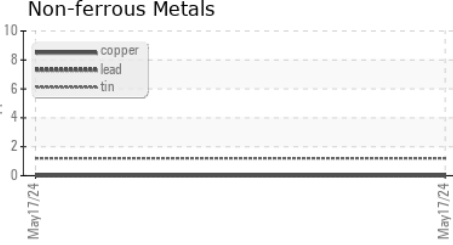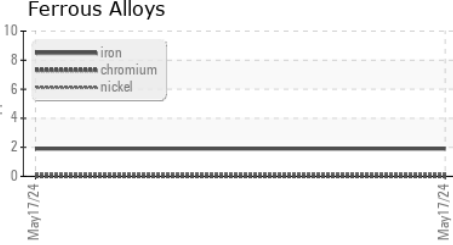

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : SFA0000208 **Received** : 10 Jun 2024
Lab Number : 06204657 **Tested** : 12 Jun 2024
Unique Number : 11072118 **Diagnosed** : 12 Jun 2024 - Doug Bogart
Test Package : PLANT (Additional Tests: FT-IR, KF, pH)

COMERCIAL KALTE
 MARTIN CARRERA 567 PTE
 MONTERREY, ZZ
 MX 64290
 Contact: Service Manager
 tampico@kalte.com.mx

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)