


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

LOW STAGE 2 / BOOSTER 2 (S/N TDSL283XL0130JJ)

Refrigeration Compressor

USPI 1009-68 SC (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Oct2021	Apr2022 Jun2022	Nov2022 Jun2023 Jan2024	Apr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012442	USP0005284	USP248413
Sample Date		Client Info		29 Apr 2024	05 Jan 2024	25 Jun 2023
Machine Age	hrs	Client Info		103253	101414	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	<1
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	0
Sodium	ppm	ASTM D5185m		2	0	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	<1
Water	%	ASTM D6304	>0.01	0.001	0.004	0.002
ppm Water	ppm	ASTM D6304	>100	3	50	15.3
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	893	10378	1659
Particles >6μm		ASTM D7647	>2500	349	2240	349
Particles >14μm		ASTM D7647	>640	11	40	15
Particles >21μm		ASTM D7647	>160	1	8	3
Particles >38μm		ASTM D7647	>40	0	1	0
Particles >71μm		ASTM D7647		0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	17/16/11	21/18/12	18/16/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.015	0.014	0.015



OIL ANALYSIS REPORT

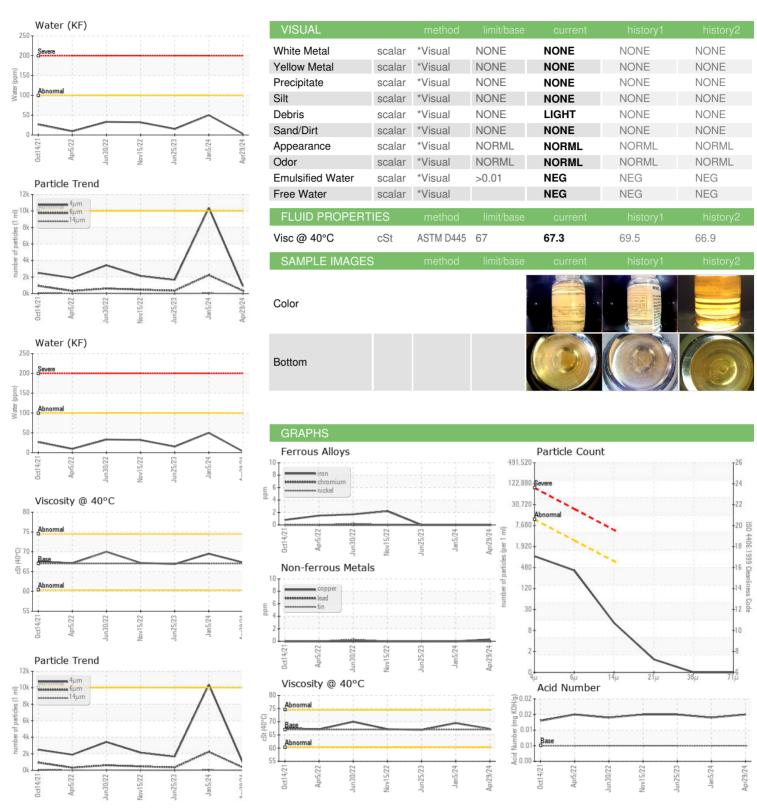





Certificate 12367

Laboratory Sample No. Lab Number

: 06204720

: USP0012442

Unique Number : 11072181 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 10 Jun 2024

Tested : 12 Jun 2024 Diagnosed

: 12 Jun 2024 - Doug Bogart

KraftHeinz - Fort Myers - Plant 8374 5521 DIVISION DR FORT MYERS, FL US 33905

Contact: RON MOGENSEN ronnie.mogensen@kraftheinz.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: KRAFORFL [WUSCAR] 06204720 (Generated: 06/12/2024 20:28:16) Rev: 1

Contact/Location: RON MOGENSEN - KRAFORFL

T:

F: