


## **OIL ANALYSIS REPORT**

Sample Rating Trend



NORMAL



Machine Id

# FRICK C-4 1100 (S/N 2284DD)

Refrigeration Compressor

**USPI 1009-68 SC (15 GAL)** 

#### DIAGNOSIS

#### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		y2013 Dec20	14 Feb2016 Mar2018	Jul2019 May2020 Nov2021 I	far2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012428	USP0007745	USP0003484
Sample Date		Client Info		31 May 2024	21 Feb 2024	02 Nov 2023
Machine Age	hrs	Client Info		76372	73438	71241
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	<1
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		<1	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m		0	1	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	2	1
Sodium	ppm	ASTM D5185m		1	<1	<1
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.01	0.005	0.001	0.007
ppm Water	ppm	ASTM D6304	>100	54	9	76
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	392	3064	2312
Particles >6µm		ASTM D7647	>2500	113	724	545
Particles >14µm		ASTM D7647	>320	6	31	25
Particles >21µm		ASTM D7647	>80	1	6	5
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/10	19/17/12	18/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.01




## **OIL ANALYSIS REPORT**



40k	4µ	m				
30k - 20k - Abi	14	μm	1			
20k			1	1		
10k - Abi	ormal		$\prod$	Λ		
1011			M	水	^	^
0k	-					






VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
ELLIID DRODERT	TEC.	mothod	limit/basa	current	history1	history?

VISC @ 40°C	CSI	A5 1 W D445	07	00.1	65.9	05.5
SAMPLE IMAGES	;	method	limit/base	current	history1	history2

Color





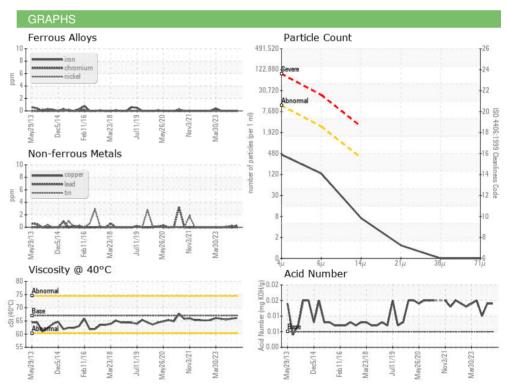



(3.04) tS 6!



Certificate 12367

Laboratory Sample No.

: USP0012428 Lab Number : 06204730

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 10 Jun 2024 **Tested** : 12 Jun 2024

Unique Number : 11072191 Diagnosed Test Package : IND 2

**CARGILL MEATS** 

SPRUCE GROVE, AB CA Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 12 Jun 2024 - Doug Bogart

T:

F: