




OIL ANALYSIS REPORT

Sample Rating Trend

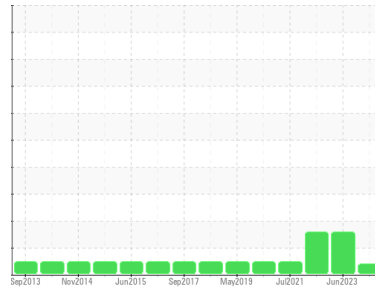

VISCOSITY



Area

RM6 [SV2312130312]

Machine Id

MCQUAY BOA VILLA PARK 6&7 (S/N STNU06500153)

Component

Refrigeration Compressor

Fluid

MOBIL EAL 46 (16 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

Fuel content negligible. There is no indication of any contamination in the oil.

Fluid Condition

The oil viscosity is higher than normal. The AN level is acceptable for this fluid.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0812146	WC0487423	WC0487469
Sample Date	Client Info		01 May 2024	13 Jun 2023	19 Apr 2022
Machine Age	hrs	Client Info	48000	40730	0
Oil Age	hrs	Client Info	30000	20000	0
Oil Changed	Client Info		Not Changed	Not Changed	N/A
Sample Status			ABNORMAL	MARGINAL	MARGINAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >100	0	<1	1
Chromium	ppm	ASTM D5185m >2	0	0	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >50	0	<1	1
Lead	ppm	ASTM D5185m >2	<1	0	<1
Copper	ppm	ASTM D5185m >100	<1	<1	2
Tin	ppm	ASTM D5185m >4	<1	<1	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	<1	<1
Barium	ppm	ASTM D5185m 0	0	2	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m 0	<1	0	0
Magnesium	ppm	ASTM D5185m 0	0	0	0
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 450	23	4	3
Zinc	ppm	ASTM D5185m 5	0	3	3
Sulfur	ppm	ASTM D5185m 40	0	52	51

CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	2	34	30
Sodium	ppm	ASTM D5185m	<1	1	0
Potassium	ppm	ASTM D5185m >20	1	<1	1
Water	%	ASTM D6304 >0.02	0.014	▲ 0.029	▲ 0.035
ppm Water	ppm	ASTM D6304 >250	146	▲ 294.9	▲ 352.5

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974 0.04	0.043	0.027	0.031




OIL ANALYSIS REPORT

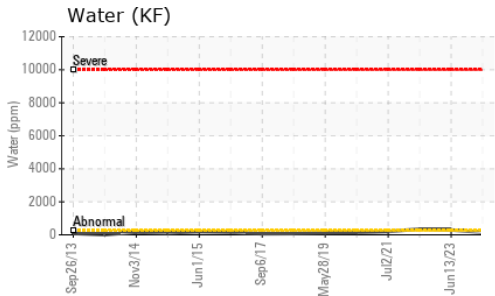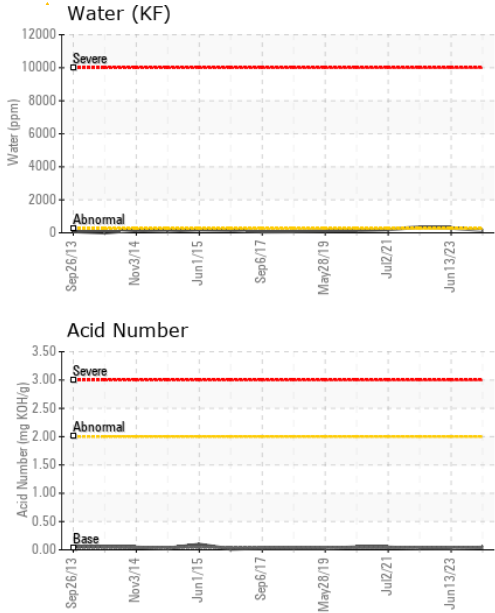





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.02	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46 ▲ 92.45	39.74	43.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

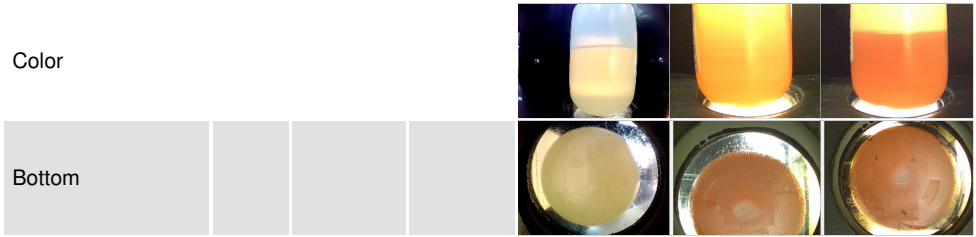

GRAPHS

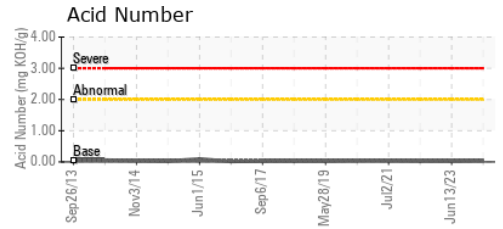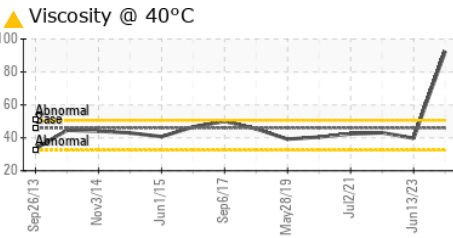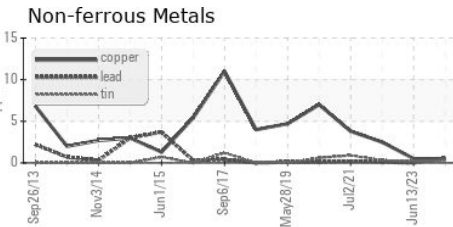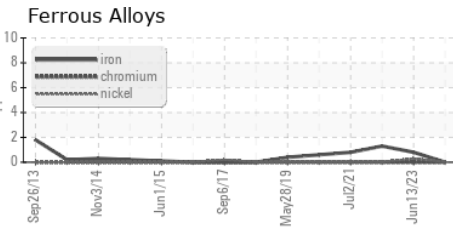

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0812146 **Received** : 10 Jun 2024
Lab Number : 06204771 **Tested** : 17 Jun 2024
Unique Number : 11072232 **Diagnosed** : 18 Jun 2024 - Jonathan Hester
Test Package : IND 2

DAIKIN APPLIED-RICHMOND
 8991 OLD STAPLES MILL ROAD
 HENRICO, VA
 US 23228
 Contact: AMANDA CARRIER
 amanda.carrier@daikinapplied.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)