


OIL ANALYSIS REPORT

PG-46 [290222]

INGERSOLL RAND UP8234U080094 - ABLE BARN

Component





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001475		
Sample Date		Client Info		17 May 2024		
Machine Age	hrs	Client Info		6361		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
CONTAMINATION	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	<1		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		383		
Zinc	ppm	ASTM D5185m		8		
Sulfur	ppm	ASTM D5185m		27		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	2		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


0.09

Acid Number (AN)

mg KOH/g ASTM D8045



OIL ANALYSIS REPORT

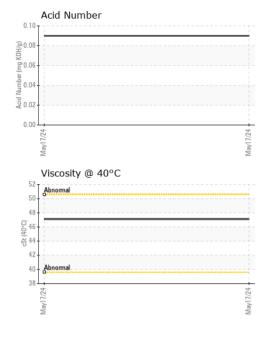







Certificate 12367

Laboratory Sample No.

Lab Number : 06204822 Unique Number : 11072283

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UFD0001475

To discuss this sample report, contact Customer Service at 1-800-237-1369.

May17/24

Non-ferrous Metals

Viscosity @ 40°C

Received : 10 Jun 2024 **Tested**

: 11 Jun 2024

: 11 Jun 2024 - Wes Davis

May17/24 -

Diagnosed

US 60143 Contact: ED DIENER ed.diener@fluidairedynamics.com

FLUID-AIRE DYNAMICS

225 SPRING LAKE DR

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: ED DIENER - UCFLUSCH

Acid Number

등 0.08 €0.06 은 0.04

0.00

Report Id: UCFLUSCH [WUSCAR] 06204822 (Generated: 06/11/2024 19:31:07) Rev: 1

T: (847)678-8388

ITASCA, IL