

## **OIL ANALYSIS REPORT**

Area S-46 [289482] PNEUTECH AK1000017734 - IONBOND Component Compressor

#### Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

### Wear


All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



Sample Rating Trend




NORMAL

SAMPLE INFORM	NATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UFD0001560		
Sample Date		Client Info		04 Jun 2024		
Machine Age	hrs	Client Info		8541		
Oil Age	hrs	Client Info		2872		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
CONTAMINATIO	N	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	0		
Lead	ppm	ASTM D5185m	>25	<1		
Copper	ppm	ASTM D5185m	>50	1		
Tin	ppm	ASTM D5185m	>15	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		83		
Zinc	ppm	ASTM D5185m		2		
Sulfur	ppm	ASTM D5185m		25		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4		
Sodium	ppm	ASTM D5185m		2		
Potassium	ppm	ASTM D5185m	>20	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.087		



# **OIL ANALYSIS REPORT**

VISUAL

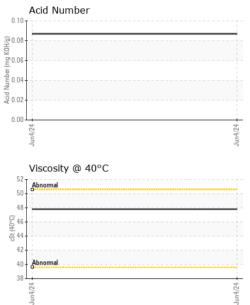

			43 <i>U</i> 1	NONE				
	White Metal	scalar	*Visual	NONE	NONE			
	Yellow Metal	scalar	*Visual	NONE	NONE			
	Precipitate	scalar	*Visual	NONE	NONE			
	Silt Debris	scalar	*Visual	NONE	NONE			
		scalar	*Visual	NONE	NONE			
24 -	Sand/Dirt	scalar	*Visual	NONE	NONE			
Jun4/24	Appearance	scalar	*Visual	NORML	NORML			
	Odor	scalar	*Visual	NORML	NORML			
	Emulsified Water	scalar	*Visual	>0.1	NEG			
	Free Water	scalar	*Visual		NEG			
	FLUID PROPER	TIES	method	limit/base	current	history1	history2	
	Visc @ 40°C	cSt	ASTM D445		47.8			
	SAMPLE IMAGE	S	method	limit/base	current	history1	history2	
Jun4/24	Color					no image	no image	
,un r								
	Bottom				The second	no image	no image	
	Non-ferrous Meta			Jun4/24				
	Viscosity @ 40°C			Jun4/24	Acid Number			
	55 50 <b>Abnormal</b> 50 415 40 40 <b>Abnormal</b> 35			(0,10 (0,10) (0,00) (0,				
	Jun4/24			Jun4/24	Jun4/24			
Laboratory Sample No. Lab Number Unique Number Test Package	: UFD0001560 : <mark>06204842</mark> : 11072303	1 Madison Ave., Cary, NC 27513 FLUI   Received : 10 Jun 2024   Tested : 12 Jun 2024   Diagnosed : 12 Jun 2024 - Wes Davis				14250 JL BUI	D-AIRE DYNAMICS - (MP 14250 JUDICIAL ROA BURNSVILLE, M US 5530 Contact: Service Manage	
discuss this sample report, Denotes test methods that	, contact Customer Serv	7025 sco	pe of accrea	litation.	ule (JCGM 106		7 F	

Contact/Location: Service Manager - UCFLUBUR Page 2 of 2