




OIL ANALYSIS REPORT



Machine Id
HBKM01BE
 Component
Biogas Engine
 Fluid
SHELL MYSELLA S5 S (--- GAL)

Sample Rating Trend

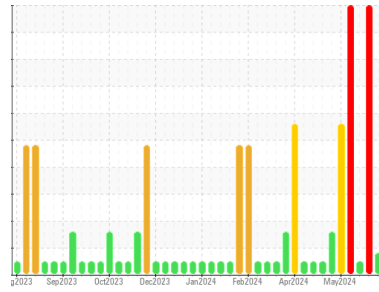

DIAGNOSIS

- Recommendation**
No corrective action is recommended at this time. Resample at the next service interval to monitor.
- Wear**
The tin level is abnormal. All other component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0775165	WC0775166	WC0775168
Sample Date	Client Info		06 Jun 2024	29 May 2024	22 May 2024
Machine Age	hrs	Client Info	110498	110378	110217
Oil Age	hrs	Client Info	393	276	115
Oil Changed	Client Info		Oil Added	Oil Added	Changed
Sample Status			ABNORMAL	SEVERE	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>4.0	<1.0	<1.0	<1.0
Water	WC Method		NEG	NEG	NEG
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		17	---	---
Iron	ppm	ASTM D5185m >14	7	7	2
Chromium	ppm	ASTM D5185m >3	<1	<1	0
Nickel	ppm	ASTM D5185m	0	<1	0
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m	0	<1	<1
Aluminum	ppm	ASTM D5185m >5	3	▲ 5	2
Lead	ppm	ASTM D5185m >8	<1	<1	<1
Copper	ppm	ASTM D5185m >5	2	2	<1
Tin	ppm	ASTM D5185m >3	▲ 4	▲ 5	1
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	30	39	4
Barium	ppm	ASTM D5185m	0	2	0
Molybdenum	ppm	ASTM D5185m	4	9	4
Manganese	ppm	ASTM D5185m	<1	<1	0
Magnesium	ppm	ASTM D5185m	19	30	16
Calcium	ppm	ASTM D5185m	1683	2437	1597
Phosphorus	ppm	ASTM D5185m 300	373	600	343
Zinc	ppm	ASTM D5185m	479	736	423
Sulfur	ppm	ASTM D5185m	3856	5595	3593

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >180	174	▲ 226	85
Sodium	ppm	ASTM D5185m >20	3	<1	<1
Potassium	ppm	ASTM D5185m >20	<1	2	0


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	0.1	0.1	0
Nitration	Abs/cm	*ASTM D7624	4.4	4.9	3.8
Sulfation	Abs/.1mm	*ASTM D7415	20.2	26.1	18.2




OIL ANALYSIS REPORT


Non-ferrous Metals

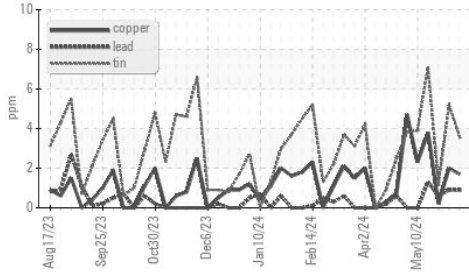


FT-IR (Direct Trend)

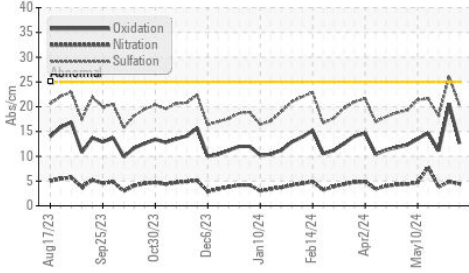


Acid Number

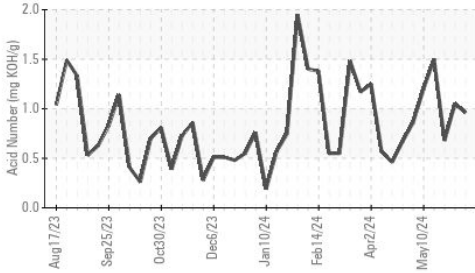

PQ

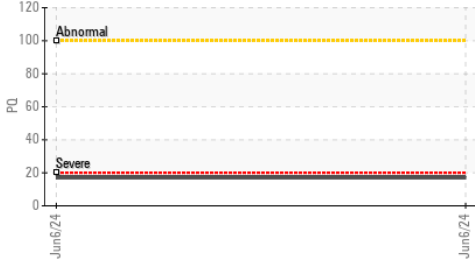

Viscosity @ 100°C

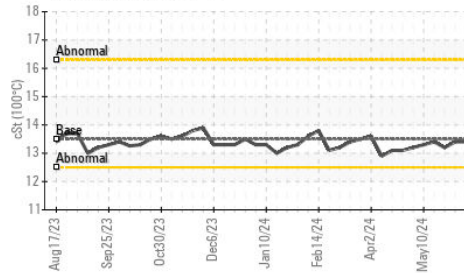


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	*ASTM D7414	12.6	20.6	11.1
Acid Number (AN)	mg KOH/g	ASTM D8045	0.96	1.05	0.68
Base Number (BN)	mg KOH/g	ASTM D2896 5.3	3.46	3.56	4.27

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual NONE	NONE	NONE	NONE
Silt	scalar	*Visual NONE	NONE	NONE	NONE
Debris	scalar	*Visual NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual NONE	NONE	NONE	NONE
Appearance	scalar	*Visual NORML	NORML	NORML	NORML
Odor	scalar	*Visual NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	NEG	NEG	NEG
Free Water	scalar	*Visual	NEG	NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445 13.5	13.4	13.4	13.2

GRAPHS


Iron (ppm)

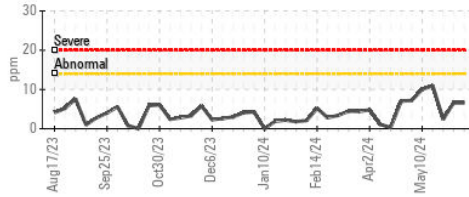


Lead (ppm)

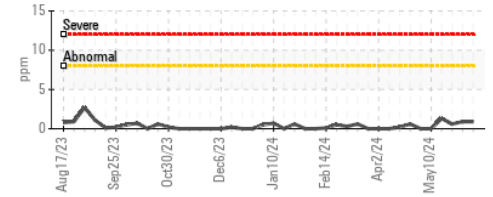


Aluminum (ppm)

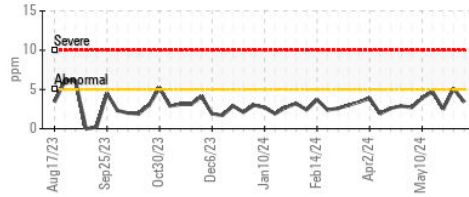


Chromium (ppm)

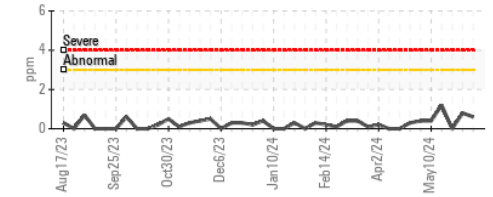


Copper (ppm)

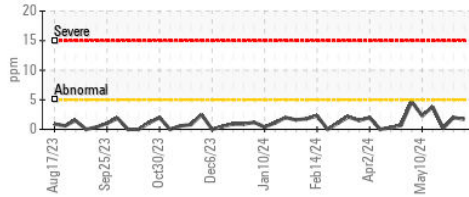


Silicon (ppm)

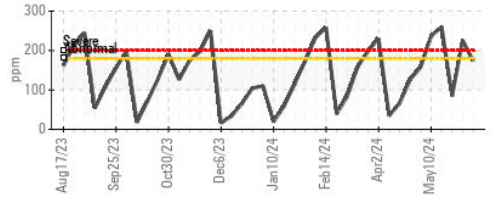

Viscosity @ 100°C

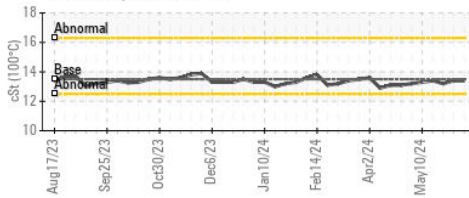

Base Number

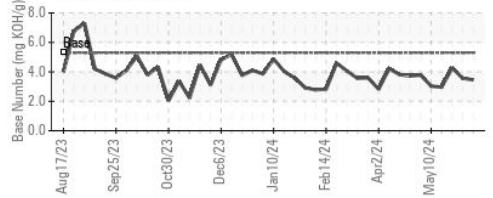

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0775165

Lab Number : 06204883

Unique Number : 11072344

Test Package : MOB 2 (Additional Tests: pq)

Received : 10 Jun 2024

Tested : 12 Jun 2024

Diagnosed : 12 Jun 2024 - Don Baldrige

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

EDL NA Recips-Honeybrook

Honey Brook Powerstation, 481 S. Churchtown Road

Narvon, PA

US 17555-9574

Contact: Christian Adames

Christian.Adames@edlenergy.com

T:

F: