




OIL ANALYSIS REPORT

Sample Rating Trend

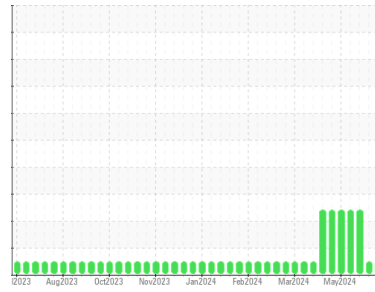

NORMAL



Machine Id
E-2 (S/N 1144675)
 Component
Biogas Engine
 Fluid
MAHLER Q8 Mahler G8 SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0944586	WC0914334	WC0914331
Sample Date	Client Info			03 Jun 2024	27 May 2024	20 May 2024
Machine Age	hrs	Client Info		13193	13031	12867
Oil Age	hrs	Client Info		763	601	437
Oil Changed	Client Info			N/A	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<1.0	<1.0	<1.0
Water	WC Method	>0.1		NEG	NEG	NEG
Glycol	WC Method			NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>45	2	1	7
Chromium	ppm	ASTM D5185m	>2	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>5	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	2	2	4
Lead	ppm	ASTM D5185m	>5	<1	<1	3
Copper	ppm	ASTM D5185m	>14	<1	0	2
Tin	ppm	ASTM D5185m	>13	2	<1	4
Vanadium	ppm	ASTM D5185m		<1	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		2	2	2
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m		5	10	6
Calcium	ppm	ASTM D5185m		2355	2177	2536
Phosphorus	ppm	ASTM D5185m		410	396	445
Zinc	ppm	ASTM D5185m		470	445	525
Sulfur	ppm	ASTM D5185m		2739	2542	3056

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>200	7	4	21
Sodium	ppm	ASTM D5185m		17	15	▲ 214
Potassium	ppm	ASTM D5185m	>20	3	1	▲ 30


INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0.1
Nitration	Abs/cm	*ASTM D7624	>20	6.6	5.8	9.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	15.4	14.9	19.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	10.4	9.7	14.4
Acid Number (AN)	mg KOH/g	ASTM D8045		1.368	1.107	0.80
Base Number (BN)	mg KOH/g	ASTM D2896	8.0	7.58	8.39	7.03




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

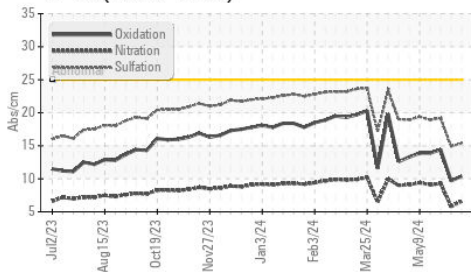


Acid Number

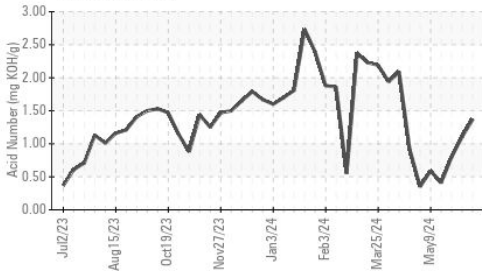

Base Number

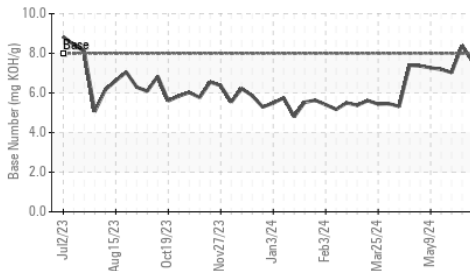

Viscosity @ 100°C

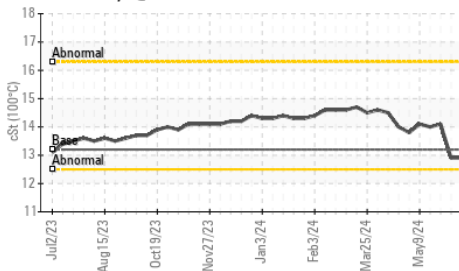


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	13.2	12.9	12.9

GRAPHS


Iron (ppm)

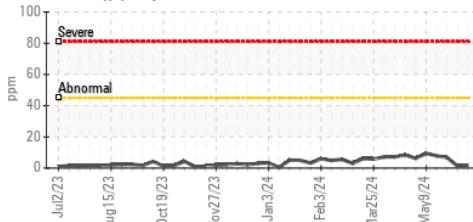


Lead (ppm)

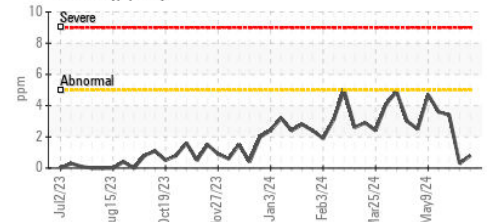


Aluminum (ppm)

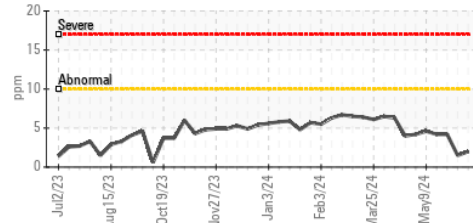


Chromium (ppm)

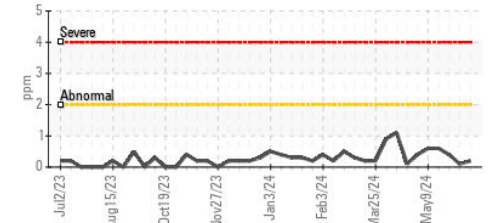


Copper (ppm)

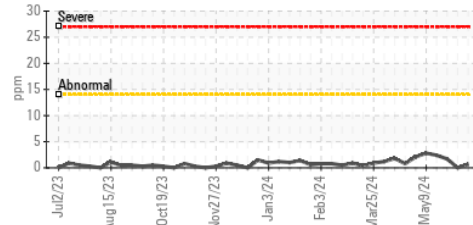


Silicon (ppm)

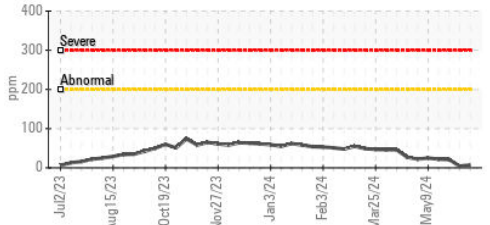

Viscosity @ 100°C

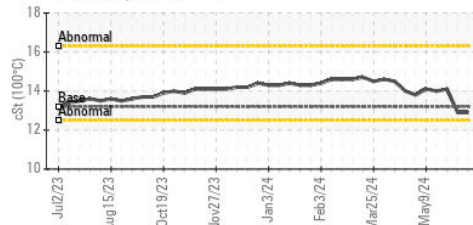

Base Number

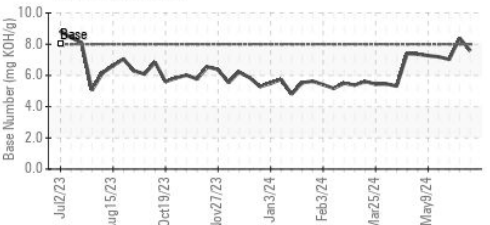

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0944586

Lab Number : 06204885

Unique Number : 11072346

Test Package : MOB 2

Received : 10 Jun 2024

Tested : 12 Jun 2024

Diagnosed : 12 Jun 2024 - Don Baldrige

OAK GROVE GA

967 CARL-BETHLEHEM RD

WINDER, GA

US 30680

Contact: ZACK GRAVES

zack.graves@cubedistrictenergy.com

T: (470)596-8000

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)