




# OIL ANALYSIS REPORT

Sample Rating Trend

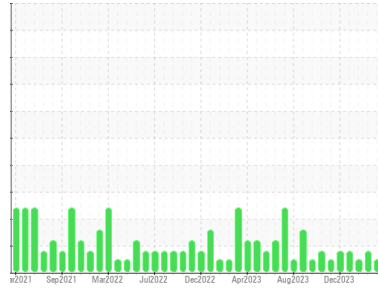

**NORMAL**



Area

**Louisville**

Machine Id

**[Louisville] Oil - Port Genset**

Component

**Port Genset**

Fluid

**MOBIL 15W40 (35 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

|               | method      | limit/base  | current            | history1    | history2    |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info |             | <b>WC0898527</b>   | WC0874748   | WC0874763   |
| Sample Date   | Client Info |             | <b>29 May 2024</b> | 20 May 2024 | 28 Apr 2024 |
| Machine Age   | hrs         | Client Info | <b>2286</b>        | 2120        | 1850        |
| Oil Age       | hrs         | Client Info | <b>1852</b>        | 1686        | 1414        |
| Oil Changed   | Client Info |             | <b>N/A</b>         | N/A         | N/A         |
| Sample Status |             |             | <b>NORMAL</b>      | ABNORMAL    | NORMAL      |

## CONTAMINATION

|        | method    | limit/base | current        | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel   | WC Method | >4.0       | <b>&lt;1.0</b> | <1.0     | <1.0     |
| Glycol | WC Method |            | <b>NEG</b>     | NEG      | NEG      |

## WEAR METALS

|          | method | limit/base  | current | history1     | history2 |    |
|----------|--------|-------------|---------|--------------|----------|----|
| Iron     | ppm    | ASTM D5185m | >50     | <b>25</b>    | 33       | 29 |
| Chromium | ppm    | ASTM D5185m | >4      | <b>&lt;1</b> | 1        | 1  |
| Nickel   | ppm    | ASTM D5185m | >2      | <b>0</b>     | 0        | <1 |
| Titanium | ppm    | ASTM D5185m |         | <b>&lt;1</b> | 0        | <1 |
| Silver   | ppm    | ASTM D5185m | >5      | <b>0</b>     | <1       | <1 |
| Aluminum | ppm    | ASTM D5185m | >12     | <b>2</b>     | 1        | 2  |
| Lead     | ppm    | ASTM D5185m | >17     | <b>12</b>    | ▲ 17     | 13 |
| Copper   | ppm    | ASTM D5185m | >70     | <b>6</b>     | 8        | 7  |
| Tin      | ppm    | ASTM D5185m | >15     | <b>&lt;1</b> | <1       | 1  |
| Vanadium | ppm    | ASTM D5185m |         | <b>0</b>     | 0        | <1 |
| Cadmium  | ppm    | ASTM D5185m |         | <b>0</b>     | 0        | <1 |

## ADDITIVES

|            | method | limit/base  | current | history1    | history2 |      |
|------------|--------|-------------|---------|-------------|----------|------|
| Boron      | ppm    | ASTM D5185m |         | <b>10</b>   | 13       | 13   |
| Barium     | ppm    | ASTM D5185m |         | <b>0</b>    | 0        | <1   |
| Molybdenum | ppm    | ASTM D5185m |         | <b>66</b>   | 67       | 65   |
| Manganese  | ppm    | ASTM D5185m |         | <b>0</b>    | <1       | <1   |
| Magnesium  | ppm    | ASTM D5185m |         | <b>1544</b> | 1623     | 1540 |
| Calcium    | ppm    | ASTM D5185m |         | <b>1214</b> | 1407     | 1251 |
| Phosphorus | ppm    | ASTM D5185m |         | <b>1117</b> | 1183     | 1135 |
| Zinc       | ppm    | ASTM D5185m |         | <b>1381</b> | 1464     | 1364 |
| Sulfur     | ppm    | ASTM D5185m |         | <b>3710</b> | 3983     | 3411 |

## CONTAMINANTS

|           | method | limit/base  | current | history1   | history2 |     |
|-----------|--------|-------------|---------|------------|----------|-----|
| Silicon   | ppm    | ASTM D5185m | >25     | <b>3</b>   | 3        | 4   |
| Sodium    | ppm    | ASTM D5185m | >118    | <b>1</b>   | 2        | 2   |
| Potassium | ppm    | ASTM D5185m | >20     | <b>2</b>   | <1       | 3   |
| Water     | %      | ASTM D6304  | >0.1    | <b>NEG</b> | NEG      | NEG |

## INFRA-RED





|           | method   | limit/base  | current | history1    | history2 |      |
|-----------|----------|-------------|---------|-------------|----------|------|
| Soot %    | %        | *ASTM D7844 |         | <b>0.2</b>  | 0.3      | 0.3  |
| Nitration | Abs/cm   | *ASTM D7624 | >20     | <b>10.6</b> | 12.6     | 11.0 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30     | <b>21.5</b> | 22.6     | 21.7 |

## FLUID DEGRADATION

|                  | method   | limit/base  | current | history1     | history2 |       |
|------------------|----------|-------------|---------|--------------|----------|-------|
| Oxidation        | Abs/.1mm | *ASTM D7414 | >25     | <b>20.4</b>  | 23.1     | 20.6  |
| Base Number (BN) | mg KOH/g | ASTM D2896  |         | <b>12.49</b> | 12.76    | 12.84 |







# OIL ANALYSIS REPORT

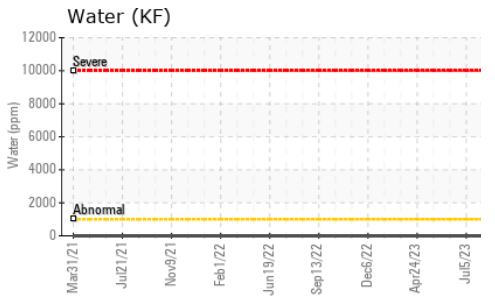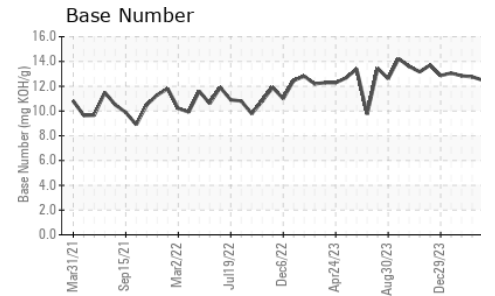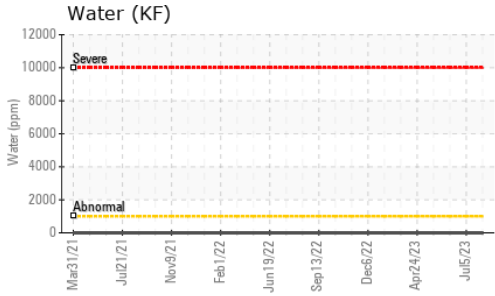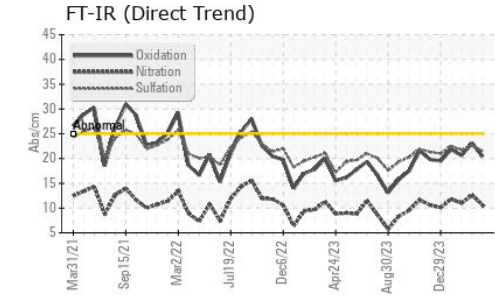

| VISUAL           | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual    | NONE    | NONE     | NONE     |
| Precipitate      | scalar | *Visual    | NONE    | NONE     | NONE     |
| Silt             | scalar | *Visual    | NONE    | NONE     | NONE     |
| Debris           | scalar | *Visual    | NONE    | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual    | NONE    | NONE     | NONE     |
| Appearance       | scalar | *Visual    | NORML   | NORML    | NORML    |
| Odor             | scalar | *Visual    | NORML   | NORML    | NORML    |
| Emulsified Water | scalar | *Visual    | >0.1    | NEG      | NEG      |
| Free Water       | scalar | *Visual    |         | NEG      | NEG      |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 100°C     | cSt    | ASTM D445  | 14.2    | 13.6     | 13.6     |

## GRAPHS

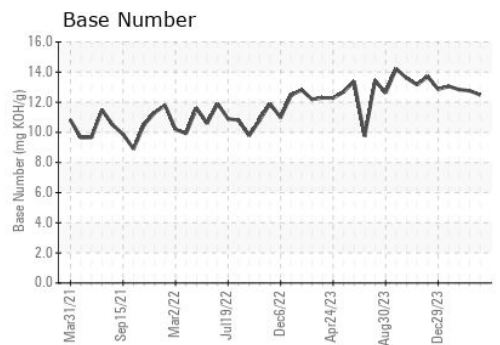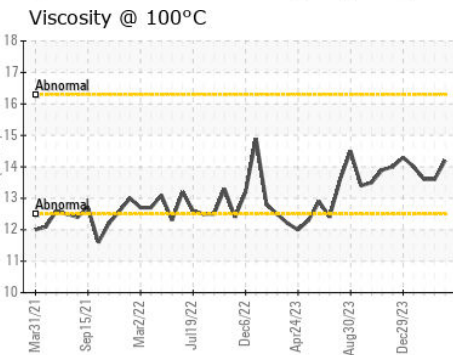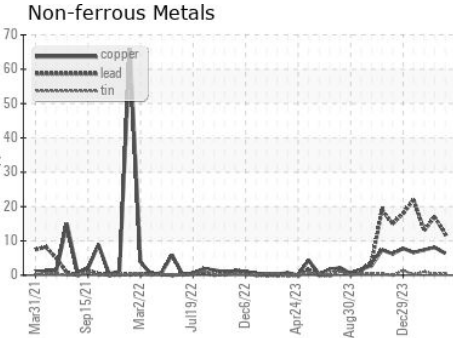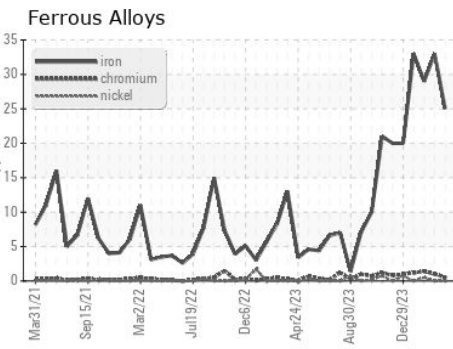

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0898527      **Received** : 10 Jun 2024  
**Lab Number** : 06204909      **Tested** : 13 Jun 2024  
**Unique Number** : 11072370      **Diagnosed** : 13 Jun 2024 - Sean Felton  
**Test Package** : IND 2 ( Additional Tests: KF )

**MARATHON PETROLEUM CO.**  
 101 12TH ST  
 CATLETTSBURG, KY  
 US 41169  
 Contact: CORY GUMBERT  
 cagumbert@marathonpetroleum.com  
 T: (606)585-3950  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)