




FUEL REPORT

Sample Rating Trend

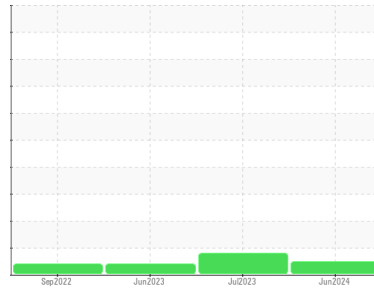

NORMAL



Machine Id
CR5505

Component
Diesel Fuel

Fluid
No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

The water content is negligible. There is no indication of any contamination in the fuel.

Fuel Condition

The condition of the fuel is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0952172	WC0704436	WC0746651
Sample Date	Client Info			03 Jun 2024	18 Jul 2023	15 Jun 2023
Machine Age	hrs	Client Info		8294	6862	6305
Sample Status				NORMAL	ABNORMAL	ABNORMAL


PHYSICAL PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	3.0	2.79	2.88	2.6

SULFUR CONTENT		method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0	0	0
Sodium	ppm	ASTM D5185m	<0.1	1	0	0
Potassium	ppm	ASTM D5185m	<0.1	<1	<1	0
Water	%	ASTM D6304	<0.05	0.003	0.004	0.005
ppm Water	ppm	ASTM D6304	<500	29	45.3	51.0

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185m	<0.1	0	<1	0
Nickel	ppm	ASTM D5185m	<0.1	<1	0	0
Lead	ppm	ASTM D5185m	<0.1	0	0	0
Vanadium	ppm	ASTM D5185m	<0.1	0	0	0
Iron	ppm	ASTM D5185m	<0.1	0	0	0
Calcium	ppm	ASTM D5185m	<0.1	0	0	0
Magnesium	ppm	ASTM D5185m	<0.1	<1	<1	0
Phosphorus	ppm	ASTM D5185m	<0.1	0	<1	0
Zinc	ppm	ASTM D5185m	<0.1	0	0	0





SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

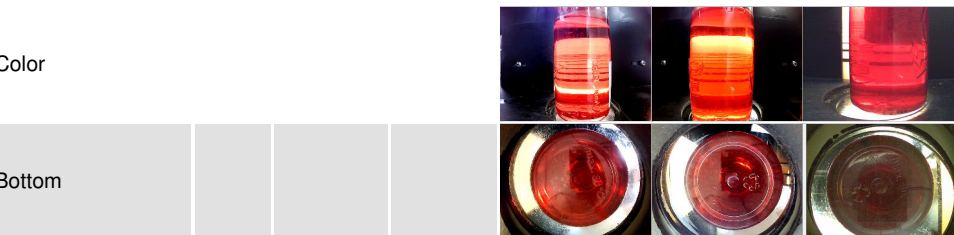



FUEL REPORT

GRAPHS

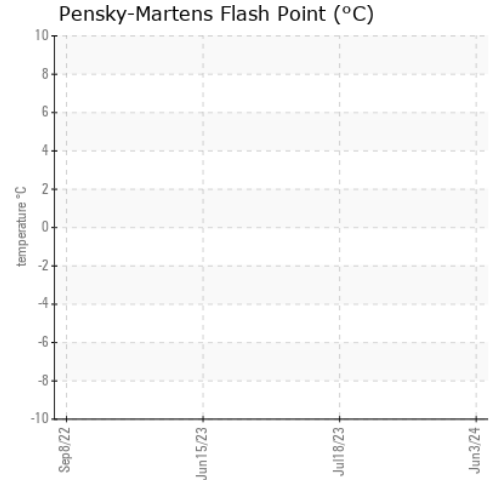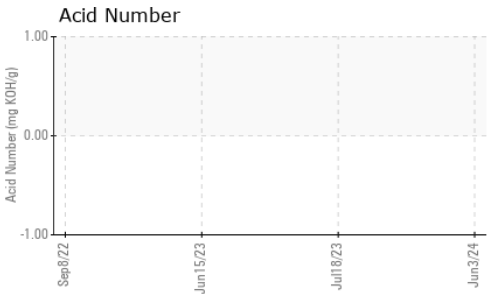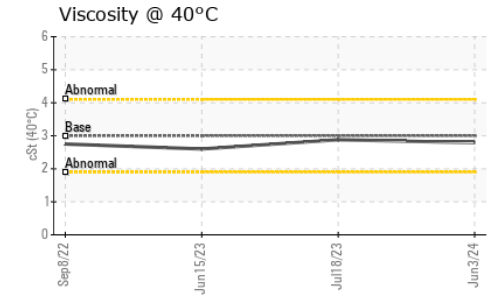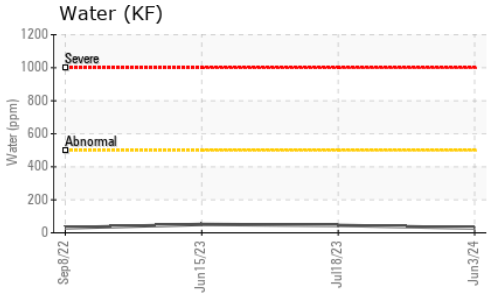

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0952172 **Received** : 10 Jun 2024
Lab Number : 06205263 **Tested** : 13 Jun 2024
Unique Number : 11072724 **Diagnosed** : 13 Jun 2024 - Jonathan Hester
Test Package : CONST (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BUCKNER HEAVY LIFT

4732 NC 54 EAST

GRAHAM, NC

US 27253-9215

Contact: MICHAEL LAWSON

michaell@bucknercompanies.com

T: (336)376-8888

F: (336)376-4090