

FUEL REPORT

Area QTS SUWANEE DC1 [17702] **[QTS SUWANEE DC1] K8**

Diesel Fuel

Fluid No.2 DIESEL FUEL (ULTRALOW SULPHUR) (4000 GAL)

DIAGNOSIS

Recommendation

All laboratory tests indicate that this sample meets ASTM D975 specifications for No.2 ultra-low-sulfur diesel fuel.

Corrosion

All metal levels are normal indicating no corrosion in the system.

Contaminants

There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Fuel Condition

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.




Sample Rating Trend



SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0953842		
Sample Date		Client Info		20 May 2024		
Machine Age	hrs	Client Info		0		
Sample Status				NORMAL		
PHYSICAL PROP	ERTIES	method	limit/base	current	history1	history2
Fuel Color	text	*Visual Screen	Yllow	Red		
ASTM Color	scalar	*ASTM D1500		L4.5		
Visc @ 40°C	cSt	ASTM D445	3.0	2.37		
Pensky-Martens Flash Point	°C	*PMCC Calculated	52	62.1		
SULFUR CONTER	NT	method	limit/base	current	history1	history2
Sulfur	ppm	ASTM D5185m	10	0		
Sulfur (UVF)	ppm	ASTM D5453		9		
DISTILLATION		method	limit/base	current	history1	history2
Initial Boiling Point	°C	ASTM D86	165	173		
5% Distillation Point	°C	ASTM D86		196		
10% Distill Point	°C	ASTM D86	201	206		
15% Distillation Point	°C	ASTM D86		214		
20% Distill Point	°C	ASTM D86	216	222		
30% Distill Point	°C	ASTM D86	230	236		
40% Distill Point	°C	ASTM D86	243	249		
50% Distill Point	°C	ASTM D86	255	262		
60% Distill Point	°C	ASTM D86	267	275		
70% Distill Point	°C	ASTM D86	280	289		
80% Distill Point	°C	ASTM D86	295	304		
85% Distillation Point	°C	ASTM D86		314		
90% Distill Point	°C	ASTM D86	310	324		
95% Distillation Point	°C	ASTM D86		342		
Final Boiling Point	°C	ASTM D86	341	357		
IGNITION QUALIT	ΓY	method	limit/base	current	history1	history2
API Gravity		ASTM D7777	37.7	36		
Cetane Index		ASTM D4737	<40.0	48		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	<1.0	0		
Sodium	ppm	ASTM D5185m	<0.1	1		
Potassium	ppm	ASTM D5185m	<0.1	1		
Water	%	ASTM D6304	<0.05	0.003		
ppm Water	ppm	ASTM D6304	<500	35		
% Gasoline	%	*In-House	<0.50	0.0		
% Biodiesel	%	*In-House	<20.0	0.0		



FUEL REPORT

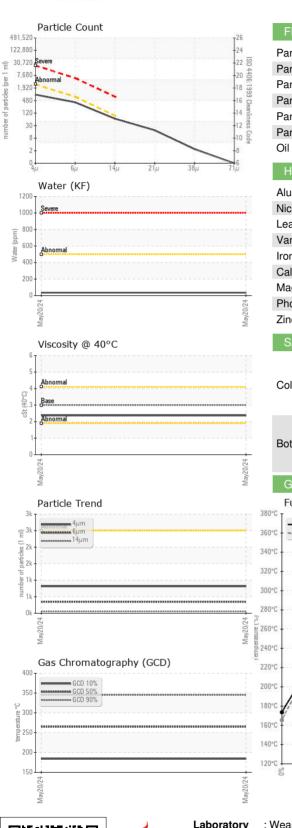


FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
articles >4µm		ASTM D7647	>2500	814		
articles >6µm		ASTM D7647	>640	346		
articles >14µm		ASTM D7647	>80	57		
articles >21µm		ASTM D7647	>20	16		
articles >38µm		ASTM D7647	>4	2		
articles >71µm		ASTM D7647	>3	0		
l Cleanliness		ISO 4406 (c)	>18/16/13	17/16/13		
HEAVY METALS		method	limit/base	current	history1	history2
uminum	ppm	ASTM D5185m	<0.1	0		
ckel	ppm	ASTM D5185m	<0.1	<1		
ad	ppm	ASTM D5185m	<0.1	0		
anadium	ppm	ASTM D5185m	<0.1	0		
n	ppm	ASTM D5185m	<0.1	0		
alcium	ppm	ASTM D5185m	<0.1	0		
agnesium	ppm	ASTM D5185m	<0.1	<1		
osphorus	ppm	ASTM D5185m	<0.1	0		
าด	ppm	ASTM D5185m	<0.1	0		
SAMPLE IMAGES	S	method	limit/base	current	history1	history2
blor					no image	no image
ottom					no image	no image
GRAPHS						
Fuel Distillation Cu	irve		temperature °C	ют :	ns Flash Point (°C)
		1		GCD Spectrur	n	Mav20/24
بر	K		60 55 50			
1			49			

200 150

100

50

%00

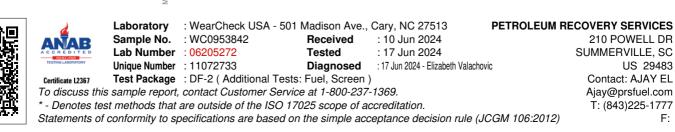

10%

30% 40% 20% %09 %0L 80% 90%

> Perce nt Recovered

20%

Report Id: PETSUM [WUSCAR] 06205272 (Generated: 06/17/2024 10:40:24) Rev: 1

Contact/Location: AJAY EL - PETSUM

5 16 20

Time (min)

F: