




# OIL ANALYSIS REPORT

Sample Rating Trend

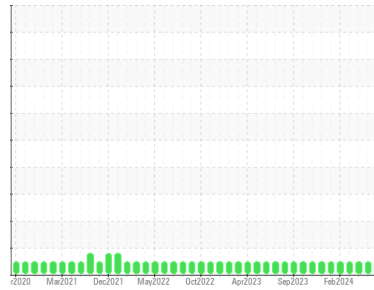

**NORMAL**



Machine Id  
**HP-A - K2330A**  
 Component  
**Compressor**  
 Fluid  
**REFRIG COMP OIL ISO 32 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>HLC0003328</b>	HLC0003324	HLC0003188
Sample Date	Client Info		<b>02 Jun 2024</b>	29 Apr 2024	31 Mar 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m		<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	<1	1
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	1
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	1

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	5	<b>0</b>	0	21
Barium	ppm	ASTM D5185m	5	<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m	5	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	5	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185m	12	<b>0</b>	0	5
Phosphorus	ppm	ASTM D5185m	12	<b>42</b>	3	25
Zinc	ppm	ASTM D5185m	12	<b>0</b>	0	1
Sulfur	ppm	ASTM D5185m	1000	<b>1038</b>	865	963

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	2	1
Sodium	ppm	ASTM D5185m		<b>4</b>	6	13
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	1





## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1021</b>	667	1117
Particles >6µm	ASTM D7647	>2500	<b>256</b>	62	241
Particles >14µm	ASTM D7647	>320	<b>10</b>	7	11
Particles >21µm	ASTM D7647	>80	<b>1</b>	3	2
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/18/15	<b>17/15/10</b>	17/13/10	17/15/11

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.10	<b>0.11</b>	0.10	0.10

# OIL ANALYSIS REPORT

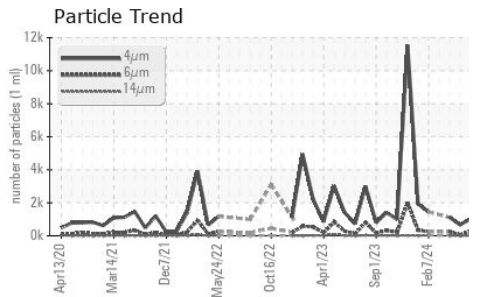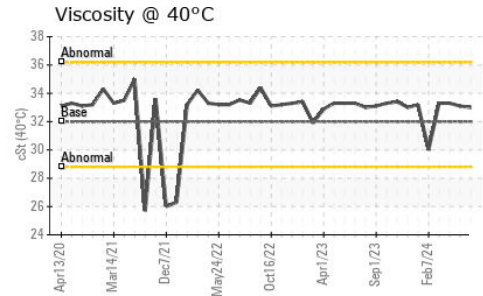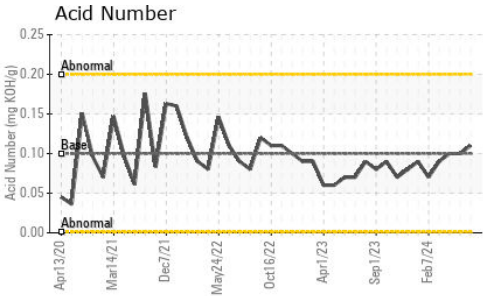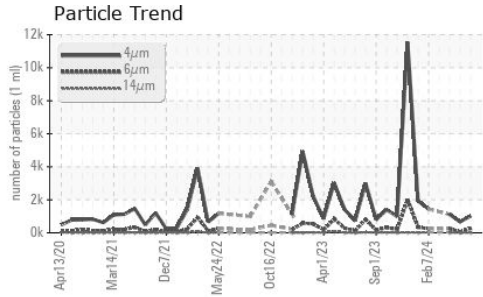






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	33.0	33.1

**SAMPLE IMAGES**

method	limit/base	current	history1	history2
Color				
Bottom				

## GRAPHS

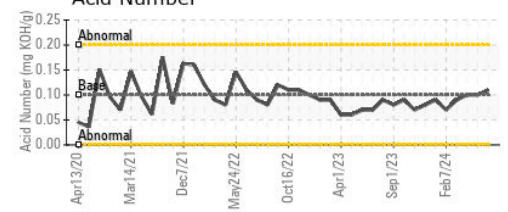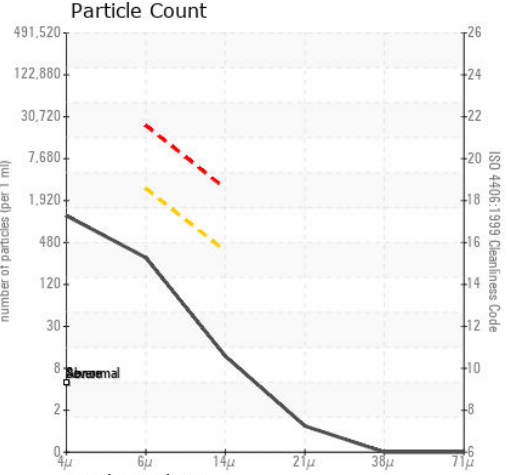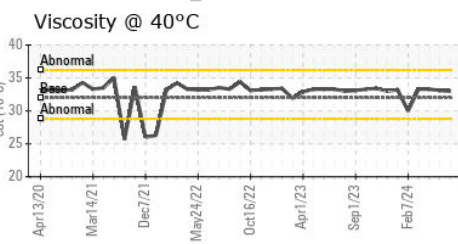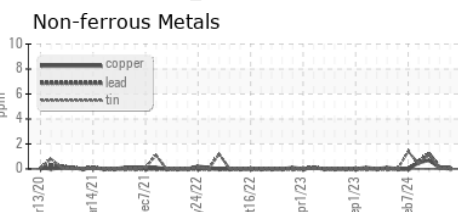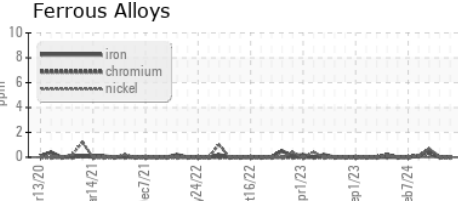

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : HLC0003328  
**Lab Number** : 06205345  
**Unique Number** : 11072806  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**Received** : 10 Jun 2024  
**Tested** : 12 Jun 2024  
**Diagnosed** : 12 Jun 2024 - Don Baldrige

**HILCORP NORTHSTAR FACILITY**  
 PRUDHOE BAY, AK  
 US 99734  
 Contact: PERRY NEEL  
 pneel@hilcorp.com  
 T: (907)670-3514  
 F: (907)659-5377

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)