


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

6716676 (S/N 1300) Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Feb 2020	Jan2021 Aug2021	Jul2022 Apr2023	May2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC130216	KC111783	KC101599
Sample Date		Client Info		28 May 2024	13 Apr 2023	25 Jul 2022
Machine Age	hrs	Client Info		25397	18739	13958
Oil Age	hrs	Client Info		8000	8400	3800
Oil Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	5	5
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	2
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	19	36	31
Calcium	ppm	ASTM D5185m	2	2	0	0
Phosphorus	ppm	ASTM D5185m		5	2	<1
Zinc	ppm	ASTM D5185m		32	66	42
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		13	11	12
Potassium	ppm	ASTM D5185m	>20	4	4	8
Water	%	ASTM D6304	>0.05	0.014	0.021	0.025
ppm Water	ppm	ASTM D6304	>500	143	218.0	251.3
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		969	4661	6138
Particles >6µm		ASTM D7647	>1300	274	1229	△ 2368
Particles >14μm		ASTM D7647	>80	19	94	▲ 316
Particles >21µm		ASTM D7647	>20	6	2 6	▲ 119
Particles >38μm		ASTM D7647	>4	0	1	<u> </u>
Particles >71µm		ASTM D7647	>3	0	0	1
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/11	19/17/14	<u>^</u> 20/18/15
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A - ! - N (A N)		4 OTM D00 45	0.4	0.25	0.00	0.00

Acid Number (AN)

mg KOH/g ASTM D8045 0.4


0.32

0.35

0.32



OIL ANALYSIS REPORT

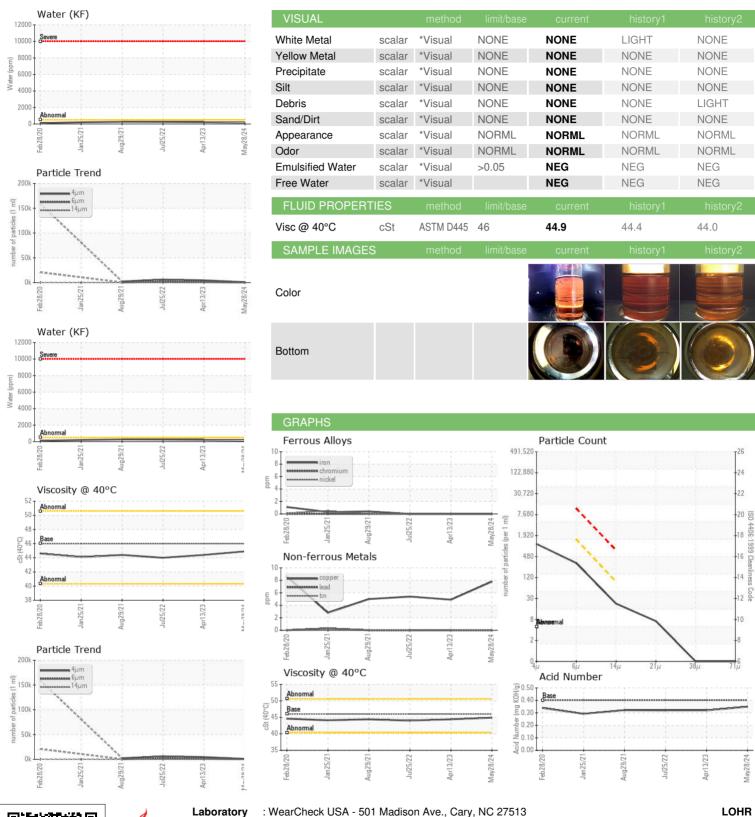





Certificate 12367

Laboratory Sample No. Lab Number : 06205395 Unique Number : 11072856

: KC130216 Test Package : IND 2

Received : 10 Jun 2024 **Tested** : 13 Jun 2024

Diagnosed : 13 Jun 2024 - Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

1445 MCCAIG RD

paul.shelly@lohr.us

Contact: PAUL SHELLY

LINCOLN, AL

US 35096

T:

F: