

### **OIL ANALYSIS REPORT**

Sample Rating Trend

ISO

# KAESER SM10T 7833081 (S/N 1187)

Component Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.


#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	<b>MATION</b>	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA012266	KCP54944	
Sample Date		Client Info		05 Jun 2024	24 Feb 2023	
Machine Age	hrs	Client Info		4043	1761	
Oil Age	hrs	Client Info		0	1761	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	
Chromium	ppm	ASTM D5185m	>10	0	<1	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	<1	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	3	1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m	2.10	<1	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0	0	2	
Magnesium	ppm	ASTM D5185m	100	55	70	
Calcium	ppm	ASTM D5185m	0	0	2	
Phosphorus	ppm	ASTM D5185m	0	11	0	
Zinc	ppm	ASTM D5185m		0	6	
Sulfur	ppm	ASTM D5185m	23500	21157	19754	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon		ASTM D5185m	>25	<1	2	
Sodium	ppm ppm	ASTM D5185m	>20	11	11	
Potassium		ASTM D5185m	>20	5	9	
Water	ppm %	ASTM D5185III ASTM D6304		5 0.028	9	
ppm Water	ppm	ASTM D6304	>5005	287	162.8	
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm	1200	ASTM D7647	-inni/base	78036	14174	
Particles >6µm		ASTM D7647	>1300	<u>\</u> 43014	4858	
Particles >14µm		ASTM D7647 ASTM D7647	>80	▲ 3103	▲ 175	
Particles >21µm		ASTM D7647 ASTM D7647		▲ 317	▲ 175 ▲ 25	
Particles >38µm		ASTM D7647 ASTM D7647	>20	▲ 5	1	
				0	0	
Particles >71µm		ASTM D7647				
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>2</b> 3/19	▲ 19/15	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.32	0.30	



## **OIL ANALYSIS REPORT**





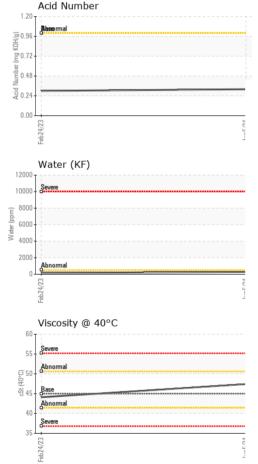

 $\mathbf{\hat{e}}$ 

VISUAL		method		/base	current		tory1	histo	n y Z
White Metal	scalar	*Visual	NON		NONE	LIGH			
Yellow Metal	scalar	*Visual	NON	E	NONE	NON	E		
Precipitate	scalar	*Visual	NON	E	NONE	NON	E		
Silt	scalar	*Visual	NON	Ξ	NONE	NON	E		
Debris	scalar	*Visual	NON	E	NONE	LIGH	IT		
Sand/Dirt	scalar	*Visual	NON	Ξ	NONE	NON	E		
Appearance	scalar	*Visual	NORI	ИL	NORML	NOR	ML		
Odor	scalar	*Visual	NORI	ИL	NORML	NOR	ML		
Emulsified Water	scalar	*Visual	>0.05	;	NEG	NEG			
Free Water	scalar	*Visual			NEG	NEG			
FLUID PROPERT	IES	method	limit	/base	current	hist	tory1	histo	ory2
Visc @ 40°C	cSt	ASTM D445	45		47.4	44.1			
SAMPLE IMAGES	5	method	limit	/base	current	hist	tory1	histo	vrv2
									.,_
Color								no ima	ige
				/	72	11			
Bottom					(1985)			no ima	nae
20110111							2))		.90
GRAPHS									
Ferrous Alloys					Particle Cour	ht			
				491,520 T					T <sup>26</sup>
iron				122,880 -					-24
nickel				122,000					T21
				30,720-					-22
				7,680-	• •				20
23 23			24		· · · · ·	/			-20
Feb 2 4/2 3			Jun5/24	ng 1,920-					-18
	_			월 480 -	1 N.	. /			10
Non-ferrous Metals	5			t bart					10
copper				(11 1,920 - 1,920 - 480 - 120 -		1	1		-20 -18 -16 -14 -12
G- tin				an 30 -			1		12
+				30-			1		12
				8	<b>lever</b> emal				10
	**********			ļ					
Feb 2 4/23			Jun5/24	2-				1	10
			٦٢	0	6µ	14µ	21µ	38µ	714
Viscosity @ 40°C				i pi	Acid Number		2 IJA	50μ	r ip
Severe				1.20	<b>Base</b> rmal				
Abnormal				<u>0.96</u>					
)				ຍັ 0.72 - ອ					
Base	*******			4 0.48					
Abnormal				(B1.20 - (B1					
Abnormal Severe				0.004					
Abnormal			/24 -		1/23				
Abnormal Severe			Jun5/24 -		Feb 2 4/23				

 Image: Certificate L2367
 Diagnosed

 Certificate L2367
 Test Package : IND 2 (Additional Tests: KF, PrtCount)

Laboratory

Sample No. Lab Number

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: 84LEGG [WUSCAR] 06205416 (Generated: 06/14/2024 08:44:32) Rev: 1

Contact/Location: Service Manager - 84LEGG Page 2 of 2

Contact: Service Manager

T:

F: