


OIL ANALYSIS REPORT

Sample Rating Trend

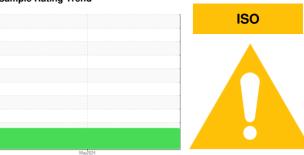

Machine Id

8792965 (S/N 4718) Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016927		
Sample Date		Client Info		31 May 2024		
Machine Age	hrs	Client Info		4690		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
					HISTOLAL	HISTOLYZ
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm		>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m		0		
Lead	ppm	ASTM D5185m	>10	<1		
Copper	ppm	ASTM D5185m	>50	11		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		<1		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	0		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		18425		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	>20	2		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D5103111	>0.05	0.007		
ppm Water	ppm	ASTM D6304	>500	76		
FLUID CLEANLIN		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8166		
Particles >6µm		ASTM D7647	>1300	△ 2966		
Particles >0µm		ASTM D7647	>80	▲ 323		
Particles >14µm		ASTM D7647	>00	▲ 93		
•		ASTM D7647	>4	4		
Particles >38µm		ASTM D7647		0		
Particles >71µm Oil Cleanliness			>3			
Oil Cleaniness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/16		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.44		

Contact/Location: MARC LOPEZ - CFLADA



OIL ANALYSIS REPORT







Certificate 12367

Laboratory Sample No.

Lab Number

: KCPA016927 : 06205444 Unique Number : 11072905

Received : 10 Jun 2024 **Tested** Diagnosed

: 12 Jun 2024 : 13 Jun 2024 - Don Baldridge

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

3576 HWY 41 SE ADAIRSVILLE, GA US 30103

Contact: MARC LOPEZ marc.lopez@cflflooring.com

T:

F: Contact/Location: MARC LOPEZ - CFLADA