




# OIL ANALYSIS REPORT

## Sample Rating Trend

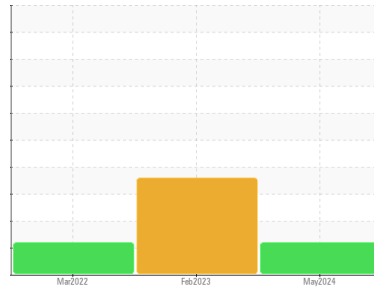

Machine Id  
**KAESER 7500719 (S/N 1631)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA018061</b>	KCP55275	KCP44185
Sample Date	Client Info		<b>24 May 2024</b>	18 Feb 2023	11 Mar 2022
Machine Age	hrs	Client Info	<b>9608</b>	6799	3750
Oil Age	hrs	Client Info	<b>3308</b>	3500	3750
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	10	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>4</b>	7	7
Tin	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>18</b>	9	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 100	<b>70</b>	56	48
Calcium	ppm	ASTM D5185m 0	<b>0</b>	2	0
Phosphorus	ppm	ASTM D5185m 0	<b>2</b>	15	3
Zinc	ppm	ASTM D5185m 0	<b>0</b>	16	4
Sulfur	ppm	ASTM D5185m 23500	<b>22775</b>	19703	17154

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	2	<1
Sodium	ppm	ASTM D5185m	<b>9</b>	8	9
Potassium	ppm	ASTM D5185m >20	<b>2</b>	5	7
Water	%	ASTM D6304 >0.05	<b>0.024</b>	▲ 0.414	0.013
ppm Water	ppm	ASTM D6304 >500	<b>249</b>	▲ 4140	138.3






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>3650</b>	---	4830
Particles >6µm	ASTM D7647	>1300	<b>1170</b>	---	▲ 1612
Particles >14µm	ASTM D7647	>80	● <b>109</b>	---	▲ 161
Particles >21µm	ASTM D7647	>20	● <b>27</b>	---	▲ 45
Particles >38µm	ASTM D7647	>4	<b>1</b>	---	2
Particles >71µm	ASTM D7647	>3	<b>0</b>	---	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	● <b>19/17/14</b>	---	▲ 18/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	<b>0.41</b>	0.41	0.33


# OIL ANALYSIS REPORT

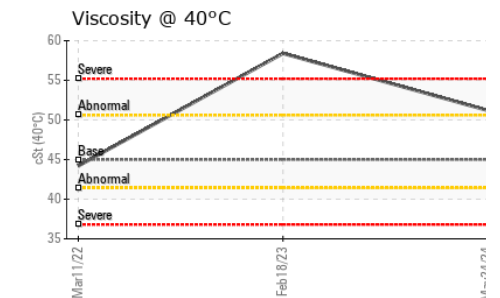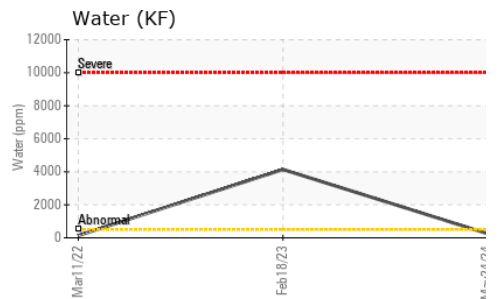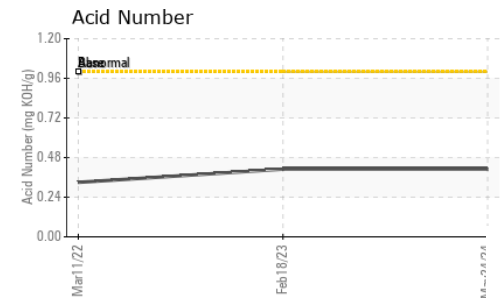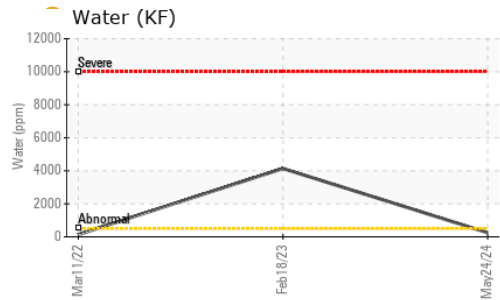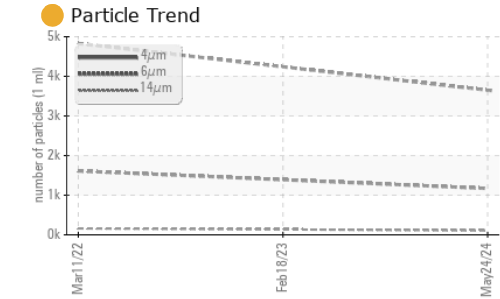






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	▲ 0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	51.2	● 58.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

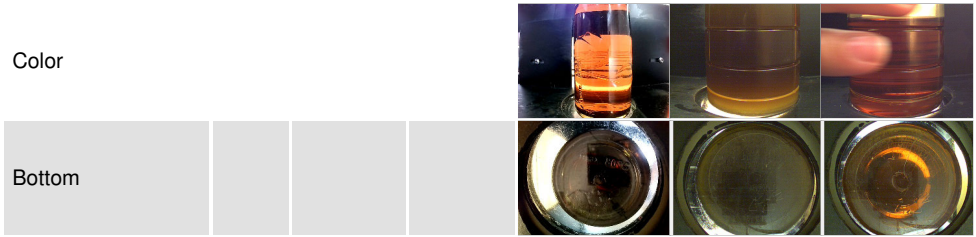

## GRAPHS

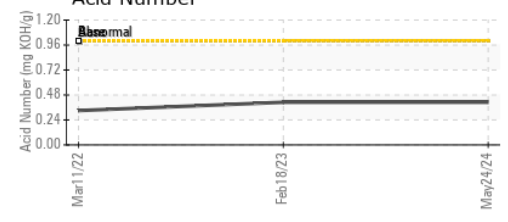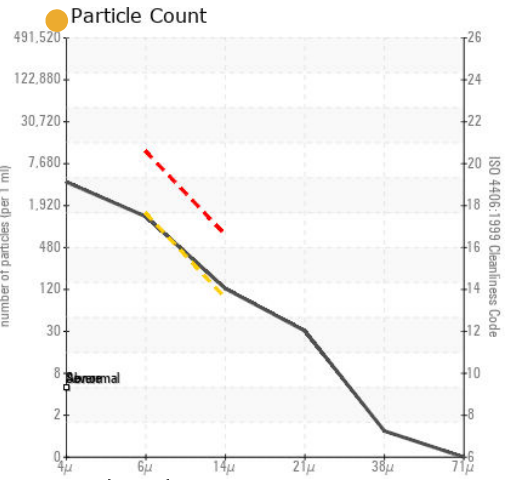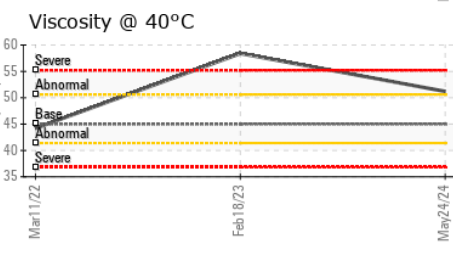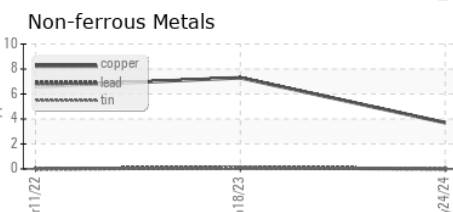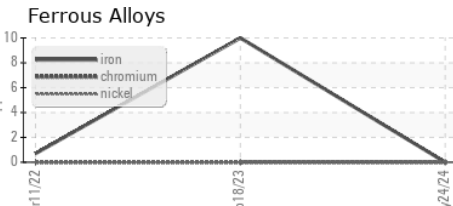

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA018061 **Received** : 10 Jun 2024  
**Lab Number** : 06205449 **Tested** : 12 Jun 2024  
**Unique Number** : 11072910 **Diagnosed** : 13 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**TANSKY ADVANCED AUTO BODY**  
 2475 W DUBLIN GRANVILLE RD  
 COLUMBUS, OH 43235  
 Contact: ROBERT VOLLMER  
 robert.vollmer@tansky.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)