




# OIL ANALYSIS REPORT

Sample Rating Trend

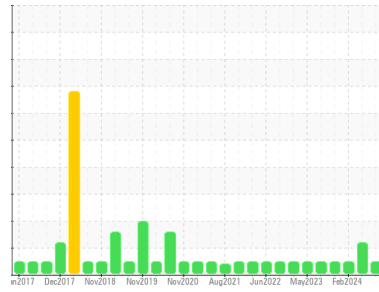

**NORMAL**



Machine Id  
**BUSCH VM7 / VP-2**  
 Component  
**Pump**  
 Fluid  
**USPI VAC 100 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM37596</b>	USP0006784	USPM30285
Sample Date	Client Info		<b>09 Jun 2024</b>	15 Apr 2024	28 Feb 2024
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >90	<b>4</b>	3	3
Chromium	ppm	ASTM D5185m >5	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >5	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >7	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >12	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >30	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >9	<b>&lt;1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	2	<1
Phosphorus	ppm	ASTM D5185m 1800	<b>1410</b>	1510	1033
Zinc	ppm	ASTM D5185m 0	<b>0</b>	0	19
Sulfur	ppm	ASTM D5185m 0	<b>0</b>	0	48

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >60	<b>11</b>	12	2
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	0	6
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >.1	<b>0.00</b>	0.044	0.020
ppm Water	ppm	ASTM D6304 >1000	<b>0</b>	445	202

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>2037</b>	8164	523
Particles >6µm	ASTM D7647	>1300	<b>823</b>	2469	199
Particles >14µm	ASTM D7647	>160	<b>137</b>	153	13
Particles >21µm	ASTM D7647	>40	<b>49</b>	28	4
Particles >38µm	ASTM D7647	>10	<b>5</b>	2	0
Particles >71µm	ASTM D7647	>3	<b>2</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>18/17/14</b>	20/18/14	16/15/11

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.05	<b>0.30</b>	0.30	0.38




# OIL ANALYSIS REPORT

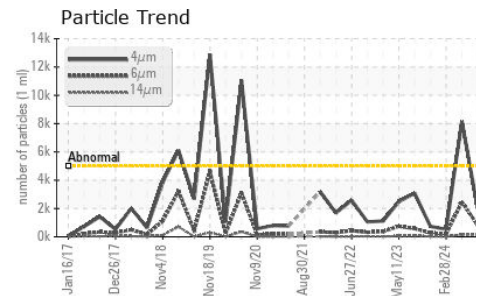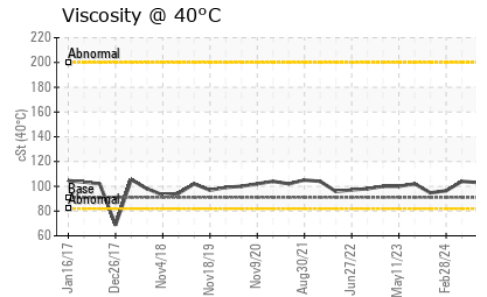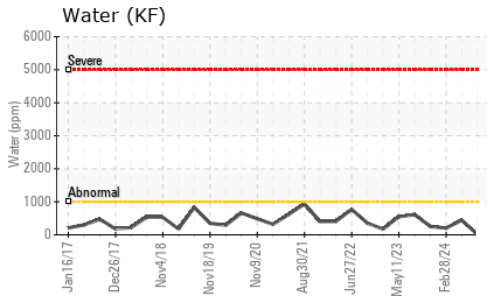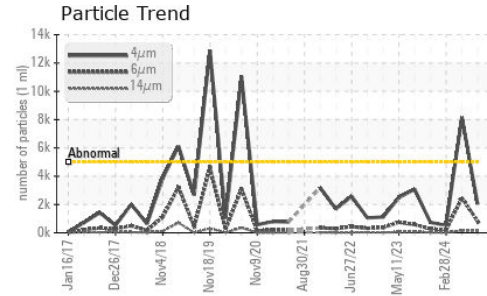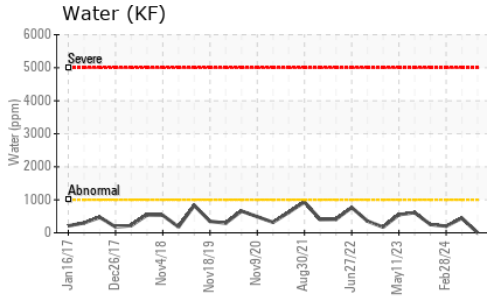






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 91	103	104	96.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

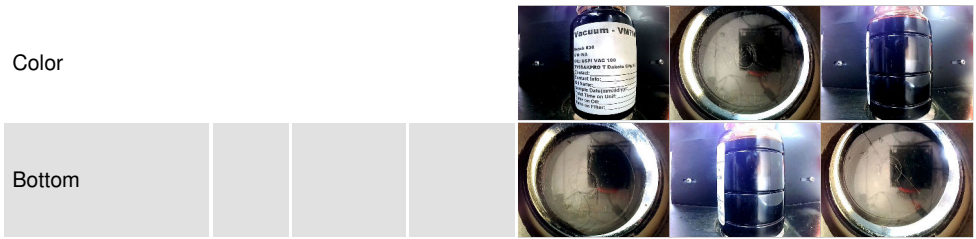

## GRAPHS

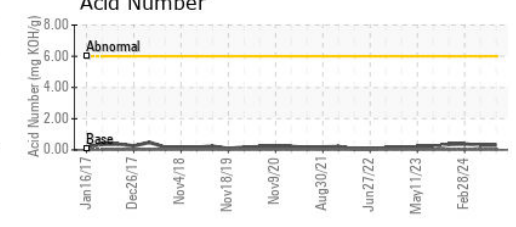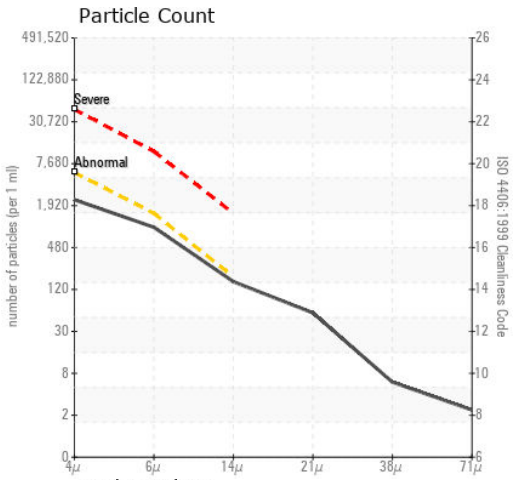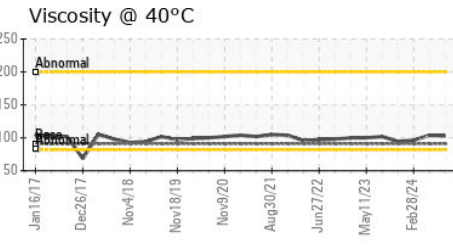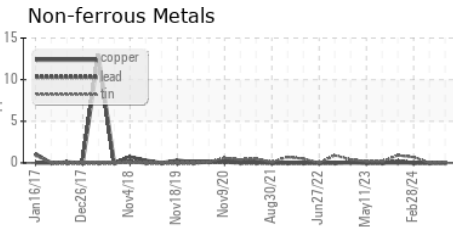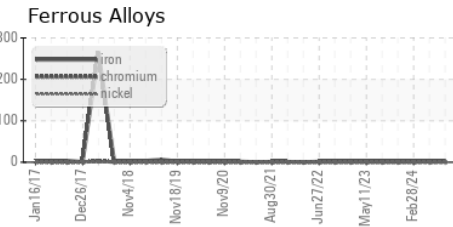

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM37596 **Received** : 10 Jun 2024  
**Lab Number** : 06205498 **Tested** : 12 Jun 2024  
**Unique Number** : 11072959 **Diagnosed** : 12 Jun 2024 - Doug Bogart  
**Test Package** : IND 2

**TYSON-DAKOTA CITY-PRO**  
 P.O. BOX 515  
 DAKOTA CITY, NE  
 US 68731  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)