


OIL ANALYSIS REPORT

Sample Rating Trend

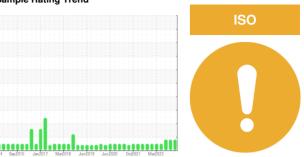

Machine Id

FRICK TYSCUM1-11 FRK (S/N TDSH19311944D)

Refrigeration Compressor

USPI ALT-68 SC (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		y2014 Sep20	15 Jan 2017 Mar 2018	Jun2019 Jun2020 Oct2021 N	Mar2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012407	USP0006906	USP0002716
Sample Date		Client Info		09 Jun 2024	15 Feb 2024	23 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ATTENTION	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	<1	8	8
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	<1	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	1	0
Calcium	ppm	ASTM D5185m		2	2	0
Phosphorus	ppm	ASTM D5185m		1	0	<1
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	39	33	29
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	1	<1	1
Sodium	ppm	ASTM D5185m		1	<1	0
Potassium	ppm	ASTM D5185m	>20	2	1	<1
Water	%	ASTM D6304	>0.01	0.003	0.006	0.003
ppm Water	ppm	ASTM D6304	>100	32	67	34.9
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		16600	22129	64364
Particles >6µm		ASTM D7647	>2500	2850	4406	1 4069
Particles >14µm		ASTM D7647	>320	16	147	53
Particles >21µm		ASTM D7647	>80	3	26	6
Particles >38µm		ASTM D7647	>20	0	0	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	2 1/19/11	22/19/14	△ 23/21/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.042	0.013





OIL ANALYSIS REPORT




Wa 250 ⊤ ¬ ¬ ¬	ter (K	F)						
200 - Seve	re							
Ē 150-								
150 - Abn	ormal	AA						
50-	W	\ \	M	۸.	~	1	M	١
0		7		V		Ų		ij
May22/1	_	=	Mar4/1	_	Jun25/2	54	Mar19/2	







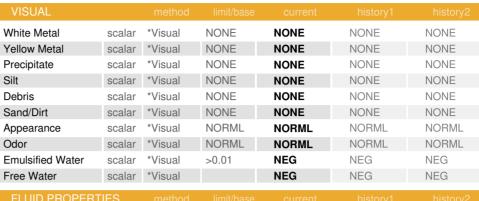


T LOID T HOT LITT						
Visc @ 40°C	cSt	ASTM D445	65.6	64.2	64.2	63.5

SAMPLE IMAGES

Color

Bottom



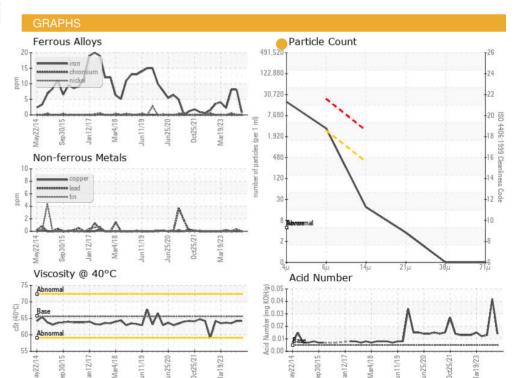





Laboratory Sample No.

: USP0012407 Lab Number : 06205526 Unique Number : 11072987

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 10 Jun 2024

Tested : 13 Jun 2024

Diagnosed : 13 Jun 2024 - Doug Bogart

Test Package : IND 2 Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (402)423-6375 F: (402)423-6661

CUMMING, GA

US 30130

TYSON -CUMMING-USP

Contact: BRENT SMITH