

OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

FRICK TYSCUM2-3 FRK (S/N TDSH233L223F)

Refrigeration Compressor

USPI ALT-68 SC (--- QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


2013 Apri2015 Sep2016 Mar2016 Juni2019 Juni2019 Over2021 Mar2022						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0012420	USP0006893	USP0002713
Sample Date		Client Info		09 Jun 2024	15 Feb 2024	23 Oct 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	<1	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		2	0	0
Phosphorus	ppm	ASTM D5185m		<1	0	<1
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	43	15	13
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	<1	<1
Sodium	ppm	ASTM D5185m		1	<1	0
Potassium	ppm	ASTM D5185m	>20	2	1	<1
Water	%	ASTM D6304	>0.01	0.005	0.006	0.005
ppm Water	ppm	ASTM D6304	>100	52	61	54.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2866	2243	3170
Particles >6µm		ASTM D7647	>2500	729	486	953
Particles >14µm		ASTM D7647	>320	14	22	49
Particles >21µm		ASTM D7647	>80	3	5	8
Particles >38µm		ASTM D7647	>20	0	0	1
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/18/15	19/17/11	18/16/12	19/17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.013	0.014	0.012





OIL ANALYSIS REPORT











VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
ELLID DDODEDT	150		11 1.0			

FLUID FROFEI	TIES	memou			HISTORY	HISTORYZ
Visc @ 40°C	cSt	ASTM D445	65.6	65.7	65.5	65.1

SAMPLE IMAGES	




Color









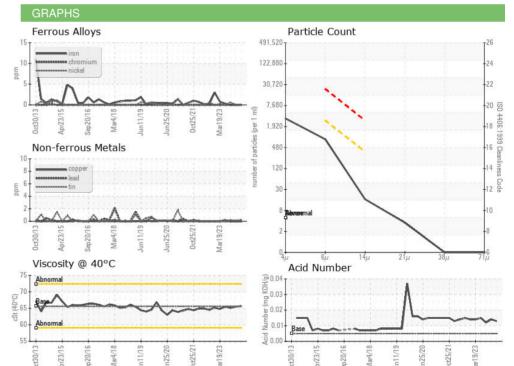





Certificate 12367

Laboratory Sample No.

: USP0012420 Lab Number : 06205539 Unique Number : 11073000

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 10 Jun 2024

Tested : 13 Jun 2024 Diagnosed : 13 Jun 2024 - Doug Bogart

Test Package : IND 2 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (402)423-6375 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (402)423-6661

CUMMING, GA

US 30130

TYSON - CUMMING-USP

Contact: BRENT SMITH