


# **OIL ANALYSIS REPORT**

# **CHEMLUBE 630 [1669073]** L6-TRFR-PB17 - PFNONWOVENS

Component Compressor





### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06205634	UCH05676298	UCH05282699
Sample Date		Client Info		05 May 2024	10 Sep 2022	07 Jun 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
CONTAMINATION	١	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	NEG
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4	4	5
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	2	2	0
Lead	ppm	ASTM D5185m	>25	3	0	0
Copper	ppm	ASTM D5185m	>50	4	<1	<1
Tin	ppm	ASTM D5185m	>15	1	0	0
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	4.1	0	4	7
Barium	ppm	ASTM D5185m	0.1	0	0	0
Molybdenum	ppm	ASTM D5185m	0	3	1	2
Manganese	ppm	ASTM D5185m	0.7	2	<1	<1
Magnesium	ppm	ASTM D5185m	0	<1	0	<1
Calcium	ppm	ASTM D5185m	0	8	11	19
Phosphorus	ppm	ASTM D5185m	1600	1028	1088	1002
Zinc	ppm	ASTM D5185m	0	5	12	8
Sulfur	ppm	ASTM D5185m	354	4671	7183	7020
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	2	3
Sodium	ppm	ASTM D5185m		2	0	0
Potassium	ppm	ASTM D5185m	>20	5	<1	0
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.102	0.27	0.31	0.369




210 200 190

## **OIL ANALYSIS REPORT**



VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	223.7	210	212	213
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						

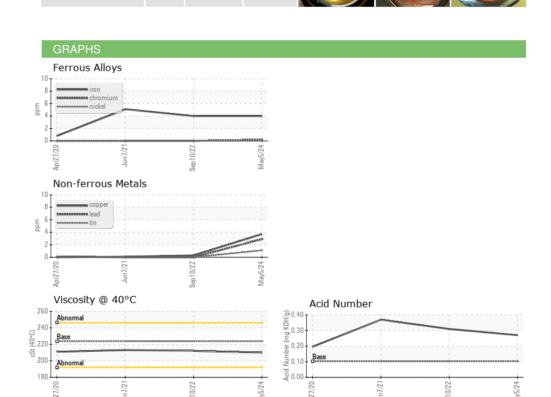





Certificate 12367

Laboratory Sample No.

Lab Number : 06205634

Test Package : IND 2

: UCH06205634 Unique Number : 11073095

**Bottom** 

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received **Tested** Diagnosed

: 10 Jun 2024 : 12 Jun 2024

: 12 Jun 2024 - Wes Davis

**CORROSION PRODUCTS & EQUIPMENT** 940 POINTVIEW AVE EPHRATA, PA

US 17522 Contact: RYAN HUNGARTER

rhungarter@corrosion-products.com T: (717)961-1998

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)