


# **FUEL REPORT**

# **OWENSBORO HEALTH OFFSITE TMOB MMCC [17631]** [OWENSBORO HEALTH OFFSITE TMOB MMCC] TMOB

**Diesel Fuel** 

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (125 GAL)





## **DIAGNOSIS**

#### Recommendation

We advise that you filter this fluid before use. All laboratory tests indicate that this sample meets ASTM D975 specifications for No.2 ultra-low-sulfur diesel fuel.

### Corrosion

The iron level is marginal.

#### Contaminants

There is a high amount of particulates present in the fuel. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The water content is negligible. There is no indication of any contamination in the fuel.


#### **Fuel Condition**

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

| ) (123 GAL)                |        |                  |            |             |          |          |
|----------------------------|--------|------------------|------------|-------------|----------|----------|
| SAMPLE INFORM              | MATION | method           | limit/base | current     | history1 | history2 |
| Sample Number              |        | Client Info      |            | WC06206055  |          |          |
| Sample Date                |        | Client Info      |            | 30 May 2024 |          |          |
| Machine Age                | hrs    | Client Info      |            | 0           |          |          |
| Sample Status              |        |                  |            | ABNORMAL    |          |          |
| PHYSICAL PROP              | ERTIES | method           | limit/base | current     | history1 | history2 |
| Fuel Color                 | text   | *Visual Screen   | Yllow      | Red         |          |          |
| ASTM Color                 | scalar | *ASTM D1500      |            | L4.5        |          |          |
| Visc @ 40°C                | cSt    | ASTM D445        | 3.0        | 2.57        |          |          |
| Pensky-Martens Flash Point | °C     | *PMCC Calculated | 52         | 59.3        |          |          |
| SULFUR CONTE               | NT     | method           | limit/base | current     | history1 | history2 |
| Sulfur                     | ppm    | ASTM D5185m      | 10         | 0           |          |          |
| Sulfur (UVF)               | ppm    | ASTM D5453       |            | 12          |          |          |
| DISTILLATION               |        | method           | limit/base | current     | history1 | history2 |
| nitial Boiling Point       | °C     | ASTM D86         | 165        | 171         |          |          |
| 5% Distillation Point      | °C     | ASTM D86         |            | 195         |          |          |
| 10% Distill Point          | °C     | ASTM D86         | 201        | 205         |          |          |
| 15% Distillation Point     | °C     | ASTM D86         |            | 213         |          |          |
| 20% Distill Point          | °C     | ASTM D86         | 216        | 221         |          |          |
| 30% Distill Point          | °C     | ASTM D86         | 230        | 236         |          |          |
| 40% Distill Point          | °C     | ASTM D86         | 243        | 251         |          |          |
| 50% Distill Point          | °C     | ASTM D86         | 255        | 265         |          |          |
| 60% Distill Point          | °C     | ASTM D86         | 267        | 279         |          |          |
| 70% Distill Point          | °C     | ASTM D86         | 280        | 293         |          |          |
| 80% Distill Point          | °C     | ASTM D86         | 295        | 307         |          |          |
| 35% Distillation Point     | °C     | ASTM D86         |            | 317         |          |          |
| 90% Distill Point          | °C     | ASTM D86         | 310        | 327         |          |          |
| 95% Distillation Point     | °C     | ASTM D86         |            | 344         |          |          |
| Final Boiling Point        | °C     | ASTM D86         | 341        | 360         |          |          |
| IGNITION QUALIT            | ΓΥ     | method           | limit/base | current     | history1 | history2 |
| API Gravity                |        | ASTM D7777       | 37.7       | 36          |          |          |
| Cetane Index               |        | ASTM D4737       | <40.0      | 48          |          |          |
| CONTAMINANTS               |        | method           | limit/base | current     | history1 | history2 |
| Silicon                    | ppm    | ASTM D5185m      | <1.0       | 0           |          |          |
| Sodium                     | ppm    | ASTM D5185m      | <0.1       | 1           |          |          |
| Potassium                  | ppm    | ASTM D5185m      | < 0.1      | 1           |          |          |
| Water                      | %      | ASTM D6304       | < 0.05     | 0.004       |          |          |
| opm Water                  | ppm    | ASTM D6304       | < 500      | 48          |          |          |
| % Gasoline                 | %      | *In-House        | < 0.50     | 0.0         |          |          |
| % Biodiesel                | %      | *In-House        | <20.0      | 0.0         |          |          |



## **FUEL REPORT**

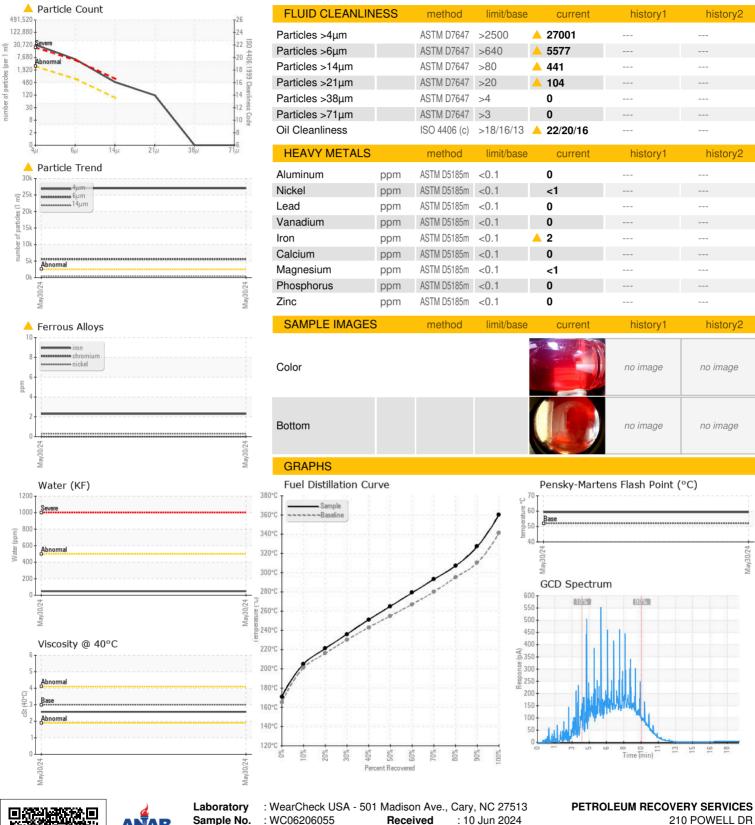





Certificate 12367

Sample No.

Lab Number : 06206055

: WC06206055

Unique Number : 11073516 Diagnosed Test Package : DF-2 (Additional Tests: Fuel, Screen)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

210 POWELL DR SUMMERVILLE, SC US 29483

Contact: AJAY EL Ajay@prsfuel.com T: (843)225-1777

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**Tested** 

: 19 Jun 2024

: 19 Jun 2024 - Elizabeth Valachovic