



OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id
KAESER 8494300
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KC130812	---	---
Sample Date	Client Info		06 May 2024	---	---
Machine Age	hrs	Client Info	3593	---	---
Oil Age	hrs	Client Info	1440	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			ABNORMAL	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	---	---
Chromium	ppm	ASTM D5185m >10	0	---	---
Nickel	ppm	ASTM D5185m >3	0	---	---
Titanium	ppm	ASTM D5185m >3	0	---	---
Silver	ppm	ASTM D5185m >2	0	---	---
Aluminum	ppm	ASTM D5185m >10	1	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >50	7	---	---
Tin	ppm	ASTM D5185m >10	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m 90	0	---	---
Molybdenum	ppm	ASTM D5185m	0	---	---
Manganese	ppm	ASTM D5185m	0	---	---
Magnesium	ppm	ASTM D5185m 90	21	---	---
Calcium	ppm	ASTM D5185m 2	0	---	---
Phosphorus	ppm	ASTM D5185m	1	---	---
Zinc	ppm	ASTM D5185m	21	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---	---
Sodium	ppm	ASTM D5185m	14	---	---
Potassium	ppm	ASTM D5185m >20	5	---	---
Water	%	ASTM D6304 >0.05	0.013	---	---
ppm Water	ppm	ASTM D6304 >500	139	---	---

FLUID CLEANLINESS


	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		5628	---	---
Particles >6µm	ASTM D7647	>1300	▲ 3054	---	---
Particles >14µm	ASTM D7647	>80	▲ 227	---	---
Particles >21µm	ASTM D7647	>20	17	---	---
Particles >38µm	ASTM D7647	>4	0	---	---
Particles >71µm	ASTM D7647	>3	0	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	---	---

FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.29	---	---

OIL ANALYSIS REPORT


▲ Particle Trend

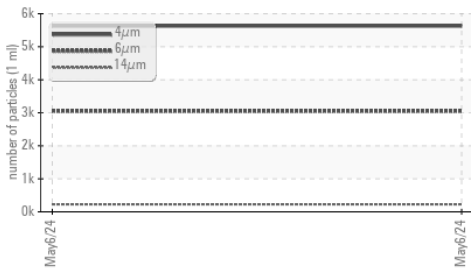


Water (KF)

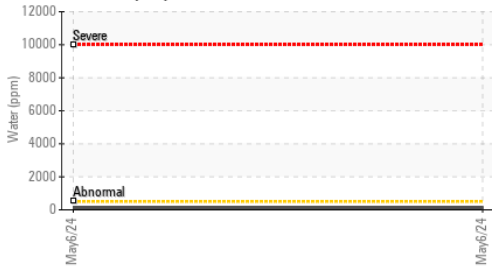


Acid Number

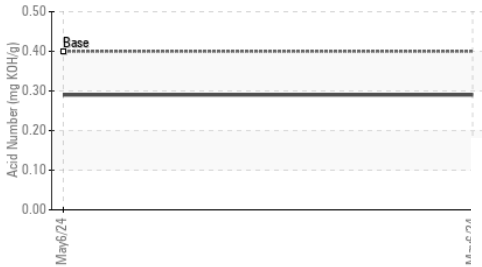

Water (KF)

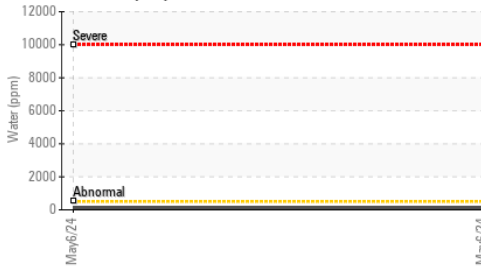

Viscosity @ 40°C

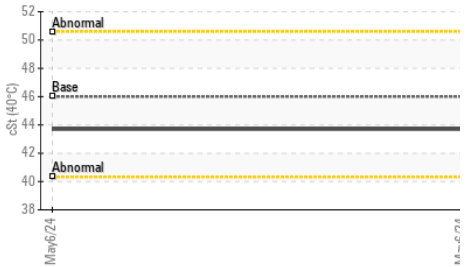

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.7	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color



no image

no image

Bottom



no image


no image

GRAPHS

Ferrous Alloys




Non-ferrous Metals

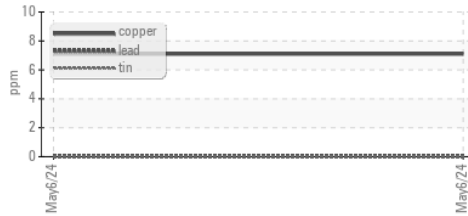


Viscosity @ 40°C



▲ Particle Count

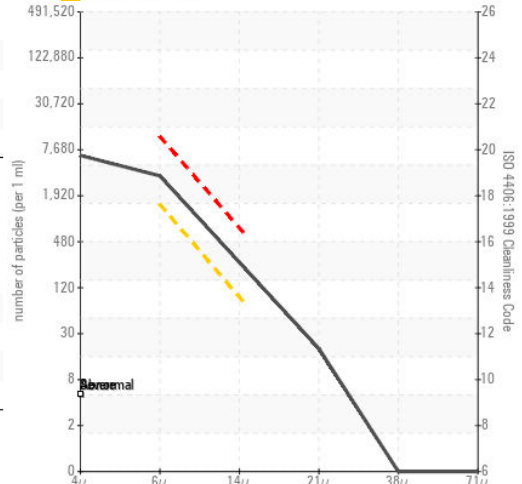

Acid Number

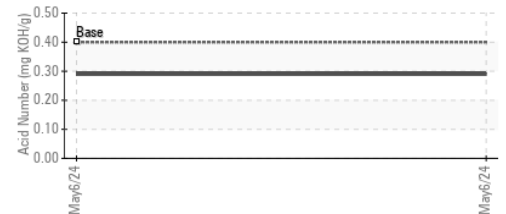

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KC130812

Lab Number : 06206501

Unique Number : 11073962

Test Package : IND 2

Received : 11 Jun 2024

Tested : 13 Jun 2024

Diagnosed : 13 Jun 2024 - Angela Borella

PACKAGING CORP OF AMERICA

15600 NW 15TH AVE M

MIAMI, FL

US 33169

Contact: GLEN RUFFALO

glennruffalo@packagingcorp.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)