


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER CSD 75T 4099433 (S/N 1152)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun2019	Sep 2019 Oct2020	Jan2022 Mar2023	May2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA016039	KCPA000157	KCP34805
Sample Date		Client Info		06 May 2024	02 Mar 2023	12 Jan 2022
Machine Age	hrs	Client Info		34348	29694	21835
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	1	<1
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	4	12	9
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m				0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	24	16	3
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	65	65	60
Calcium	ppm	ASTM D5185m	2	1	1	0
Phosphorus	ppm	ASTM D5185m		2	15	7
Zinc	ppm	ASTM D5185m		7	11	12
Sulfur	ppm	ASTM D5185m		20496	17780	18401
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	2	2
Sodium	ppm	ASTM D5185m		40	42	43
Potassium	ppm	ASTM D5185m	>20	6	9	6
Water	%	ASTM D6304	>0.05	0.023	0.027	0.014
ppm Water	ppm	ASTM D6304	>500	236	270.8	147.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		483	672	759
Particles >6µm		ASTM D7647	>1300	126	177	244
Particles >14μm		ASTM D7647	>80	14	12	22
Particles >21μm		ASTM D7647	>20	4	3	2
Particles >38μm		ASTM D7647	>4	0	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	16/14/11	17/15/11	15/12
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 0.4

0.32 0.282



OIL ANALYSIS REPORT

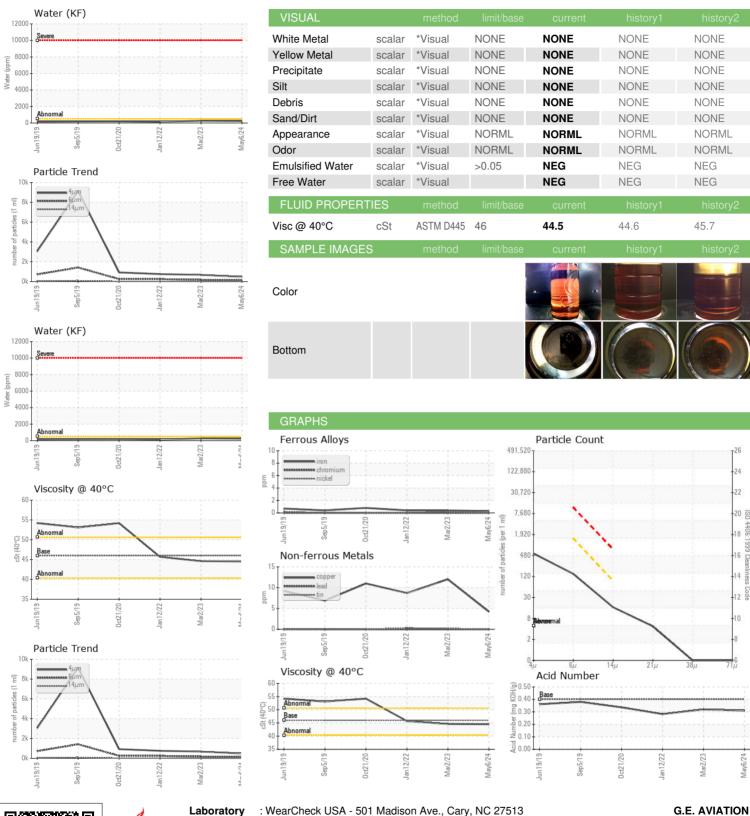





Sample No.

Laboratory Lab Number

Unique Number : 11073966

: KCPA016039 : 06206505

Received **Tested** Diagnosed

: 11 Jun 2024 : 13 Jun 2024

: 13 Jun 2024 - Angela Borella

1450 MS-6 BATESVILLE, MS US 38606 Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: