


# **OIL ANALYSIS REPORT**

Sample Rating Trend

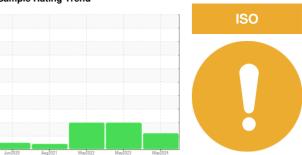

Machine Id

# KAESER BSD 50 7147160 (S/N 2192)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

#### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jun2020	Aug2021	May2022 May2023	May2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017629	KCP53824	KC103858
Sample Date		Client Info		14 May 2024	09 May 2023	06 May 2022
Machine Age	hrs	Client Info		10093	9320	9077
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Changed	Not Changd
Sample Status				ATTENTION	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	0	2	2
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	2	2	3
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m	90	8	<1	17
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	90	61	64	68
Calcium	ppm	ASTM D5185m	2	0	0	1
Phosphorus	ppm	ASTM D5185m		1	1	5
Zinc	ppm	ASTM D5185m		10	12	17
Sulfur	ppm	ASTM D5185m		20264	22411	17968
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	0	<1
Sodium	ppm	ASTM D5185m		16	12	11
Potassium	ppm	ASTM D5185m	>20	4	6	7
Water	%	ASTM D6304	>0.05	0.027	0.021	0.031
ppm Water	ppm	ASTM D6304	>500	279	211.2	312.7
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		3615	10749	25350
Particles >6µm		ASTM D7647	>1300	1216	2459	<u>▲</u> 6255
Particles >14μm		ASTM D7647	>80	95	<u>^</u> 205	<b>△</b> 456
Particles >21µm		ASTM D7647	>20	<u> </u>	<u></u> 58	<b>▲</b> 82
Particles >38µm		ASTM D7647	>4	1	<u>12</u>	<u> 7</u>
Particles >71µm		ASTM D7647	>3	0	1	2
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>19/17/14</b>	<u>\$\text{\Delta}\$ 21/18/15</u>	<u>22/20/16</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



## **OIL ANALYSIS REPORT**







Certificate 12367

Laboratory Sample No.

Lab Number

: 06206509

: KCPA017629 Unique Number : 11073970

Received : 11 Jun 2024 **Tested** Diagnosed

: 13 Jun 2024 Test Package : IND 2 ( Additional Tests: KF, PrtCount )

: 13 Jun 2024 - Don Baldridge

3104 S MAIN ST STUTTGART, AR US 72160

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: DELSTU [WUSCAR] 06206509 (Generated: 06/15/2024 08:09:32) Rev: 1

Contact/Location: Service Manager - DELSTU

T:

F: