





# OIL ANALYSIS REPORT

Sample Rating Trend

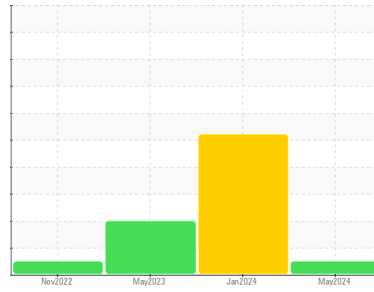

Machine Id  
**7546898 (S/N 1737)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC122256</b>	KC125322	KC05856175
Sample Date	Client Info			<b>21 May 2024</b>	24 Jan 2024	04 May 2023
Machine Age	hrs	Client Info		<b>2486</b>	2302	1141
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	4	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>20</b>	11	9
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>53</b>	34	45
Calcium	ppm	ASTM D5185m	2	<b>0</b>	1	<1
Phosphorus	ppm	ASTM D5185m		<b>2</b>	1	<1
Zinc	ppm	ASTM D5185m		<b>5</b>	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Sodium	ppm	ASTM D5185m		<b>10</b>	4	6
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	4
Water	%	ASTM D6304	>0.05	<b>0.038</b>	▲ 0.128	▲ 0.118
ppm Water	ppm	ASTM D6304	>500	<b>383</b>	▲ 1280	▲ 1180

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>1163</b>	---	---
Particles >6µm		ASTM D7647	>1300	<b>533</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>8</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>1</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>17/16/10</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.34</b>	0.33	0.26


# OIL ANALYSIS REPORT

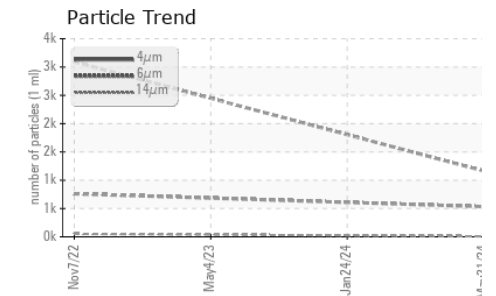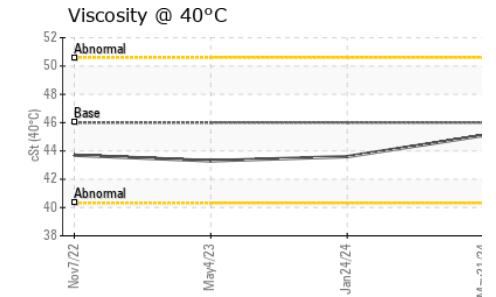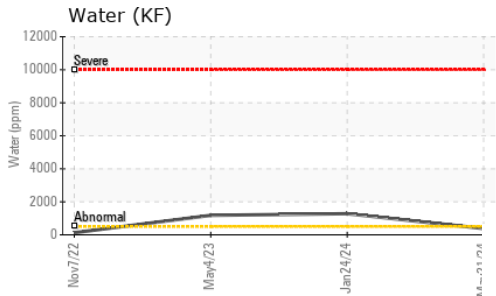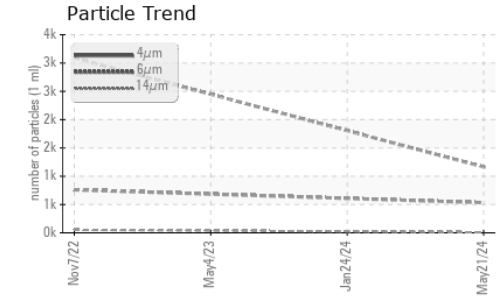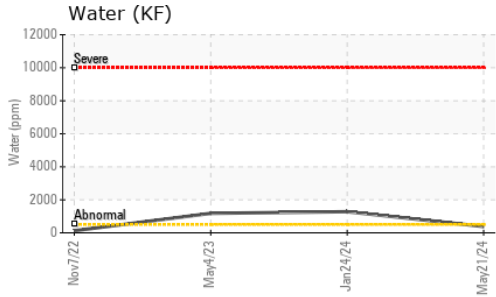





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	▲ MODER	NONE
Debris	scalar	*Visual	NONE	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	● HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	0.2%
Free Water	scalar	*Visual		NEG	▲ 10.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.1	43.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

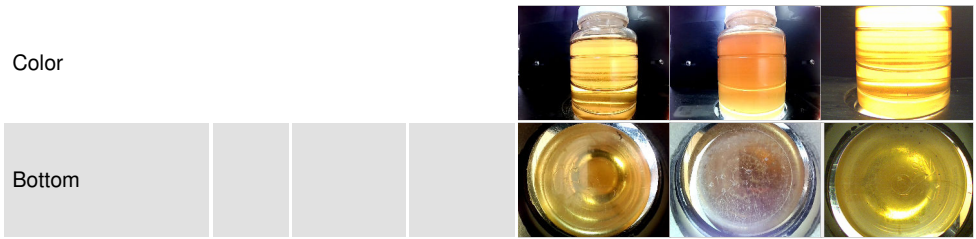

## GRAPHS

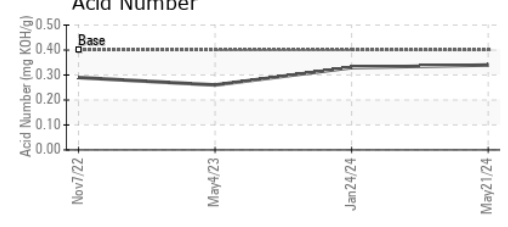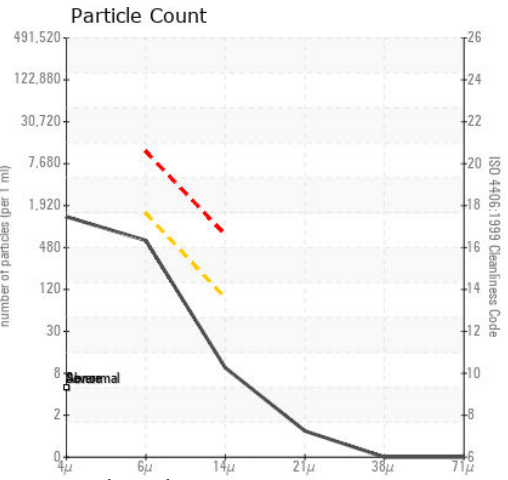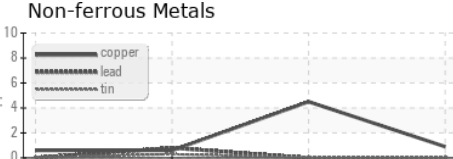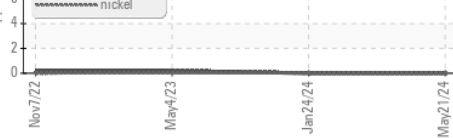

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC122256  
**Lab Number** : 06206528  
**Unique Number** : 11073989  
**Test Package** : IND 2  
**Received** : 11 Jun 2024  
**Tested** : 13 Jun 2024  
**Diagnosed** : 13 Jun 2024 - Don Baldrige

**APTIV**  
 13085 HAMILTON CROSSING BLVD  
 CARMEL, IN  
 US 46032  
 Contact: JEREMY MOON  
 jeremy.w.moon@aptiv.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)