


OIL ANALYSIS REPORT

Sample Rating Trend

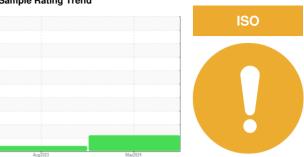

Machine Id

KAESER 7667873 (S/N 1059)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Aug2023	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA017843	KCPA005201	
Sample Date		Client Info		30 May 2024	23 Aug 2023	
Machine Age	hrs	Client Info		9718	6922	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				ATTENTION	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	<1	1	
Tin	ppm	ASTM D5185m	>10	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	61	36	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	81	69	
Calcium	ppm	ASTM D5185m	0	2	2	
Phosphorus	ppm	ASTM D5185m	0	<1	<1	
Zinc	ppm	ASTM D5185m	0	2	4	
Sulfur	ppm	ASTM D5185m	23500	20628	21440	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		16	20	
Potassium	ppm	ASTM D5185m	>20	3	10	
Water	%	ASTM D6304	>0.05	0.029	0.027	
ppm Water	ppm	ASTM D6304	>500	293	279.1	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4339		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	105		
Particles >21µm		ASTM D7647	>20	18		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/14		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40	0.39	



OIL ANALYSIS REPORT

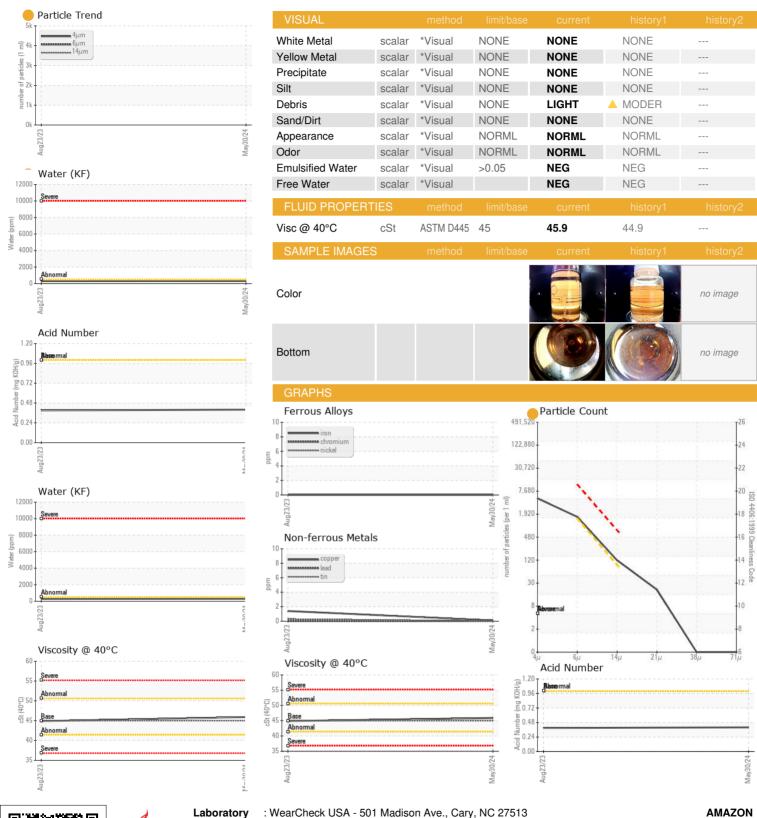



Laboratory Sample No.

Lab Number

: KCPA017843 : 06206530 Unique Number : 11073991

Received : 11 Jun 2024 **Tested** Diagnosed

Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 13 Jun 2024 : 13 Jun 2024 - Don Baldridge 7001 VOLLMER RD MATTESON, IL

Contact: Service Manager

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: AMAMAT [WUSCAR] 06206530 (Generated: 06/13/2024 17:03:14) Rev: 1

Contact/Location: Service Manager - AMAMAT

US 60443

T:

F: