


OIL ANALYSIS REPORT

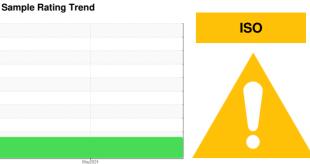

Machine Id

8352517 (S/N 1768)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		,	-	May2024		
CANADI E INICODA	AATIONI		11 11 11		111	1::
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125972		
Sample Date		Client Info		23 May 2024		
Machine Age	hrs	Client Info		761		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	6		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	67		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		1		
Zinc	ppm	ASTM D5185m		5		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m	720	9		
Potassium	ppm	ASTM D5185m	>20	7		
Water	%	ASTM D6304		0.020		
ppm Water	ppm	ASTM D6304	>500	203		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8406		
Particles >6µm		ASTM D7647	>1300	4648		
Particles >14µm		ASTM D7647	>80	<u>▲</u> 652		
Particles >21µm		ASTM D7647	>20	<u>▲</u> 127		
Particles >38µm		ASTM D7647	>4	1		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 20/19/17		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.32		
. ,						



OIL ANALYSIS REPORT

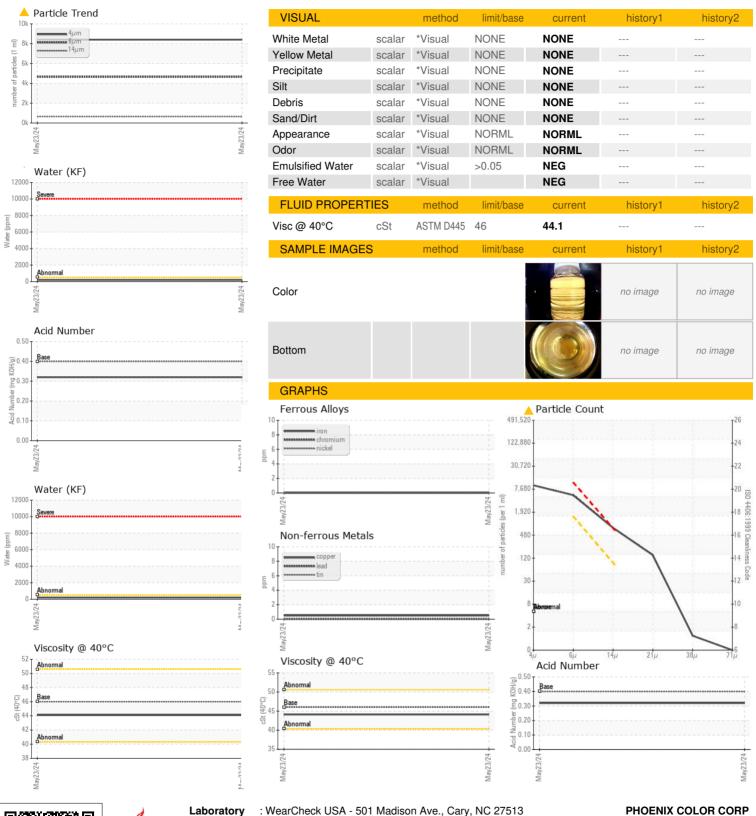





Certificate 12367

Laboratory Sample No. Lab Number : 06206549 Unique Number : 11074010

: KC125972 Test Package : IND 2

Received : 11 Jun 2024 **Tested** Diagnosed

: 13 Jun 2024 : 13 Jun 2024 - Don Baldridge

1116 COLLEGE AVE TERRE HAUTE, IN US 47802 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: PHOTER [WUSCAR] 06206549 (Generated: 06/13/2024 14:31:05) Rev: 1

Contact/Location: Service Manager - PHOTER

T:

F: