


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

SULLAIR TCCS SC 5 SUL (S/N 12791HGC)

Refrigeration Compressor

USPI 1009-68 SC (40 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		n2015 Mar20	17 Aug2018 Jul2019	Jul2020 Jul2021 Jun2022 J	un2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USP0013424	USP0006245	USP0004489
Sample Date		Client Info		10 Jun 2024	19 Mar 2024	11 Dec 2023
Machine Age	hrs	Client Info		252002	29061	24831
Oil Age	hrs	Client Info		839	9922	7624
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	0	0	0
Chromium	ppm	ASTM D5185m	>2	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	<1
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	<1	0	0
Tin	ppm	ASTM D5185m	>4	<1	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	0	<1
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		0	0	1
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m	50	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	<1	0	<1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	<1	2
Water	%	ASTM D6304	>0.01	0.001	0.001	0.001
ppm Water	ppm	ASTM D6304	>100	6	11	6
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	3888	1762	2533
Particles >6µm		ASTM D7647	>2500	872	428	838
Particles >14μm		ASTM D7647	>320	40	30	48
Particles >21µm		ASTM D7647	>80	7	8	10
Particles >38μm		ASTM D7647	>20	0	0	1
Particles >71μm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/17/12	18/16/12	19/17/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.005	0.014	0.014	0.014





OIL ANALYSIS REPORT












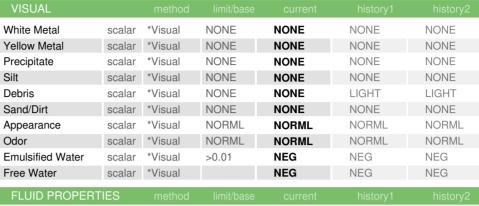


Visc @ 40°C	cSt	ASTM D445	67	73.9	▲ 81.9	78.00

SAMPLE IMAGES

Particle Count

Color

Bottom




491 52 122,88


30.72


















Certificate 12367

Laboratory Sample No. Lab Number Unique Number : 11074036

Test Package : IND 2

: USP0013424 : 06206575

Abnormal

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 11 Jun 2024 **Tested** : 14 Jun 2024

Diagnosed : 14 Jun 2024 - Doug Bogart

Jun 12/23

TYSON / TCCS - SIOUX CITY - USP

PO BOX 265 SIOUX CITY, IA US 51102

T: (712)279-0070

Contact: MICHAEL C SMITH

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (712)279-0069