


# **OIL ANALYSIS REPORT**

### Sample Rating Trend



**NORMAL** 



Machine Id

# FRICK SEAGUY C-8 (S/N 10241N85961967)

Refrigeration Compressor

FRICK COMPRESSOR OIL #9 (--- GAL)

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


v2099 0m2010 Mm2012 Feb2014 Apr2015 Mm2017 0m2016 Apr2022							
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2	
Sample Number		Client Info		USP0013447	USP0001132	USP246376	
Sample Date		Client Info		02 Jun 2024	15 Oct 2023	16 Mar 2023	
Machine Age	hrs	Client Info		10506	0	4979	
Oil Age	hrs	Client Info		0	0	0	
Oil Changed		Client Info		N/A	N/A	N/A	
Sample Status				NORMAL	NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>8	0	<1	<1	
Chromium	ppm	ASTM D5185m	>2	<1	0	0	
Nickel	ppm	ASTM D5185m		0	0	0	
Titanium	ppm	ASTM D5185m		<1	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	0	
Aluminum	ppm	ASTM D5185m	>3	0	0	0	
Lead	ppm	ASTM D5185m	>2	0	0	0	
Copper	ppm	ASTM D5185m	>8	<1	<1	0	
Tin	ppm	ASTM D5185m	>4	<1	0	0	
Vanadium	ppm	ASTM D5185m		0	0	0	
Cadmium	ppm	ASTM D5185m		<1	0	0	
ADDITIVES		method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0	
Barium	ppm	ASTM D5185m		0	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	0	
Magnesium	ppm	ASTM D5185m		<1	0	0	
Calcium	ppm	ASTM D5185m		0	0	0	
Phosphorus	ppm	ASTM D5185m		<1	0	0	
Zinc	ppm	ASTM D5185m		0	0	0	
Sulfur	ppm	ASTM D5185m		0	0	0	
CONTAMINANTS		method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<1	<1	0	
Sodium	ppm	ASTM D5185m		0	0	<1	
Potassium	ppm	ASTM D5185m	>20	<1	0	0	
Water	%	ASTM D6304	>0.01	0.001	0.001	0.003	
ppm Water	ppm	ASTM D6304	>100	7	2.0	27.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2	
Particles >4µm		ASTM D7647	>10000	577	1076	3423	
Particles >6µm		ASTM D7647	>2500	133	245	381	
Particles >14μm		ASTM D7647	>320	7	18	7	
Particles >21µm		ASTM D7647	>80	1	5	3	
Particles >38μm		ASTM D7647	>20	0	1	0	
Particles >71μm		ASTM D7647	>4	0	0	0	
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/10	17/15/11	19/16/10	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974		0.013	0.012	0.014	





## **OIL ANALYSIS REPORT**



80k -	************ 6/L	im im μm			1		
60k -					-		
40k -					1	1	
20k -	Abnormal			A	1	1	
0k	and Miles and	-	-	-	-	A Park	
	Mar10/09 Dec12/10	May17/12	Feb3/14	Apr23/15	Mar26/17	Dec9/18	Apr25/22








VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.01	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID DDODEDT	TEC.	and the set	111-11		for the control	la la karra O
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	64.0	66.3	67.7	64.5

Visc @ 40°C	cSt	ASTM D445	64.0	66.3	67.7	64.5
SAMPLE IMAGE	ES	method	limit/base	current	history1	history2

Color





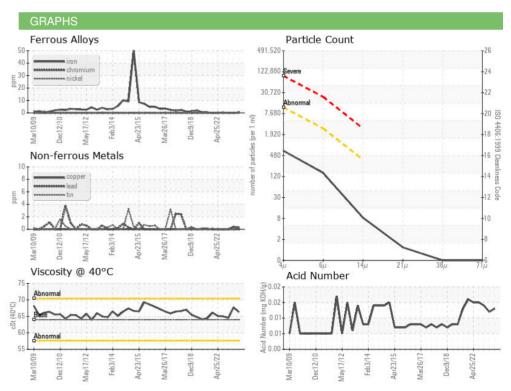





Certificate 12367

Laboratory Sample No.

: USP0013447 Lab Number : 06206589 Unique Number : 11074050 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 11 Jun 2024 **Tested** : 14 Jun 2024

Diagnosed : 14 Jun 2024 - Doug Bogart **SEABOARD FOODS** 2700 ne 28th street GUYMON, OK

US 73942 Contact: SERGIO CARLOS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: SEAGUY [WUSCAR] 06206589 (Generated: 06/15/2024 10:05:37) Rev: 1

Contact/Location: SERGIO CARLOS - SEAGUY

F:

T: (580)338-9613