


OIL ANALYSIS REPORT

Area PO Machine Id **KAESER 1076 - FUSIBOND PIPING SYSTEMS** Component





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UDI0000351	UCH05658619	
Sample Date		Client Info		05 Jun 2024	31 Aug 2022	
Machine Age	hrs	Client Info		47810	42594	
Oil Age	hrs	Client Info		5216	9842	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINATION		method	limit/base	current	history1	history2
Water		WC Method	>0.05	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	1	5	
Tin	ppm	ASTM D5185m	>10	<1	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		<1	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.1	0	0	
Barium	ppm	ASTM D5185m	0.8	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0.9	0	0	
Magnesium	ppm	ASTM D5185m	0	0	0	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	409	291	183	
Zinc	ppm	ASTM D5185m	0	55	0	
Sulfur	ppm	ASTM D5185m	1290	515	2279	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		0	0	
Potassium	ppm	ASTM D5185m	>20	<1	0	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.537	0.25	0.27	





OIL ANALYSIS REPORT

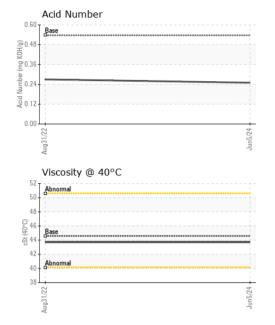













Certificate 12367

Laboratory Sample No.

: UDI0000351 Lab Number : 06206637 Unique Number : 11074098

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513

Received : 11 Jun 2024 **Tested** : 13 Jun 2024 Diagnosed

: 13 Jun 2024 - Wes Davis

DELTA INDUSTRIES - DOWNERS GROVE 2201 CURTISS STREET DOWNERS GROVE, IL US 60515

Contact: MICHAEL FERRIS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (630)960-3931