




OIL ANALYSIS REPORT

Sample Rating Trend

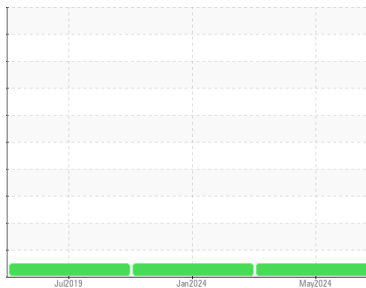

NORMAL



Area

SYNOIL 825

Machine Id

QUINCY QSV-40 UN052790 - MILWAUKEE COMPOSITES

Component

Compressor

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			UCZ06206650	UCZ06087477	UCZ04766342
Sample Date	Client Info			22 May 2024	25 Jan 2024	25 Jul 2019
Machine Age	hrs	Client Info		29946	78921	14519
Oil Age	hrs	Client Info		2838	1813	2000
Oil Changed	Client Info			Not Changed	Not Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	<1
Chromium	ppm	ASTM D5185m	>5	<1	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>15	2	0	<1
Lead	ppm	ASTM D5185m	>65	0	0	<1
Copper	ppm	ASTM D5185m	>65	3	2	<1
Tin	ppm	ASTM D5185m	>10	<1	<1	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.0	0	0	0
Barium	ppm	ASTM D5185m	0.0	0	2	8
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0	<1
Magnesium	ppm	ASTM D5185m	0.0	<1	0	15
Calcium	ppm	ASTM D5185m	0.0	0	0	1
Phosphorus	ppm	ASTM D5185m	966	16	48	107
Zinc	ppm	ASTM D5185m	0	0	0	1
Sulfur	ppm	ASTM D5185m	1309	1556	1565	3205

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	16	4	1
Sodium	ppm	ASTM D5185m		0	0	21
Potassium	ppm	ASTM D5185m	>20	<1	0	2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	0.087	0.05	0.027




OIL ANALYSIS REPORT

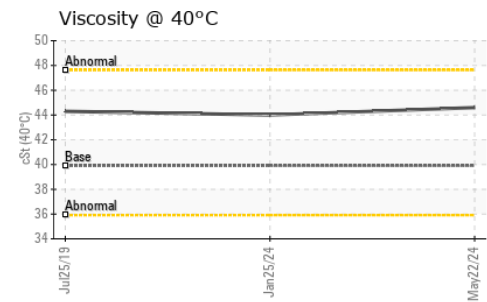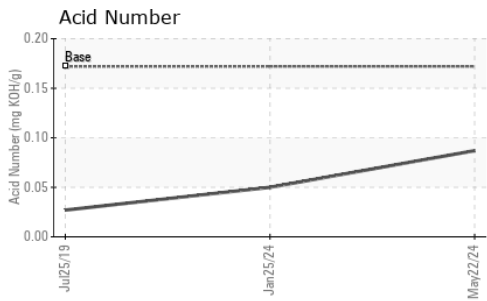





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	MODER	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	44.6	44.0	44.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

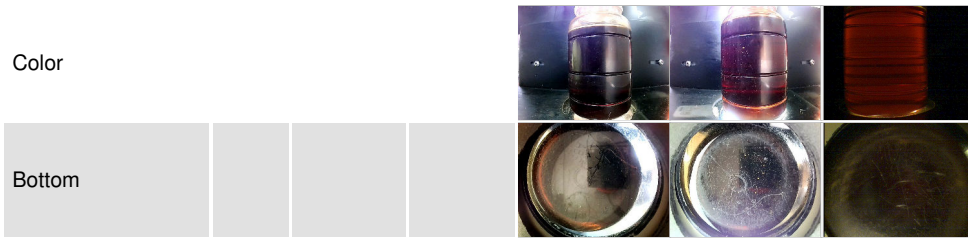

GRAPHS

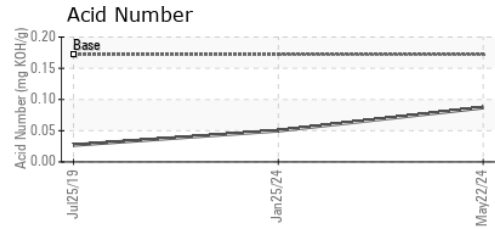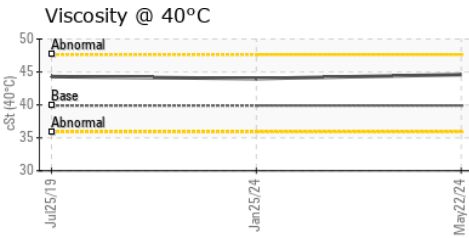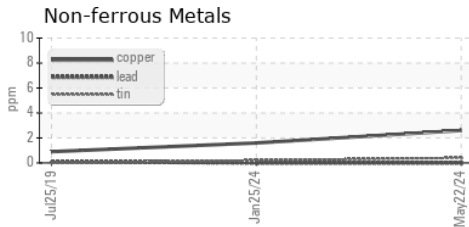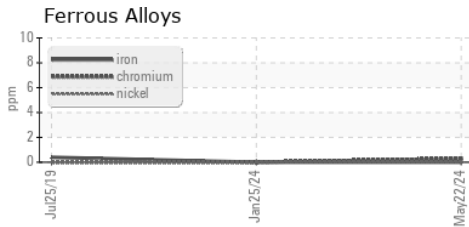

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCZ06206650 **Received** : 11 Jun 2024
Lab Number : **06206650** **Tested** : 13 Jun 2024
Unique Number : 11074111 **Diagnosed** : 13 Jun 2024 - Sean Felton
Test Package : IND 2

ZORN COMP & EQUIPMENT INC - MAIN
 1335 E WISCONSIN AVE
 PEWAUKEE, WI
 US 53072
 Contact: TONY STELLA
 tony.stella@zornair.com
 T: (800)476-4637
 F: (262)695-7017

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)