

# OIL ANALYSIS REPORT

Sample Rating Trend



**ADDITIVES**



Area

**PALLUBE 32 FG**

Machine Id

**PALATEK 23EE004089 - SALEM PARTNERS-HAGER RD**

Component

**Compressor**

**DIAGNOSIS**

**▲ Recommendation**

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

There is no indication of any contamination in the oil.

**▲ Fluid Condition**

An additive depletion is indicated. The AN level is acceptable for this fluid.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCS0620661</b>	---	---
Sample Date	Client Info			<b>31 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>4192</b>	---	---
Oil Age	hrs	Client Info		<b>4192</b>	---	---
Oil Changed	Client Info			<b>Changed</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	<b>NEG</b>	---	---




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	1	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	730	<b>▲ 0</b>	---	---
Molybdenum	ppm	ASTM D5185m	0	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m	0.0	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	0	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	0	<b>● 335</b>	---	---
Zinc	ppm	ASTM D5185m	0	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	590	<b>● 994</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>0</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	<b>0.51</b>	---	---

# OIL ANALYSIS REPORT

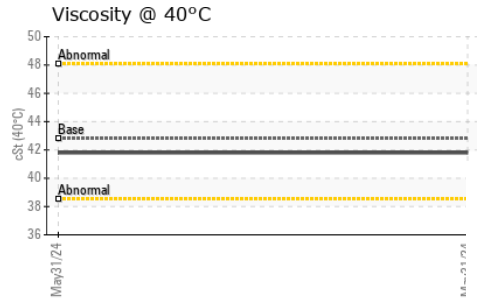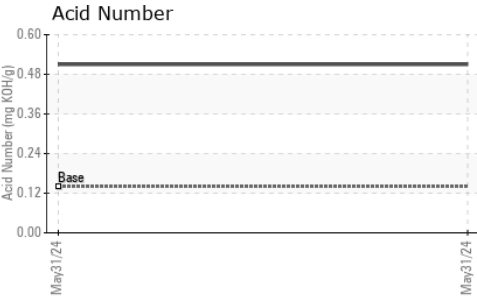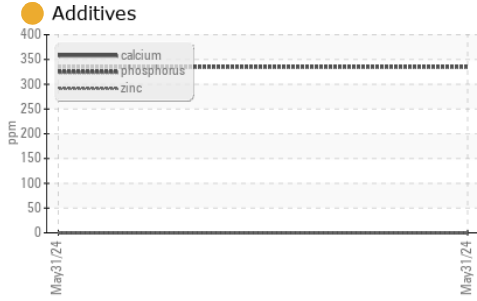






PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	42.8	41.8	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

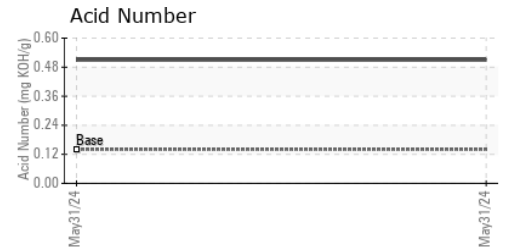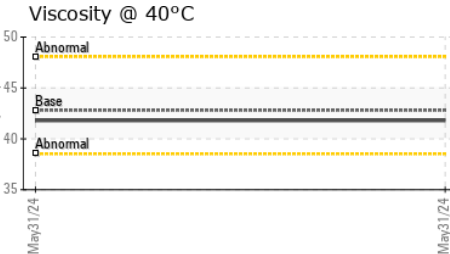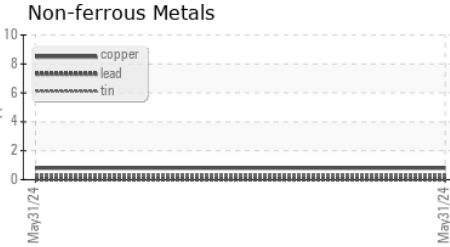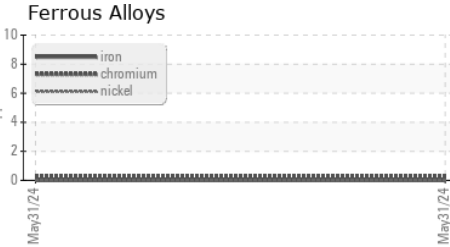

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS0620661  
**Lab Number** : 06206661  
**Unique Number** : 11074122  
**Test Package** : IND 2

**Received** : 11 Jun 2024  
**Tested** : 13 Jun 2024  
**Diagnosed** : 13 Jun 2024 - Angela Borella

**VACUUM PUMP and COMPRESSOR**  
 1490 GRUBER RD  
 GREEN BAY, WI  
 US 54313  
 Contact: ROBIN  
 robin@vpc-inc.com  
 T: (920)662-1113  
 F: (920)662-1116

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)