


**OIL ANALYSIS REPORT** 

# **NOT GIVEN [PM6-3475773] GARDNER DENVER S18077 - PACIFIC ALMOND**

Component



#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

#### Contamination

There is a moderate amount of visible silt present in the sample.

### Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		UCH06206676		
Sample Date		Client Info		31 May 2024		
Machine Age	hrs	Client Info		2809		
Oil Age	hrs	Client Info		2096		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m		0		
Titanium	ppm	ASTM D5185m		<1		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	2		
Lead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	4		
Tin	ppm	ASTM D5185m	>15	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		<1		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		2		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		3302		
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		0		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.1	0.086		
ppm Water	ppm	ASTM D6304	>1000	860		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045

0.09



## **OIL ANALYSIS REPORT**

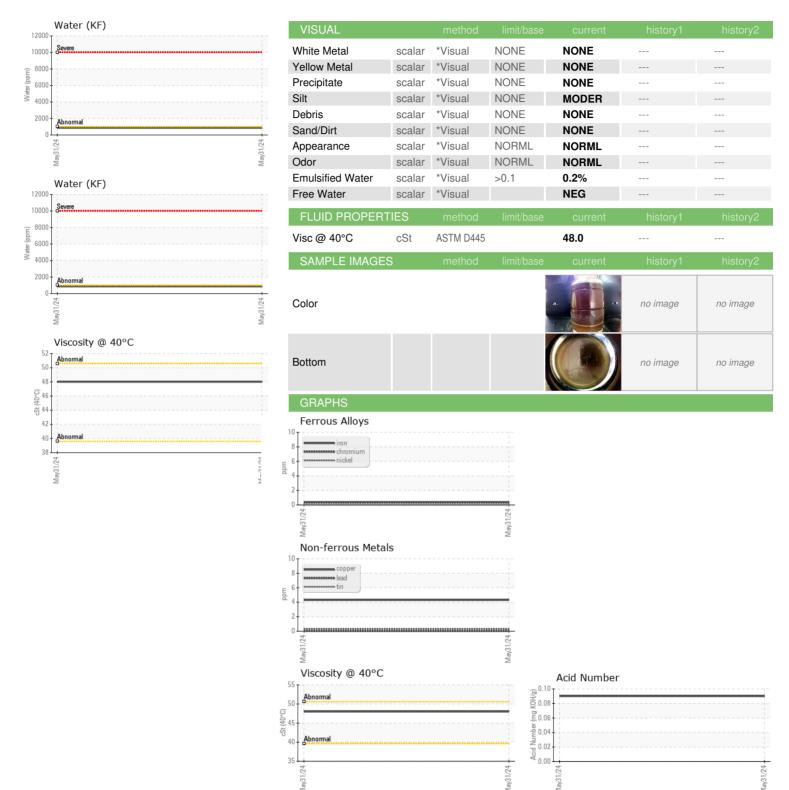





Certificate 12367

Laboratory Sample No.

Lab Number : 06206676 Unique Number : 11074137

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06206676

Received : 11 Jun 2024 **Tested** 

: 13 Jun 2024 Diagnosed : 13 Jun 2024 - Angela Borella

Test Package : IND 2 ( Additional Tests: KF ) To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CISCO AIR SYSTEMS** 

214 27TH ST SACRAMENTO, CA US 95816

Contact: BARRY FRKOVICH barryfrkovich@ciscoair.com

T: (916)444-2525 F: x:

Contact/Location: BARRY FRKOVICH - UCCISSAC