



# OIL ANALYSIS REPORT

Sample Rating Trend



DEGRADATION



Area

**CS-46 [PM6-2818315]**

Machine Id

**SULLAIR 202202080042 - POLYMER PAK**

Component

**Compressor**

## DIAGNOSIS

### ▲ Recommendation

We advise that you check for a possible overheat condition. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### ▲ Fluid Condition

The AN level is above the recommended limit. The oil viscosity is higher than normal. TAN level indicates possible presence of varnish.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06206685</b>	---	---
Sample Date	Client Info		<b>01 May 2024</b>	---	---
Machine Age	hrs	Client Info	<b>9175</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>2</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>1</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1.5	<b>0</b>	---	---
Barium	ppm	ASTM D5185m 0	<b>300</b>	---	---
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m 0.3	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m 0	<b>1</b>	---	---
Calcium	ppm	ASTM D5185m 0	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m 406	<b>70</b>	---	---
Zinc	ppm	ASTM D5185m 0	<b>9</b>	---	---
Sulfur	ppm	ASTM D5185m 1283	<b>433</b>	---	---

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m	<b>33</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>6</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.463	<b>▲ 2.54</b>	---	---



# OIL ANALYSIS REPORT

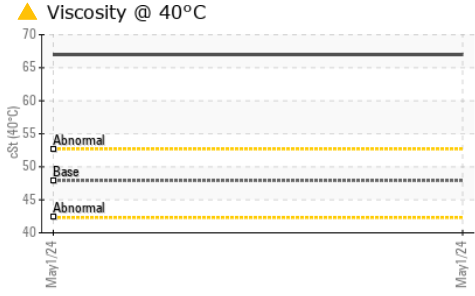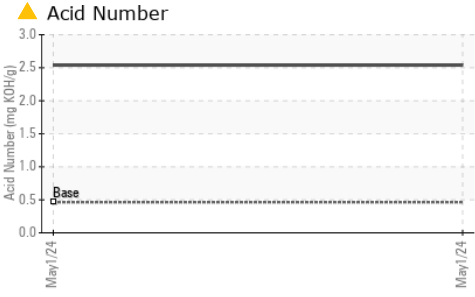





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.9 ▲ 67.0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

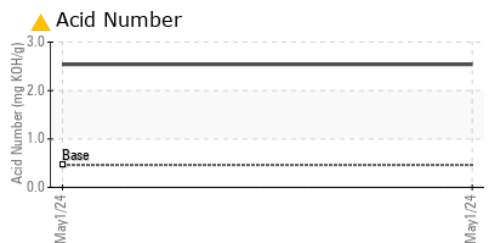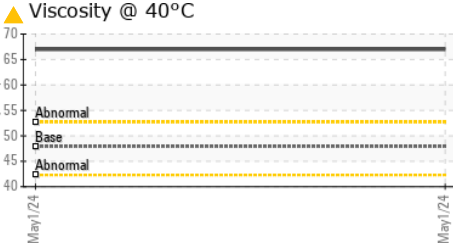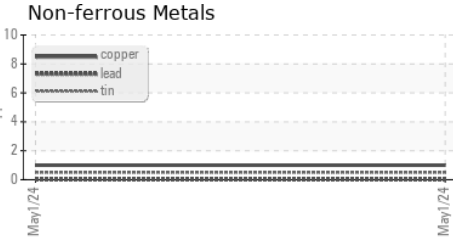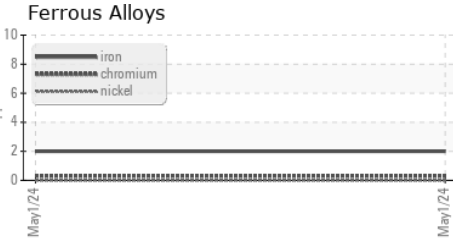

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06206685      **Received** : 11 Jun 2024  
**Lab Number** : 06206685      **Tested** : 13 Jun 2024  
**Unique Number** : 11074146      **Diagnosed** : 13 Jun 2024 - Angela Borella  
**Test Package** : IND 2

**CISCO AIR SYSTEMS**  
 214 27TH ST  
 SACRAMENTO, CA  
 US 95816  
 Contact: BARRY FRKOVICH  
 barryfrkovich@ciscoair.com  
 T: (916)444-2525  
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)