


OIL ANALYSIS REPORT

PRISTINE FG [420456]

SULLAIR 202011120033 - SONOCO PRODUCTS

Component Compressor





DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of visible silt present in the sample.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

| SAMPLE INFORM | MATION | method | limit/base | current | history1 | history2 |
|---------------|--------|-------------|------------|-------------|----------|----------|
| Sample Number | | Client Info | | UCH06206701 | | |
| Sample Date | | Client Info | | 03 May 2024 | | |
| Machine Age | hrs | Client Info | | 16161 | | |
| Oil Age | hrs | Client Info | | 1087 | | |
| Oil Changed | | Client Info | | Not Changd | | |
| Sample Status | | | | NORMAL | | |
| CONTAMINATIO | N | method | limit/base | current | history1 | history2 |
| Water | | WC Method | >0.1 | NEG | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | 0 | | |
| Chromium | ppm | ASTM D5185m | >10 | <1 | | |
| Nickel | ppm | ASTM D5185m | | 0 | | |
| Titanium | ppm | ASTM D5185m | | <1 | | |
| Silver | ppm | ASTM D5185m | | 0 | | |
| Aluminum | ppm | ASTM D5185m | >25 | 2 | | |
| Lead | ppm | ASTM D5185m | >25 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | <1 | | |
| Tin | ppm | ASTM D5185m | >15 | <1 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | <1 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | 0 | 0 | | |
| Barium | ppm | ASTM D5185m | 0 | 0 | | |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | | |
| Manganese | ppm | ASTM D5185m | | 0 | | |
| Magnesium | ppm | ASTM D5185m | 0 | <1 | | |
| Calcium | ppm | ASTM D5185m | 0 | 0 | | |
| Phosphorus | ppm | ASTM D5185m | 0 | 0 | | |
| Zinc | ppm | ASTM D5185m | 2 | 0 | | |
| Sulfur | ppm | ASTM D5185m | | 9 | | |
| CONTAMINANTS | ; | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | <1 | | |
| Sodium | ppm | ASTM D5185m | | 0 | | |
| Potassium | ppm | ASTM D5185m | >20 | <1 | | |
| FLUID DEGRADA | NOITA | method | limit/base | current | history1 | history2 |
| | | | | | | |


0.32


Acid Number (AN)


mg KOH/g ASTM D8045 0.06





OIL ANALYSIS REPORT

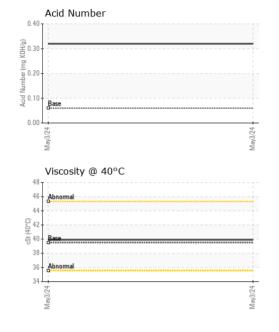

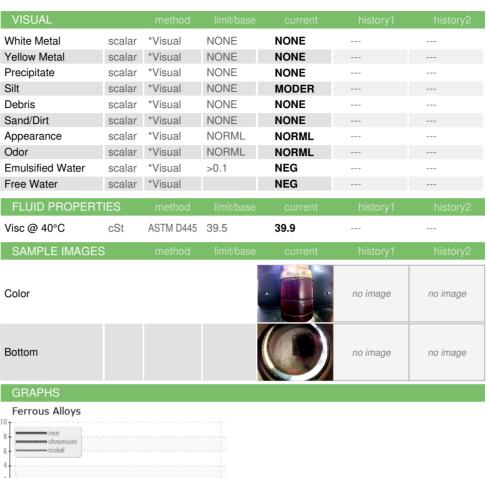











Certificate 12367

Laboratory Sample No.

Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCH06206701 Lab Number : 06206701 Unique Number : 11074162

Received : 11 Jun 2024 **Tested** : 13 Jun 2024 Diagnosed

: 13 Jun 2024 - Angela Borella

AIRMATIC COMPRESSOR SYSTEMS

700 WASHINGTON AVE CARLSTADT, NJ US 07072

Contact: ELVIN DIAZ ediaz@airmaticcompressor.com;canastasio@wearcheckusa.com

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

T: (800)864-7621 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (201)342-6241

Report Id: UCAIRCAR [WUSCAR] 06206701 (Generated: 06/15/2024 08:39:53) Rev: 1

Contact/Location: ELVIN DIAZ - UCAIRCAR