




# OIL ANALYSIS REPORT

Sample Rating Trend

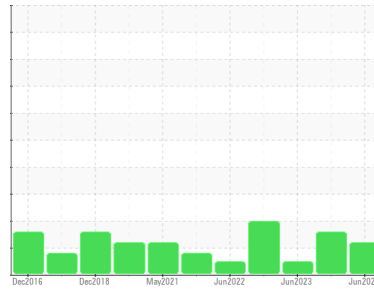

ISO



Machine Id  
**KAESER SK 26 1423871 (S/N 0267556)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA018299</b>	KCPA010993	KCPA0032121
Sample Date	Client Info			<b>04 Jun 2024</b>	12 Dec 2023	21 Jun 2023
Machine Age	hrs	Client Info		<b>69119</b>	69118	32508
Oil Age	hrs	Client Info		<b>4000</b>	0	0
Oil Changed	Client Info			<b>Changed</b>	N/A	N/A
Sample Status				<b>ATTENTION</b>	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>0</b>	2	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	1	1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>12</b>	0	24
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m	90	<b>68</b>	74	71
Calcium	ppm	ASTM D5185m	2	<b>1</b>	<1	3
Phosphorus	ppm	ASTM D5185m		<b>1</b>	41	<1
Zinc	ppm	ASTM D5185m		<b>11</b>	4	0
Sulfur	ppm	ASTM D5185m		<b>20695</b>	28034	22642

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	0	0
Sodium	ppm	ASTM D5185m		<b>27</b>	36	21
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	5	3
Water	%	ASTM D6304	>0.05	<b>0.028</b>	0.013	0.024
ppm Water	ppm	ASTM D6304	>500	<b>285</b>	140	243.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>5953</b>	32435	4628
Particles >6µm		ASTM D7647	>1300	<b>1777</b>	▲ 5980	1180
Particles >14µm		ASTM D7647	>80	<b>121</b>	▲ 120	69
Particles >21µm		ASTM D7647	>20	<b>28</b>	▲ 25	14
Particles >38µm		ASTM D7647	>4	<b>3</b>	1	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>20/18/14</b>	▲ 22/20/14	19/17/13

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.32</b>	0.30	0.33


# OIL ANALYSIS REPORT

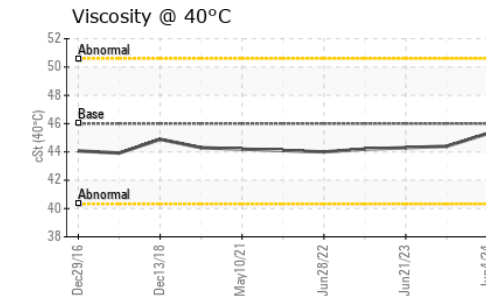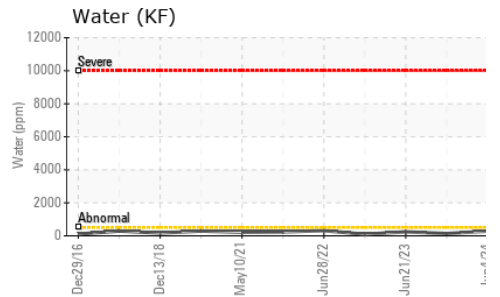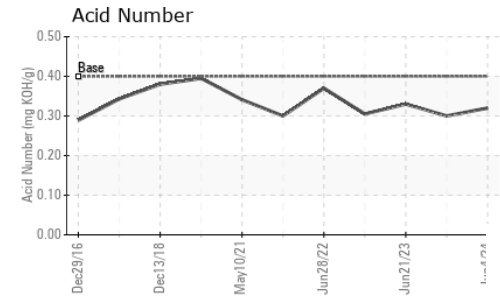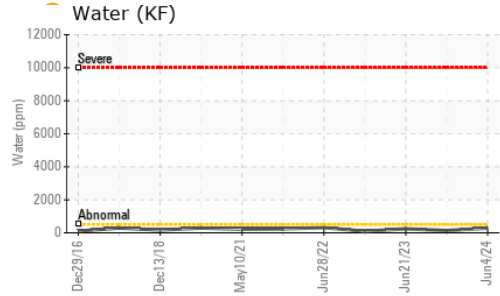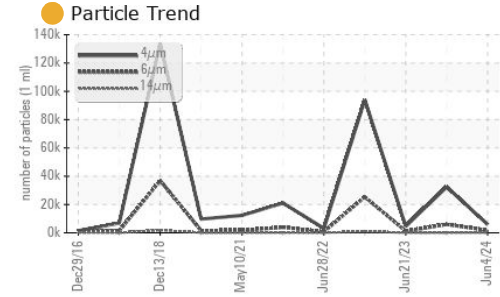





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	45.3	44.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

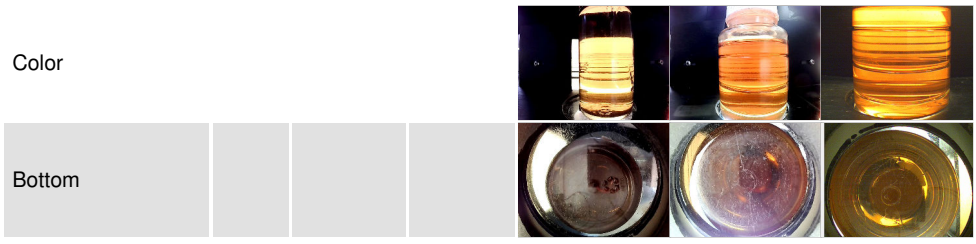

## GRAPHS

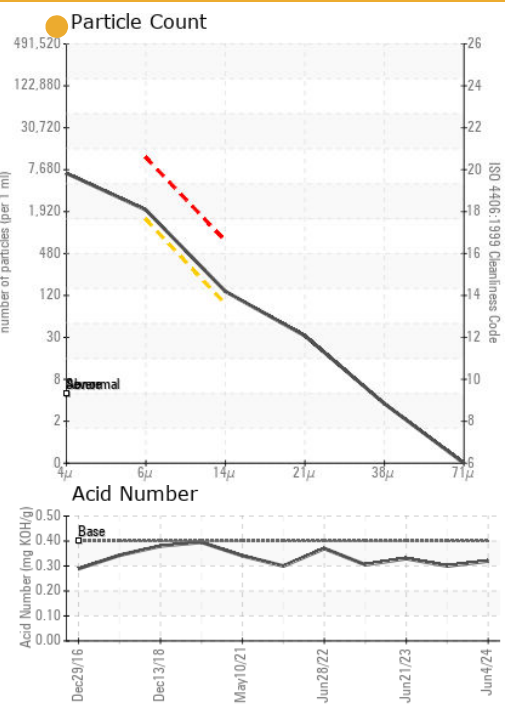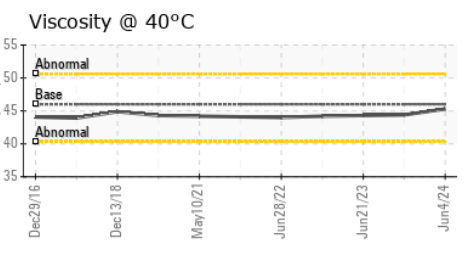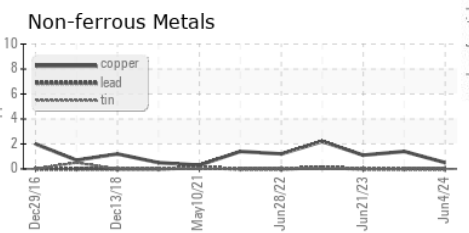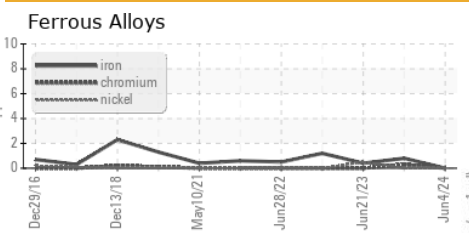

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA018299 **Received** : 11 Jun 2024  
**Lab Number** : 06207109 **Tested** : 13 Jun 2024  
**Unique Number** : 11074570 **Diagnosed** : 13 Jun 2024 - Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**POMPS TIRE**  
 7231 GENE ST  
 DEFOREST, WI  
 US 53532  
 Contact: K. DUREN  
 KDUEN@POMPSTIRE.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)