


## **OIL ANALYSIS REPORT**

Sample Rating Trend

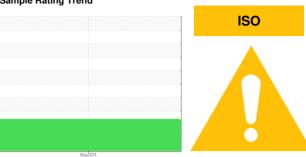

Machine Id

# 8142548 (S/N 1007)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### **DIAGNOSIS**

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.


#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

				May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018034		
Sample Date		Client Info		17 May 2024		
Machine Age	hrs	Client Info		2450		
Oil Age	hrs	Client Info		2450		
Oil Changed		Client Info		Changed		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium		ASTM D5185m	>10	0		
Cadmium	ppm	ASTM D5185m		0		
	ppm					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	23		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	26		
Sulfur	ppm	ASTM D5185m	23500	21043		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		10		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.05	0.015		
ppm Water	ppm	ASTM D6304	>500	157		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		46845		
Particles >6µm		ASTM D7647	>1300	<u>23129</u>		
Particles >14µm		ASTM D7647	>80	<u>▲</u> 3231		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38μm		ASTM D7647	>4	<u>▲</u> 62		
Particles >71µm		ASTM D7647	>3	<u>^</u> 6		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>23/22/19</u>		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37		



## **OIL ANALYSIS REPORT**

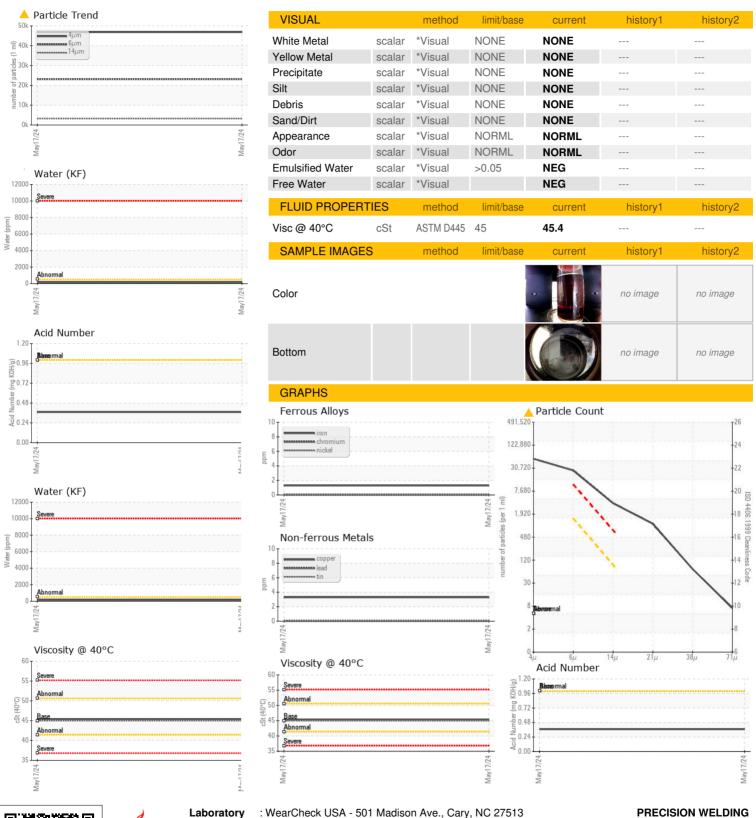



Laboratory Sample No.

Lab Number

: KCPA018034 : 06207113 Unique Number : 11074574

Received : 11 Jun 2024 **Tested** : 13 Jun 2024 Diagnosed

: 13 Jun 2024 - Angela Borella

ZANESVILLE, OH US 43701

3445 CHURCH HILL RD

Contact: Service Manager

Test Package : IND 2 ( Additional Tests: KF, PrtCount ) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: PREZAN [WUSCAR] 06207113 (Generated: 06/15/2024 08:47:43) Rev: 1

Contact/Location: Service Manager - PREZAN

T:

F: