

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

9194737 (S/N 2275) Component Compressor

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018398		
Sample Date		Client Info		03 Jun 2024		
Machine Age	hrs	Client Info		3259		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	9		
Tin		ASTM D5185m	>00	9		
	ppm		210	-		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	24		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	100	27		
Calcium	ppm	ASTM D5185m	0	<1		
Phosphorus	ppm	ASTM D5185m	0	2		
Zinc	ppm	ASTM D5185m	0	8		
Sulfur	ppm	ASTM D5185m	23500	18956		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		8		
Potassium	ppm	ASTM D5185m	>20	13		
Water	%	ASTM D6304	>0.05	0.015		
ppm Water	ppm	ASTM D6304	>500	152		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1014		
Particles >6µm		ASTM D7647	>1300	207		
Particles >14µm		ASTM D7647	>80	14		
Particles >21µm		ASTM D7647	>20	4		
Particles >38µm		ASTM D7647	>4	0		
Particles >71µm		ASTM D7647	>3	0		
		ISO 4406 (c)	>/17/13	17/15/11		
Oil Cleanliness		100 4400 (0)	/ ////10			
Oil Cleanliness FLUID DEGRADA	TION _	method	limit/base	current	history1	history2




OIL ANALYSIS REPORT





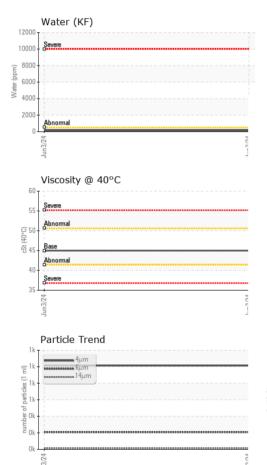

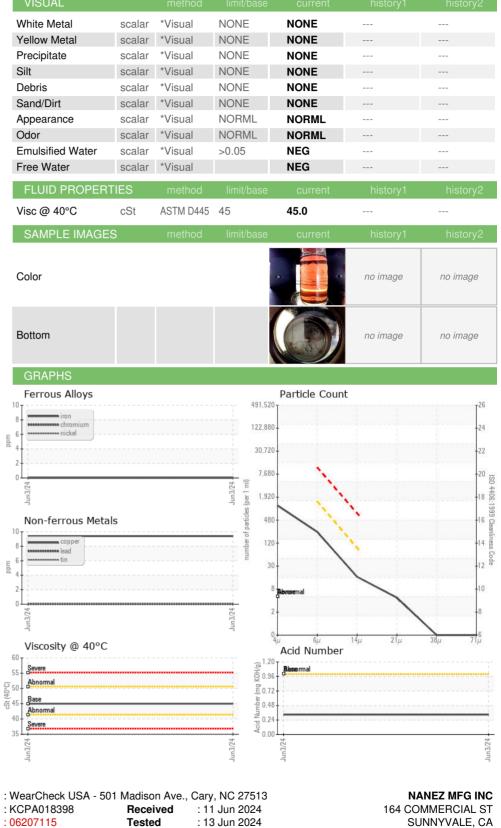



Lab Number : 06207115 Tested : 13 Jun 2024 Unique Number : 11074576 Diagnosed : 13 Jun 2024 - Angela Borella Test Package : IND 2 (Additional Tests: KF, PrtCount) Contact: Service Manager Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369. rogelioarroyo1@hotmail.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: NANSUN [WUSCAR] 06207115 (Generated: 06/13/2024 16:29:03) Rev: 1

Laboratory

Sample No.

Contact/Location: Service Manager - NANSUN

Page 2 of 2

US 94086

T:

F: