


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id

KAESER ASD 30T 2216825 (S/N 1019)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Dec2017	Jan 2019 Mar 2021	Jun2022 Jun2023	May2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018024	KCPA001927	KCP40439
Sample Date		Client Info		29 May 2024	08 Jun 2023	08 Jun 2022
Machine Age	hrs	Client Info		73836	68454	63170
Oil Age	hrs	Client Info		4000	0	6500
Oil Changed		Client Info		Changed	N/A	Changed
Sample Status				NORMAL	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	<1	<1
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	4	7	15
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	<1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	100	31	<1	2
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	3	4
Zinc	ppm	ASTM D5185m	0	15	<1	9
Sulfur	ppm	ASTM D5185m	23500	20933	21676	22315
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		15	1	0
Potassium	ppm	ASTM D5185m	>20	1	0	1
Water	%	ASTM D6304	>0.05	0.016	0.005	0.010
ppm Water	ppm	ASTM D6304	>500	163	53.0	104.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		1563	11423	2475
Particles >6µm		ASTM D7647	>1300	365	△ 3507	544
Particles >14µm		ASTM D7647	>80	25	<u>158</u>	37
Particles >21µm		ASTM D7647	>20	5	<u>^</u> 29	8
Particles >38µm		ASTM D7647	>4	0	1	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	2 1/19/14	18/16/12
FLUID DEGRADA		method	limit/base		history1	history2

0.35



OIL ANALYSIS REPORT

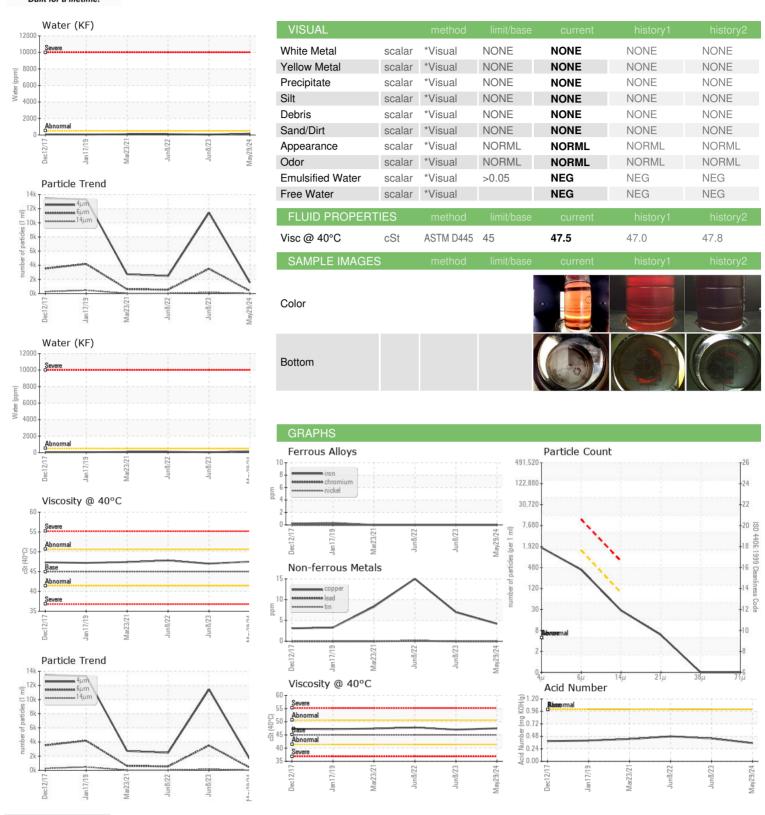





Laboratory Sample No.

Lab Number : 06207119 Unique Number : 11074580

: KCPA018024

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested** Diagnosed

: 13 Jun 2024 - Angela Borella Test Package : IND 2 (Additional Tests: KF, PrtCount)

: 11 Jun 2024

: 13 Jun 2024

Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CITY OF WEST ALLIS

6300 W MCGEOCH AVE WEST ALLIS, WI

US 53219 Contact: A/P

accountspayable@westalliswi.gov

T: F: