


OIL ANALYSIS REPORT

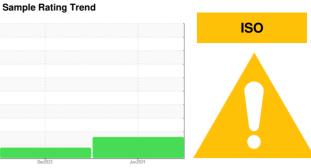

RECYCLE ROOM **USED OIL SAMPLE**

Refrigeration Compressor

{not provided} (--- GAL)

DIAGNOSIS

Recommendation

This is a baseline read-out on the submitted sample.

Wear

All wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2023	Jun2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
			minu bass			
Sample Number		Client Info		USPM18160	USPM18158	
Sample Date		Client Info		05 Jun 2024	07 Dec 2023	
Machine Age	hrs	Client Info		0	0	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	3	3	
Chromium	ppm	ASTM D5185m	>2	0	<1	
Nickel	ppm	ASTM D5185m		0	<1	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>3	0	1	
Lead	ppm	ASTM D5185m	>2	0	<1	
Copper	ppm	ASTM D5185m	>8	<1	<1	
Tin	ppm	ASTM D5185m	>4	0	<1	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	<1	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m		0	2	
Molybdenum	ppm	ASTM D5185m		0	<1	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m		0	<1	
Calcium	ppm	ASTM D5185m		0	<1	
Phosphorus	ppm	ASTM D5185m		0	1	
Zinc	ppm	ASTM D5185m		0	0	
Sulfur	ppm	ASTM D5185m		13	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	2	
Sodium	ppm	ASTM D5185m		<1	0	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.01	0.004	0.006	
ppm Water	ppm	ASTM D6304	>100	45	64	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		119602	81965	
Particles >6µm		ASTM D7647	>2500	49719	△ 9648	
Particles >14µm		ASTM D7647	>320	^ 765	81	
Particles >21µm		ASTM D7647	>80	<u> 100</u>	13	
Particles >38µm		ASTM D7647	>20	3	0	
Particles >71µm		ASTM D7647	>4	0	0	
Oil Cleanliness		ISO 4406 (c)	>/18/15	24/23/17	<u>4</u> 24/20/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A -1-I NII (ANI)	1/011/	4 OTH 4 DOZ4		0.000	0.014	

Acid Number (AN)


mg KOH/g ASTM D974

0.014

0.089



OIL ANALYSIS REPORT

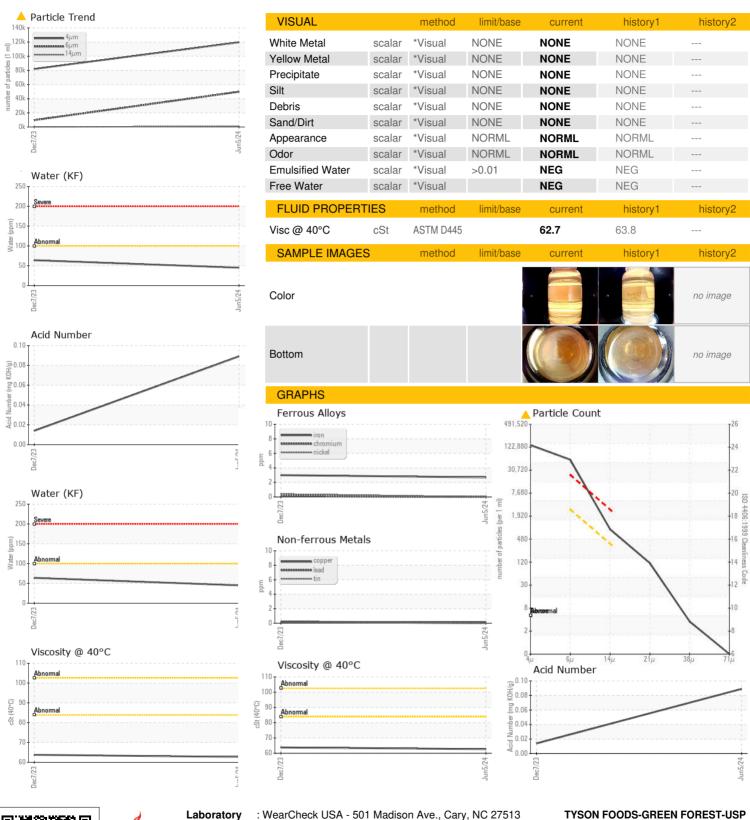





Certificate 12367

Laboratory Sample No. Lab Number : 06207123

Test Package : IND 2

: USPM18160 Unique Number : 11074584

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 11 Jun 2024 **Tested** : 19 Jun 2024

Diagnosed : 19 Jun 2024 - Doug Bogart GREEN FOREST, AR LIS

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: