




# OIL ANALYSIS REPORT

## Sample Rating Trend

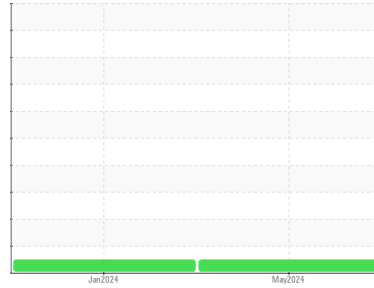

**NORMAL**



Machine Id

**J RYAN**

Component

**Port Genset**

Fluid

**DIESEL ENGINE OIL SAE 15W40 (--- GAL)**

### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil.

#### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0691816</b>	WC0773863	---
Sample Date	Client Info			<b>24 May 2024</b>	05 Jan 2024	---
Machine Age	hrs	Client Info		<b>4464</b>	2807	---
Oil Age	hrs	Client Info		<b>250</b>	250	---
Oil Changed	Client Info			<b>Changed</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>4.0		<b>&lt;1.0</b>	<1.0	---
Water	WC Method	>0.1		<b>NEG</b>	NEG	---
Glycol	WC Method			<b>NEG</b>	NEG	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>21</b>	10	---
Chromium	ppm	ASTM D5185m	>4	<b>&lt;1</b>	<1	---
Nickel	ppm	ASTM D5185m	>2	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Silver	ppm	ASTM D5185m	>5	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m	>12	<b>5</b>	2	---
Lead	ppm	ASTM D5185m	>17	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>70	<b>4</b>	12	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Cadmium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	250	<b>63</b>	171	---
Barium	ppm	ASTM D5185m	10	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	100	<b>125</b>	114	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	---
Magnesium	ppm	ASTM D5185m	450	<b>667</b>	627	---
Calcium	ppm	ASTM D5185m	3000	<b>1695</b>	1698	---
Phosphorus	ppm	ASTM D5185m	1150	<b>711</b>	685	---
Zinc	ppm	ASTM D5185m	1350	<b>907</b>	842	---
Sulfur	ppm	ASTM D5185m	4250	<b>2888</b>	2491	---




CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>9</b>	11	---
Sodium	ppm	ASTM D5185m	>158	<b>1</b>	2	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	<1	---

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>13.6</b>	10.4	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>26.7</b>	23.3	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>29.2</b>	20.7	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	<b>4.4</b>	7.6	---







# OIL ANALYSIS REPORT

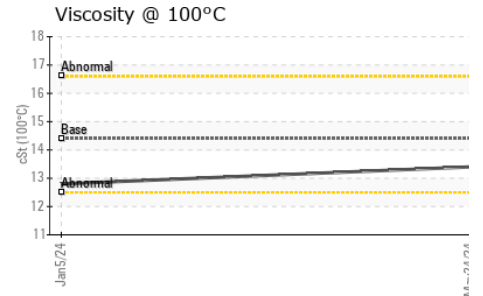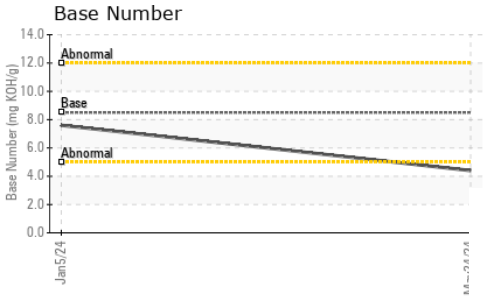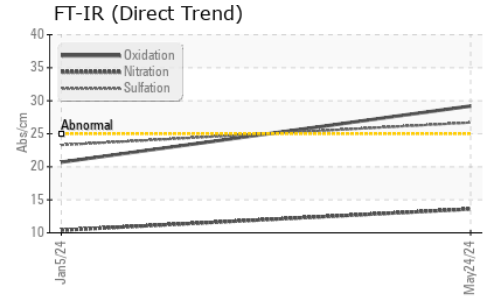

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.4	13.4	12.8

## GRAPHS

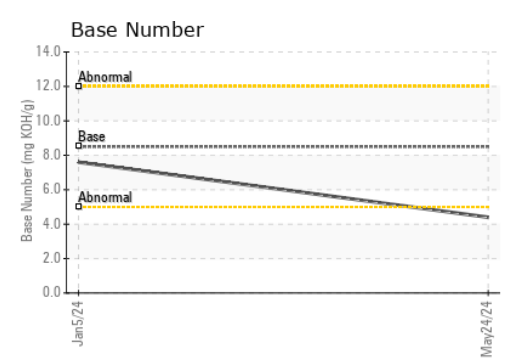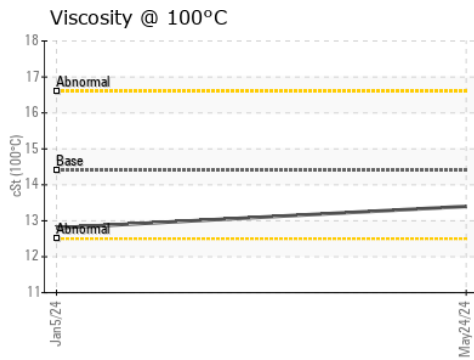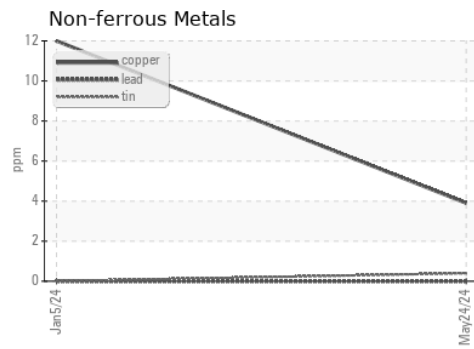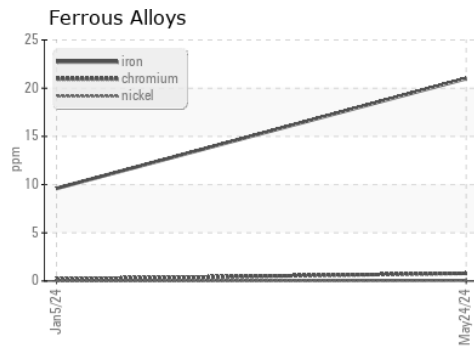

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0691816      **Received** : 11 Jun 2024  
**Lab Number** : **06207337**      **Tested** : 13 Jun 2024  
**Unique Number** : 11074798      **Diagnosed** : 13 Jun 2024 - Angela Borella  
**Test Package** : FLEET

**ASSOCIATED TERMINALS - CRANE**  
 CONVENT, LA  
 US 70723  
 Contact: GREG JOSEY  
 gjosey@associatedterminals.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)      F: (225)562-3515