




OIL ANALYSIS REPORT

Sample Rating Trend

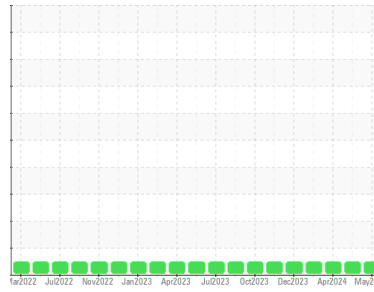

NORMAL



Machine Id
CUMMINS ART GENERATOR
 Component
Diesel Engine
 Fluid
SHELL ROTELLA T 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	KL0013575	KL0013547	KL0013248	
Sample Date	Client Info	31 May 2024	01 May 2024	09 Apr 2024	
Machine Age	hrs	Client Info	3879	0	3618
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A	
Sample Status		NORMAL	NORMAL	NORMAL	

CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >3.0	<1.0	<1.0	<1.0
Water	WC Method >0.2	NEG	NEG	NEG
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >90	5	1	<1
Chromium	ppm ASTM D5185m >20	<1	0	0
Nickel	ppm ASTM D5185m >2	0	0	<1
Titanium	ppm ASTM D5185m >2	<1	0	0
Silver	ppm ASTM D5185m >2	0	0	0
Aluminum	ppm ASTM D5185m >20	2	2	3
Lead	ppm ASTM D5185m >40	<1	0	0
Copper	ppm ASTM D5185m >330	1	<1	0
Tin	ppm ASTM D5185m >15	<1	<1	0
Vanadium	ppm ASTM D5185m	<1	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m 316	398	418	462
Barium	ppm ASTM D5185m 0.0	0	0	0
Molybdenum	ppm ASTM D5185m 1.2	93	87	87
Manganese	ppm ASTM D5185m	0	<1	0
Magnesium	ppm ASTM D5185m 24	392	404	422
Calcium	ppm ASTM D5185m 2292	1395	1331	1310
Phosphorus	ppm ASTM D5185m 1064	952	927	944
Zinc	ppm ASTM D5185m 1160	1122	1094	1103
Sulfur	ppm ASTM D5185m 4996	3391	3357	3694

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	4	3	4
Sodium	ppm ASTM D5185m	<1	2	1
Potassium	ppm ASTM D5185m >20	3	0	2

INFRA-RED

method	limit/base	current	history1	history2
Soot %	% *ASTM D7844 >6	0.1	0.2	0.1
Nitration	Abs/cm *ASTM D7624 >20	7.0	7.2	6.1
Sulfation	Abs/.1mm *ASTM D7415 >30	21.5	21.7	20.6


FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414 >25	16.1	16.4	15.1
Base Number (BN)	mg KOH/g ASTM D2896 10.1	7.3	7.5	8.1




OIL ANALYSIS REPORT


FT-IR (Direct Trend)

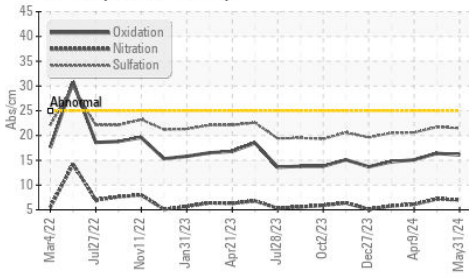

Base Number

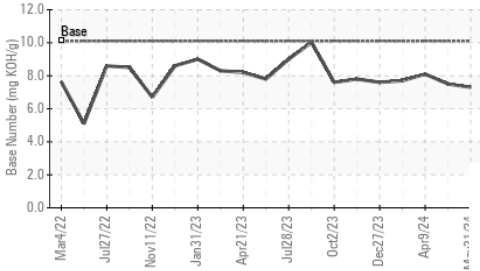

Viscosity @ 100°C

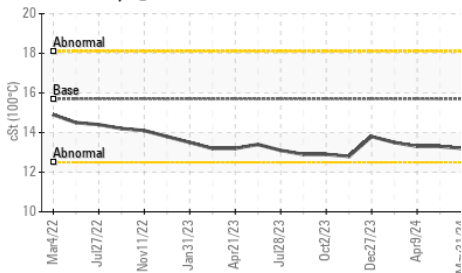


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	15.7	13.2	13.3

GRAPHS


Ferrous Alloys

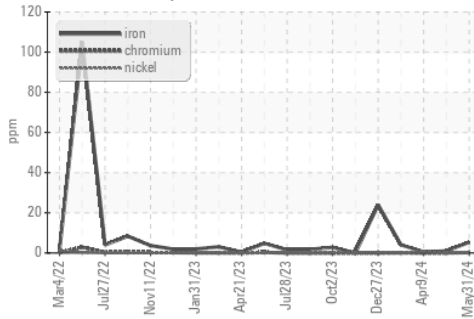


Non-ferrous Metals

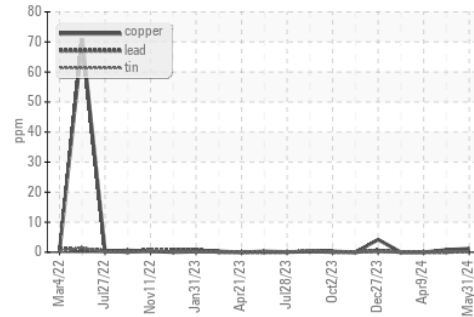

Viscosity @ 100°C

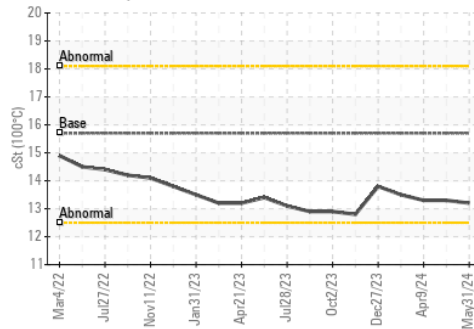

Base Number

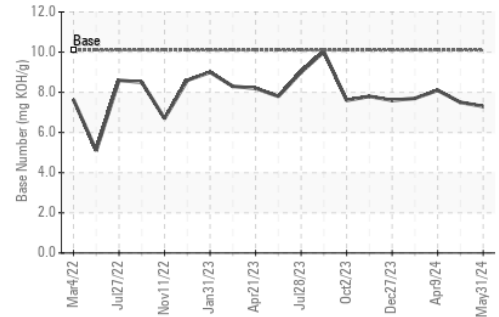

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : KL0013575

Lab Number : 06207612

Unique Number : 11075073

Test Package : FLEET

Received : 12 Jun 2024

Tested : 13 Jun 2024

Diagnosed : 13 Jun 2024 - Wes Davis

RAMIREZ & SONS

3404 N ENTERPRISE DR

HOBBS, NM

US 88240

Contact: Rick Davidson

rickdavidson.rsi@gmail.com

T:

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)