




OIL ANALYSIS REPORT

Sample Rating Trend

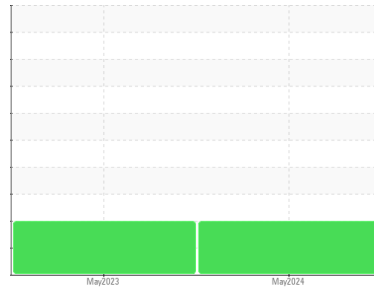

Machine Id
7019467 (S/N 1869)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA012329	KCP40963	---
Sample Date	Client Info		17 May 2024	26 May 2023	---
Machine Age	hrs	Client Info	3000	2304	---
Oil Age	hrs	Client Info	3000	2304	---
Oil Changed	Client Info		Changed	Not Changd	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	---
Chromium	ppm	ASTM D5185m >10	<1	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	<1	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	2	0	---
Lead	ppm	ASTM D5185m >10	<1	0	---
Copper	ppm	ASTM D5185m >50	<1	<1	---
Tin	ppm	ASTM D5185m >10	<1	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	---
Barium	ppm	ASTM D5185m 90	55	81	---
Molybdenum	ppm	ASTM D5185m 0	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m 100	75	90	---
Calcium	ppm	ASTM D5185m 0	0	1	---
Phosphorus	ppm	ASTM D5185m 0	0	2	---
Zinc	ppm	ASTM D5185m 0	0	0	---
Sulfur	ppm	ASTM D5185m 23500	20261	23125	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	2	---
Sodium	ppm	ASTM D5185m	19	13	---
Potassium	ppm	ASTM D5185m >20	3	2	---
Water	%	ASTM D6304 >0.05	0.027	0.015	---
ppm Water	ppm	ASTM D6304 >500	272	155.2	---






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		38246	5896	---
Particles >6µm	ASTM D7647	>1300	▲ 17032	▲ 1924	---
Particles >14µm	ASTM D7647	>80	▲ 1782	▲ 176	---
Particles >21µm	ASTM D7647	>20	▲ 351	▲ 42	---
Particles >38µm	ASTM D7647	>4	▲ 6	▲ 5	---
Particles >71µm	ASTM D7647	>3	1	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/21/18	▲ 20/18/15	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.36	0.35	---


OIL ANALYSIS REPORT

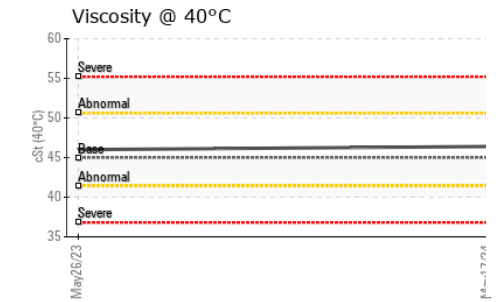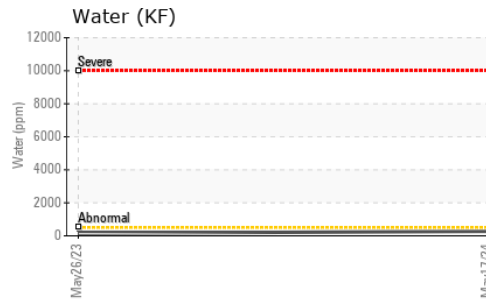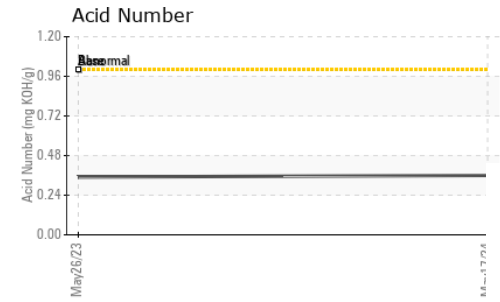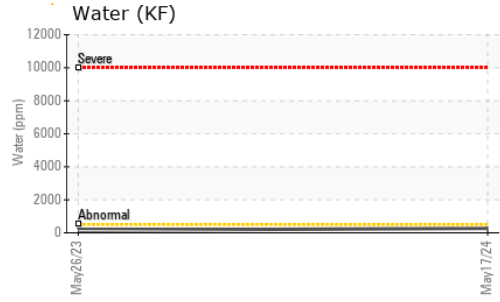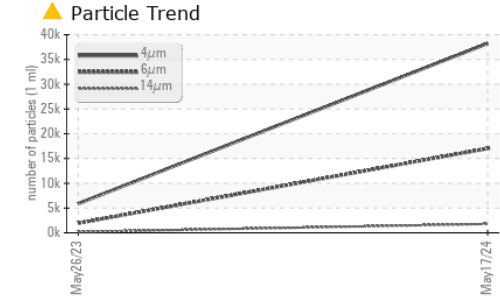






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.4	46.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

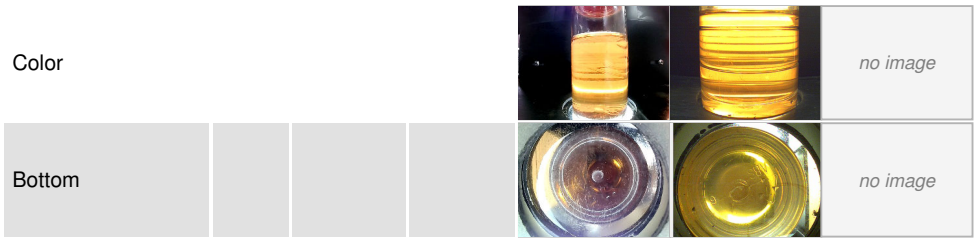

GRAPHS

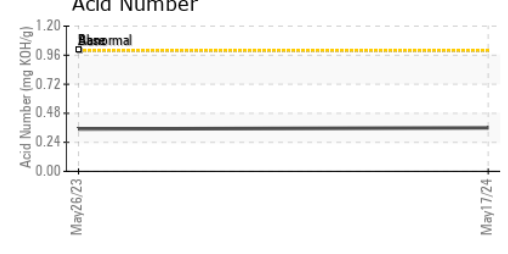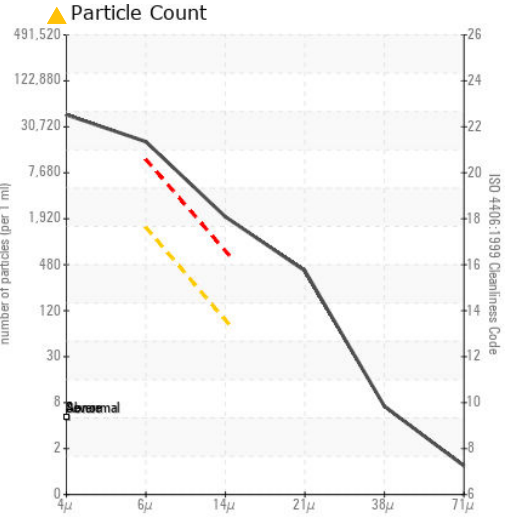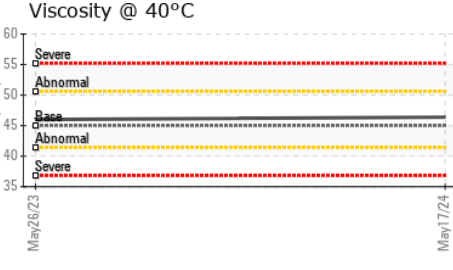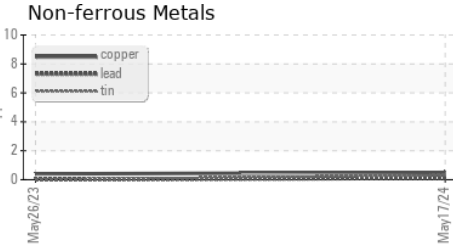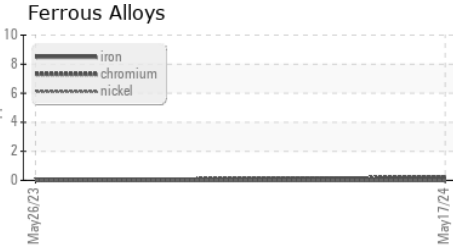

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA012329
Lab Number : 06207798
Unique Number : 11075259
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 12 Jun 2024
Tested : 13 Jun 2024
Diagnosed : 14 Jun 2024 - Don Baldrige

AMAZON
 4950 GOODMAN WAY
 EASTVALE, CA
 US
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)