


OIL ANALYSIS REPORT

Sample Rating Trend

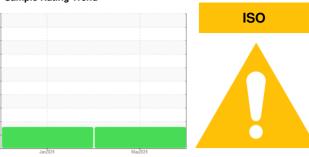

Machine Id

KAESER 8727925

Component Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

			Jan 2024	May2024		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA018860	KCPA008868	
Sample Date		Client Info		28 May 2024	08 Jan 2024	
Machine Age	hrs	Client Info		3677	2075	
Oil Age	hrs	Client Info		3000	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				ABNORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	1	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	2	2	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	2	20	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	44	68	
Calcium	ppm	ASTM D5185m	0	0	3	
Phosphorus	ppm	ASTM D5185m	0	0	<1	
Zinc	ppm	ASTM D5185m	0	0	1	
Sulfur	ppm	ASTM D5185m	23500	18728	16689	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		11	15	
Potassium	ppm	ASTM D5185m	>20	3	0	
Water	%	ASTM D6304	>0.05	0.021	0.00	
ppm Water	ppm	ASTM D6304	>500	212	0	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		29260	166848	
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>\$\infty\$ 98545</u>	
Particles >14μm		ASTM D7647	>80	566	<u>4157</u>	
Particles >21µm		ASTM D7647	>20	48	<u>225</u>	
Particles >38µm		ASTM D7647	>4	3	3	
Particles >71μm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>22/21/16</u>	<u>\$\text{\Delta}\$ 25/24/19</u>	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.33	0.30	



OIL ANALYSIS REPORT

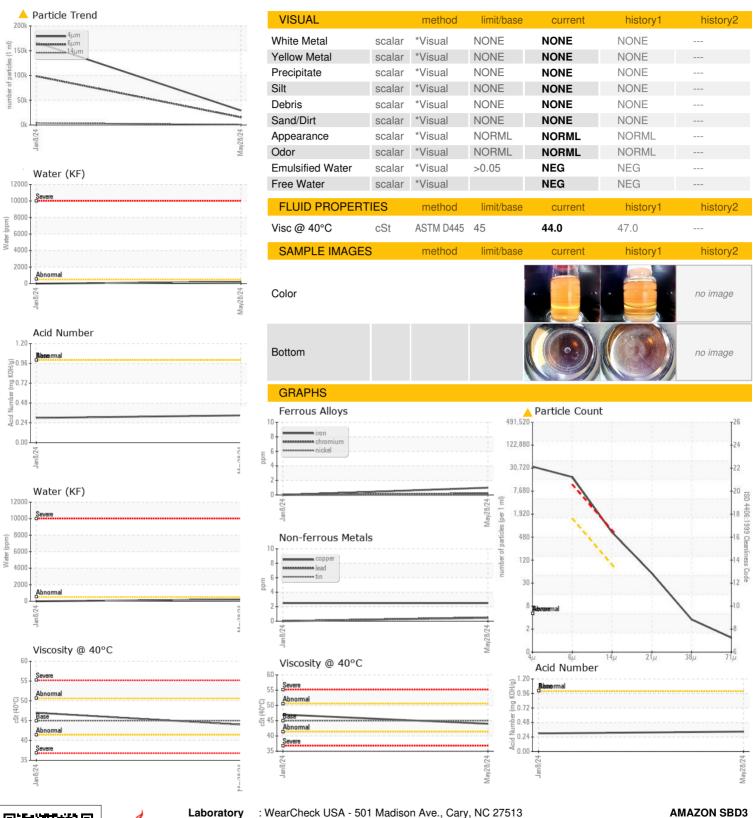





Certificate 12367

Laboratory Sample No. Lab Number

: 06207799 Unique Number : 11075260

: KCPA018860 Received **Tested**

: 13 Jun 2024 : 14 Jun 2024 - Don Baldridge Diagnosed

: 12 Jun 2024

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

 st - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

5990 N CAJON BLVD SAN BERNARDINO, CA US 92407

Contact: Service Manager betaal@amazon.com

T: F: