




OIL ANALYSIS REPORT

Sample Rating Trend

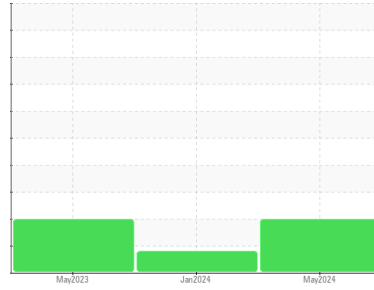

ISO



Machine Id

8431807 (S/N 1035)

Component

Compressor

Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA012328	KCPA010399	KCP52265
Sample Date	Client Info		17 May 2024	22 Jan 2024	26 May 2023
Machine Age	hrs	Client Info	14282	11484	8847
Oil Age	hrs	Client Info	3000	0	2197
Oil Changed	Client Info		Not Chngd	N/A	Not Chngd
Sample Status			ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	0	0	0
Chromium	ppm	ASTM D5185m >10	<1	<1	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	2	0
Lead	ppm	ASTM D5185m >10	<1	0	<1
Copper	ppm	ASTM D5185m >50	1	<1	<1
Tin	ppm	ASTM D5185m >10	<1	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	59	68	84
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	<1
Magnesium	ppm	ASTM D5185m 100	82	91	90
Calcium	ppm	ASTM D5185m 0	0	4	3
Phosphorus	ppm	ASTM D5185m 0	0	0	4
Zinc	ppm	ASTM D5185m 0	<1	0	<1
Sulfur	ppm	ASTM D5185m 23500	20830	22861	23208

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	1	0	2
Sodium	ppm	ASTM D5185m	29	33	9
Potassium	ppm	ASTM D5185m >20	8	9	2
Water	%	ASTM D6304 >0.05	0.035	0.032	0.022
ppm Water	ppm	ASTM D6304 >500	358	324	227.7






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		35895	5698	5595
Particles >6µm	ASTM D7647 >1300		▲ 14319	● 1557	▲ 1978
Particles >14µm	ASTM D7647 >80		▲ 1446	72	▲ 202
Particles >21µm	ASTM D7647 >20		▲ 292	11	▲ 46
Particles >38µm	ASTM D7647 >4		▲ 8	0	▲ 4
Particles >71µm	ASTM D7647 >3		0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/21/18	● 20/18/13	▲ 20/18/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.42	0.37	0.40


OIL ANALYSIS REPORT

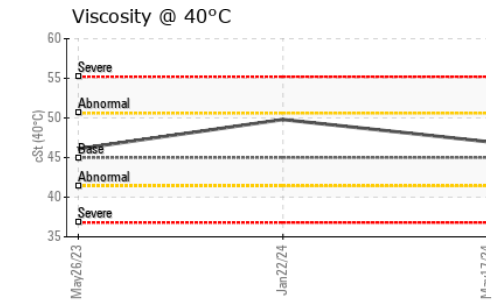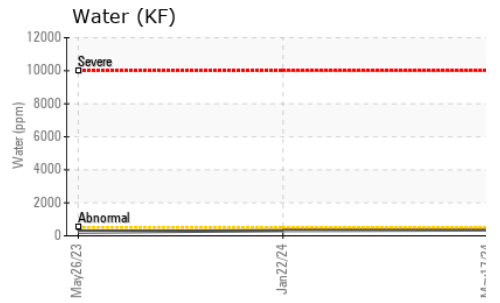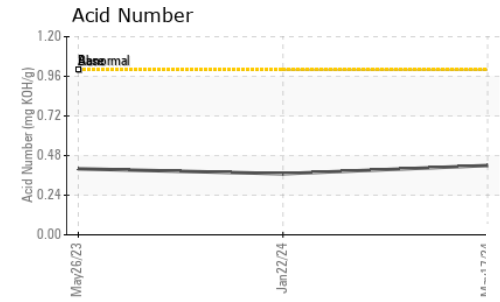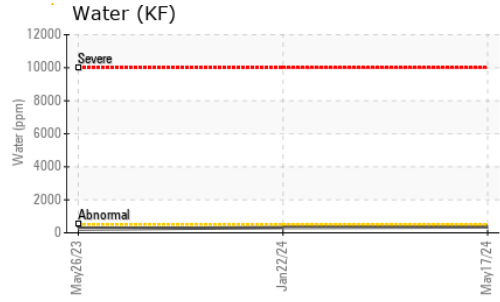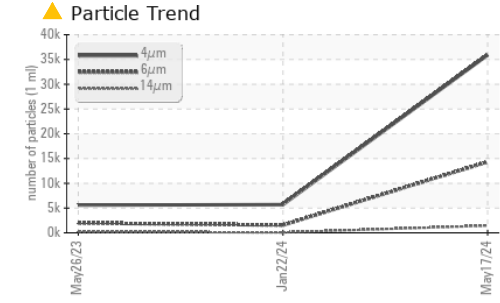





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.0	49.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

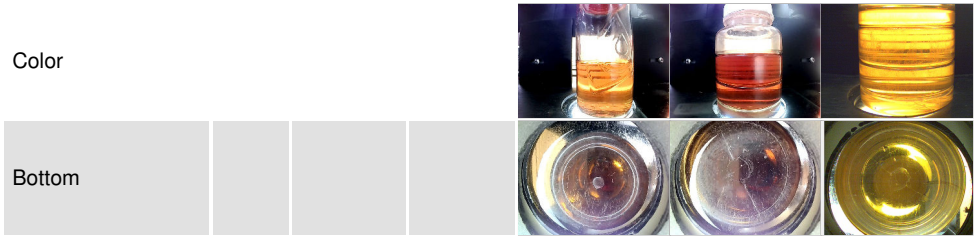

GRAPHS

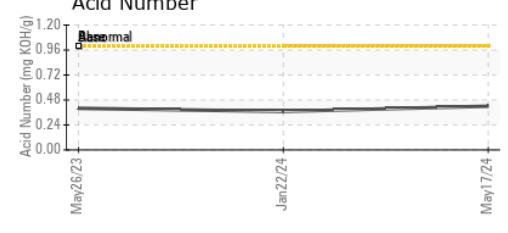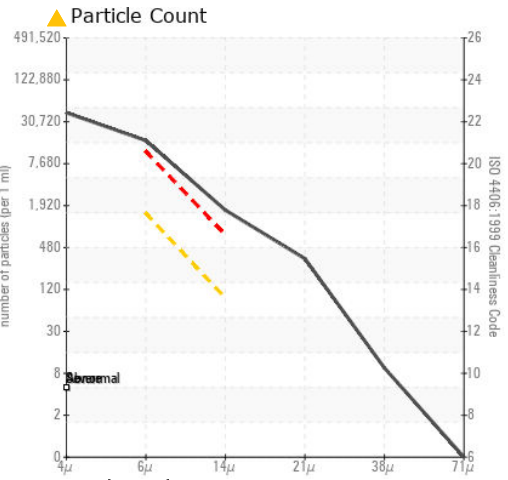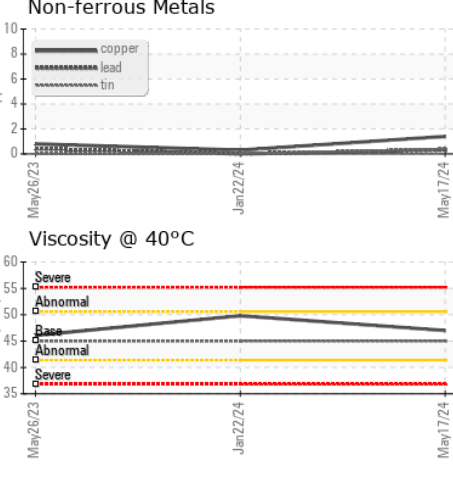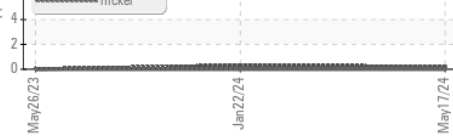

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA012328
Lab Number : 06207801
Unique Number : 11075262
Test Package : IND 2 (Additional Tests: KF, PrtCount)
Received : 12 Jun 2024
Tested : 13 Jun 2024
Diagnosed : 14 Jun 2024 - Don Baldrige

AMAZON
 4950 GOODMAN WAY
 EASTVALE, CA
 US
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)