




# OIL ANALYSIS REPORT

Sample Rating Trend

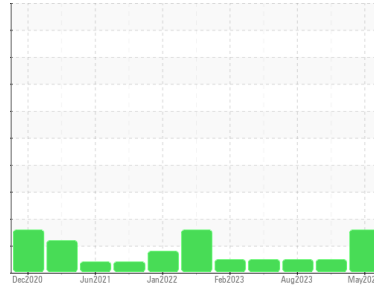

ISO



Machine Id

**KAESER 6328459**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC128265</b>	KC124764	KC121409
Sample Date	Client Info	<b>31 May 2024</b>	14 Nov 2023	14 Aug 2023
Machine Age	hrs	<b>25544</b>	26843	23228
Oil Age	hrs	<b>2316</b>	0	0
Oil Changed	Client Info	<b>Not Chngd</b>	N/A	N/A
Sample Status		<b>ABNORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	2	0	0
Lead	ppm	ASTM D5185m >10	<1	0	0
Copper	ppm	ASTM D5185m >50	2	<1	2
Tin	ppm	ASTM D5185m >10	<1	<1	0
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	37	45	38
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 90	76	62	58
Calcium	ppm	ASTM D5185m 2	0	0	2
Phosphorus	ppm	ASTM D5185m	0	0	2
Zinc	ppm	ASTM D5185m	0	0	4

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	11	9	14
Sodium	ppm	ASTM D5185m	25	20	20
Potassium	ppm	ASTM D5185m >20	6	3	7
Water	%	ASTM D6304 >0.05	0.029	0.012	0.047
ppm Water	ppm	ASTM D6304 >500	295	120.4	475.0






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	4513	1932	1431
Particles >6µm	ASTM D7647 >1300	▲ 2006	319	504
Particles >14µm	ASTM D7647 >80	▲ 371	24	39
Particles >21µm	ASTM D7647 >20	▲ 98	7	9
Particles >38µm	ASTM D7647 >4	3	0	0
Particles >71µm	ASTM D7647 >3	0	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 19/18/16	18/15/12	18/16/12

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.36	0.31	0.35


# OIL ANALYSIS REPORT

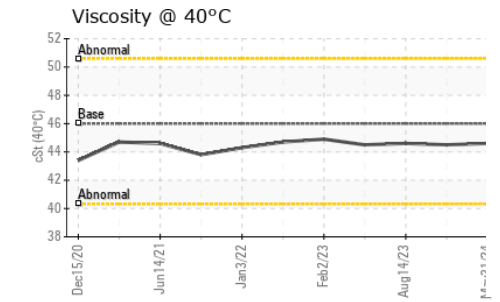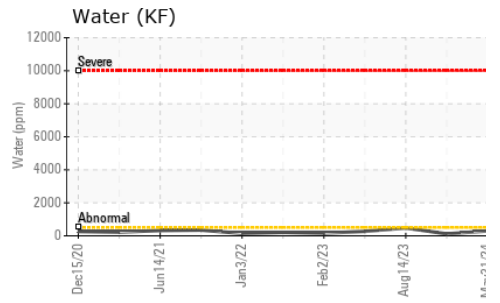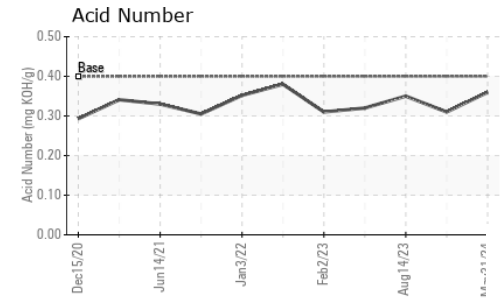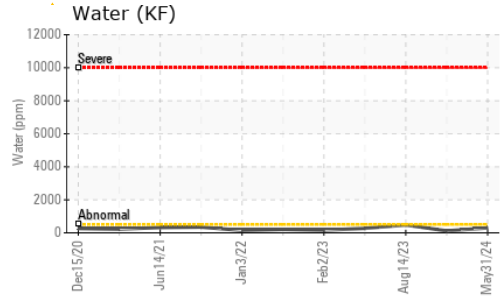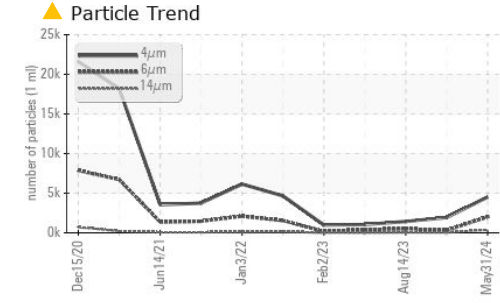





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.6	44.5	44.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

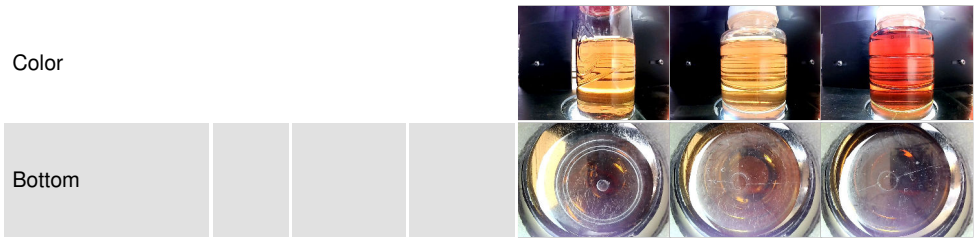

## GRAPHS

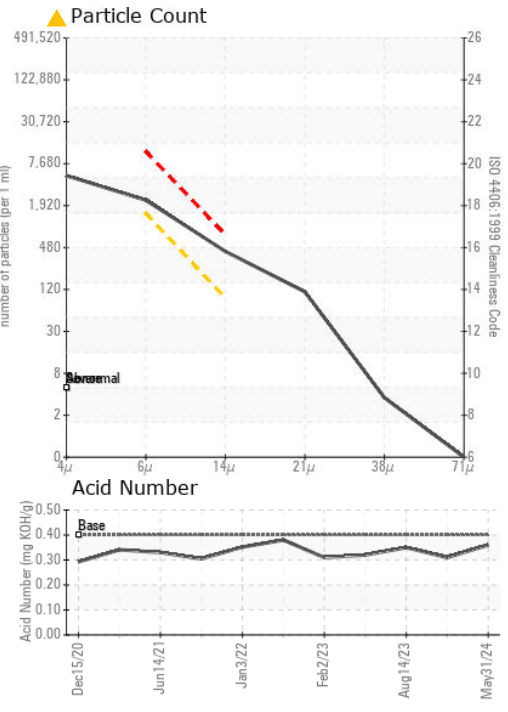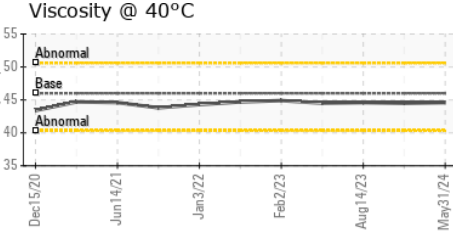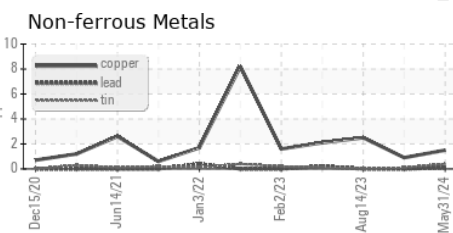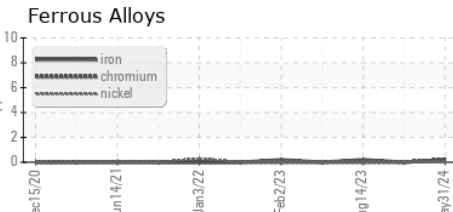

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC128265  
**Lab Number** : 06207810  
**Unique Number** : 11075271  
**Test Package** : IND 2  
**Received** : 12 Jun 2024  
**Tested** : 13 Jun 2024  
**Diagnosed** : 14 Jun 2024 - Don Baldrige

**AMAZON**  
 21500 EMERY RD  
 NORTH RANDALL, OH  
 US 44128  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)