


OIL ANALYSIS REPORT

Sample Rating Trend

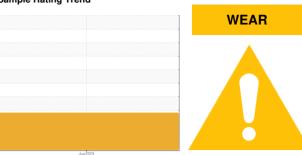

Machine Id

7523801 (S/N 1111)

Component Compressor

KAESER SIGMA (OEM) FG-460 (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

The aluminum level is abnormal. All other component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		<u>-</u>		Jun 2024		
SAMPLE INFORM	MATION	method	limit/base	ourront	hiotonul	hiotony?
SAMPLE INFORM	IATION	method	imit/base	current	history1	history2
Sample Number		Client Info		KCPA018523		
Sample Date		Client Info		05 Jun 2024		
Machine Age	hrs	Client Info		16936		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		Not Changd		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	4		
Chromium	ppm	ASTM D5185m	>10	<1		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	<1		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	△ 37		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	<1		
Tin	ppm	ASTM D5185m	>10	<1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
		ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese Magnesium	ppm	ASTM D5185m		3		
-	ppm			0		
Calcium	ppm	ASTM D5185m	E00	457		
Phosphorus	ppm	ASTM D5185m	500	-		
Zinc	ppm	ASTM D5185m		369		
Sulfur	ppm	ASTM D5185m		2073		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m		2		
Water	%	ASTM D6304		0.007		
ppm Water	ppm	ASTM D6304	>500	72		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		16079		
Particles >6µm		ASTM D7647	>1300	<u>▲</u> 5953		
Particles >14μm		ASTM D7647	>80	<u> </u>		
Particles >21µm		ASTM D7647	>20	<u>^</u> 212		
Particles >38μm		ASTM D7647	>4	<u> </u>		
Particles >71µm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>/17/13	<u>^</u> 21/20/17		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	1.22		



OIL ANALYSIS REPORT

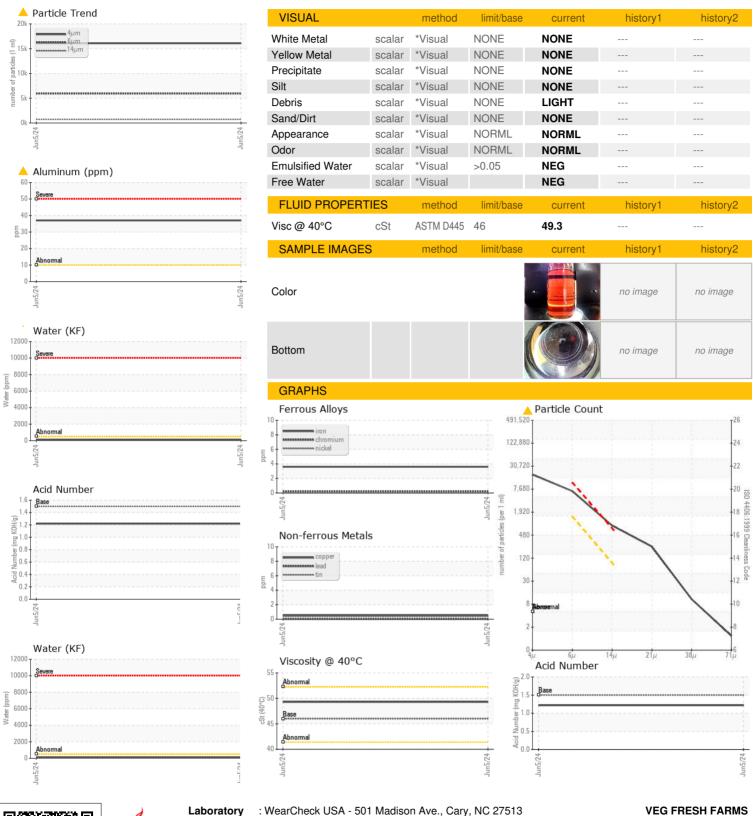



Laboratory Sample No.

: KCPA018523 Lab Number : 06207819

Unique Number : 11075280

Received : 12 Jun 2024 **Tested** : 13 Jun 2024 Diagnosed

: 14 Jun 2024 - Don Baldridge

CORONA, CA US 92878 Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - VEGCOR

T:

F:

1400 W RINCON ST