


OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id

KAESER 7969982 (S/N 1170)

Component Compressor

KAESER SIGMA (OEM) M-460 (--- QTS)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Dec2023	MayŽ024		
SAMPLE INFORM	ΙΔΤΙΩΝ	method	limit/base	current	history1	history2
	IATION		IIIIIII Dase			HISTOTYZ
Sample Number		Client Info		KCPA017994	KCPA009319	
Sample Date		Client Info		30 May 2024	14 Dec 2023	
Machine Age	hrs	Client Info		19906	16867	
Oil Age	hrs	Client Info		3038	0	
Oil Changed		Client Info		Changed	N/A	
Sample Status				NORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	<1	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	2	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	6	10	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	14	2	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	0	0	
Zinc	ppm	ASTM D5185m	0	9	4	
Sulfur	ppm	ASTM D5185m	23500	20637	17841	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	
Sodium	ppm	ASTM D5185m		2	3	
Potassium	ppm	ASTM D5185m	>20	2	0	
Water	%	ASTM D6304	>0.05	0.011	0.008	
ppm Water	ppm	ASTM D6304	>500	113	89	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2163	1915	
Particles >6µm		ASTM D7647	>1300	675	781	
Particles >14µm		ASTM D7647	>80	42	95	
Particles >21µm		ASTM D7647	>20	7	_ 25	
Particles >38µm		ASTM D7647	>4	0	1	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/17/13	18/17/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.46	0.45	



OIL ANALYSIS REPORT

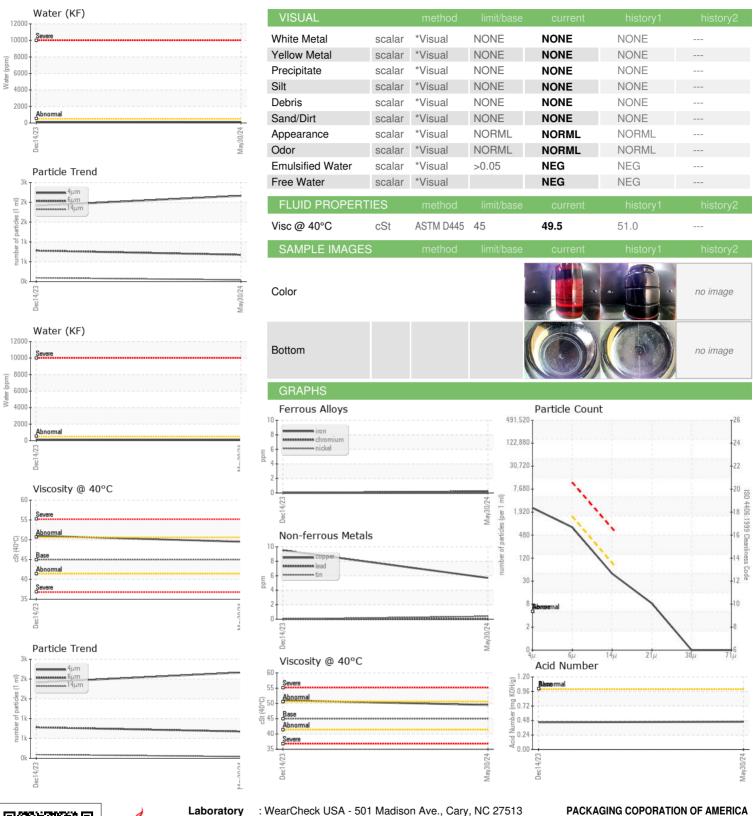





Laboratory Sample No. Lab Number

: KCPA017994 : 06207826

Unique Number: 11075287

Received **Tested** Diagnosed

: 12 Jun 2024 : 13 Jun 2024 : 14 Jun 2024 - Don Baldridge

13400 E 39TH AVE DENVER, CO US 80239

Contact: Service Manager

Test Package : IND 2 (Additional Tests: KF, PrtCount) Certificate 12367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Report Id: PACDENKCP [WUSCAR] 06207826 (Generated: 06/14/2024 22:39:19) Rev: 1

T:

F: