


# **OIL ANALYSIS REPORT**

### Sample Rating Trend



Machine Id

# ACP 1 (S/N V2471U15098)

Component Air Compressor

**USPI AIR 46 (--- GAL)** 

#### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Jun2022	Feb2023 Apr2023	Jul2023 Dec2023 A	pr2024	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM37659	USPM36614	USPM27999
Sample Date		Client Info		11 Jun 2024	02 Apr 2024	15 Jan 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	4	0
Chromium	ppm	ASTM D5185m	>4	<1	<1	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>40	3	2	3
Tin	ppm	ASTM D5185m	>5	<1	<1	2
Vanadium	ppm	ASTM D5185m		0	0	<1
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	<1	<1	<1
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	1	0	0	0
Zinc	ppm	ASTM D5185m	0	5	9	10
Sulfur	ppm	ASTM D5185m	0	0	19	22
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2	2	2
Sodium	ppm	ASTM D5185m		0	0	2
Potassium	ppm	ASTM D5185m	>20	<1	<1	0
Water	%	ASTM D6304	>0.2	0.154	0.076	0.046
ppm Water	ppm	ASTM D6304	>2000	1549	761	465
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	6655	17516	979
Particles >6µm		ASTM D7647	>2500	2362	4215	348
Particles >14µm		ASTM D7647	>320	225	255	38
Particles >21µm		ASTM D7647	>80	61	69	11
Particles >38µm		ASTM D7647	>20	2	2	0
Particles >71µm		ASTM D7647	>4	1	1	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	20/18/15	21/19/15	17/16/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.86	0.46	0.80





## **OIL ANALYSIS REPORT**












VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
<b>Emulsified Water</b>	scalar	*Visual	>0.2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG


FLUID PROPER	HES	metnoa	ilmit/base	current	nistory i	nistory2
Visc @ 40°C	cSt	ASTM D445	49.7	51.0	52.0	51.7

|--|

Color





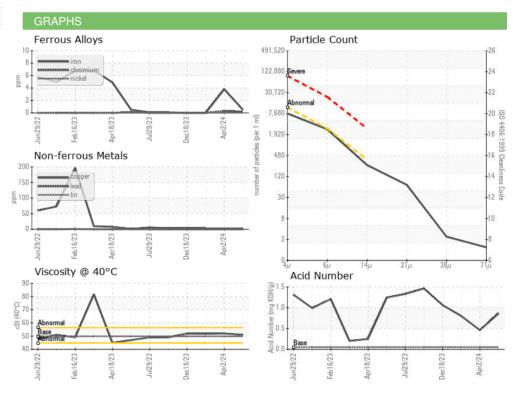





Certificate 12367

Laboratory Sample No. Lab Number : 06207849

: USPM37659 Unique Number : 11075310 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

: 12 Jun 2024 **Tested** : 13 Jun 2024 Diagnosed : 14 Jun 2024 - Doug Bogart

**PILGRIMS** 928 MARTIN LUTHER KING JR BLVD NACOGDOCHES, TX

US 75961 Contact: KERRI SULLIVAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (936)558-6928 Contact/Location: KERRI SULLIVAN - PILNACFRE

Report Id: PILNACFRE [WUSCAR] 06207849 (Generated: 06/15/2024 12:53:38) Rev: 1