OIL ANALYSIS REPORT

Sample Rating Trend

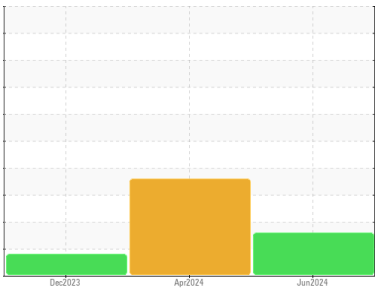

WATER

Machine Id
ACP 0 (S/N MOX1010310)
Component
Air Compressor
Fluid
INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is a moderate concentration of water present in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**USP0013370**	USP0008105	USP0004434
Sample Date		Client Info		**11 Jun 2024**	02 Apr 2024	18 Dec 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	ABNORMAL	ATTENTION

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	0
Chromium	ppm	ASTM D5185m	>4	**<1**	<1	0
Nickel	ppm	ASTM D5185m	>4	**0**	0	0
Titanium	ppm	ASTM D5185m		**<1**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**2**	2	0
Lead	ppm	ASTM D5185m	>20	**0**	0	0
Copper	ppm	ASTM D5185m	>40	**<1**	<1	0
Tin	ppm	ASTM D5185m	>5	**<1**	<1	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	0
Barium	ppm	ASTM D5185m	500	**566**	579	942
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m	0	**3**	2	0
Calcium	ppm	ASTM D5185m	0	**4**	9	<1
Phosphorus	ppm	ASTM D5185m	20	**0**	7	5
Zinc	ppm	ASTM D5185m	0	**0**	<1	0
Sulfur	ppm	ASTM D5185m	200	**237**	291	319

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**1**	0	1
Sodium	ppm	ASTM D5185m		**9**	81	2
Potassium	ppm	ASTM D5185m	>20	**2**	5	<1
Water	%	ASTM D6304	>0.6	**0.655**	0.976	0.138
ppm Water	ppm	ASTM D6304	>6000	**6550**	9760	1382

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	**1432**	---	10757
Particles >6µm		ASTM D7647	>2500	**428**	---	2356
Particles >14µm		ASTM D7647	>320	**15**	---	136
Particles >21µm		ASTM D7647	>80	**3**	---	39
Particles >38µm		ASTM D7647	>20	**0**	---	1
Particles >71µm		ASTM D7647	>4	**0**	---	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**18/16/11**	---	21/18/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**0.09**	0.054	0.092

OIL ANALYSIS REPORT

Water (KF)

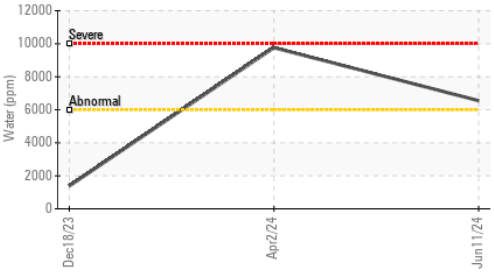

Particle Trend

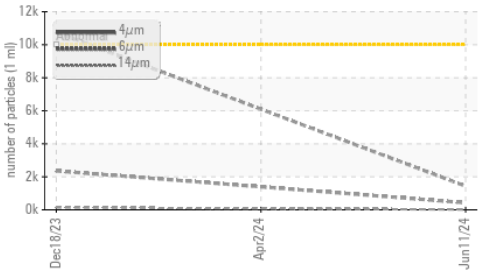

Acid Number

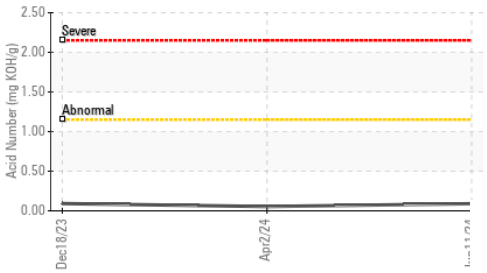

Viscosity @ 40°C

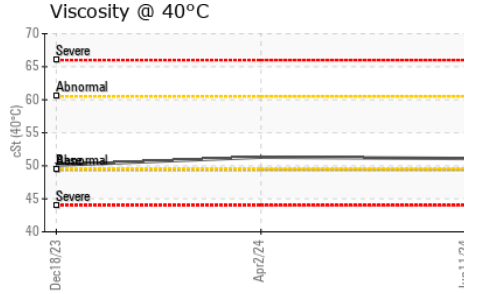

Particle Trend

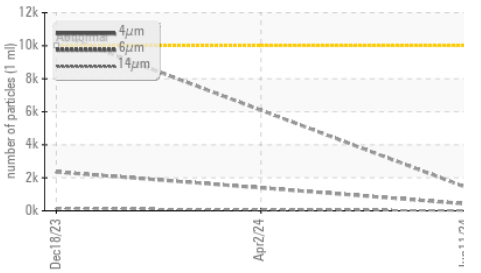

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	▲ MODER	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	**0.2%**	0.2%	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	**51.1**	51.3	50.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

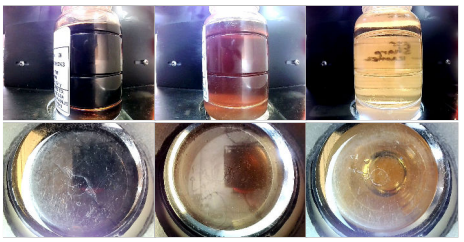

GRAPHS

Ferrous Alloys

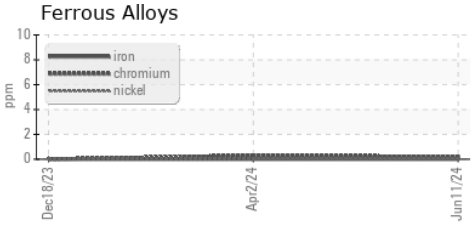

Non-ferrous Metals

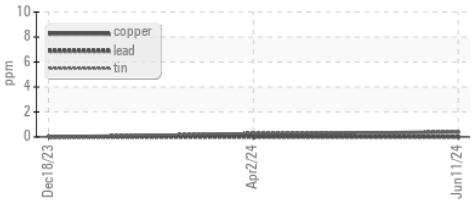

Viscosity @ 40°C

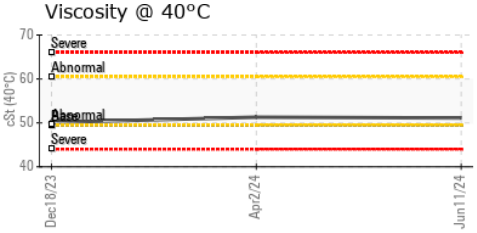

Particle Count

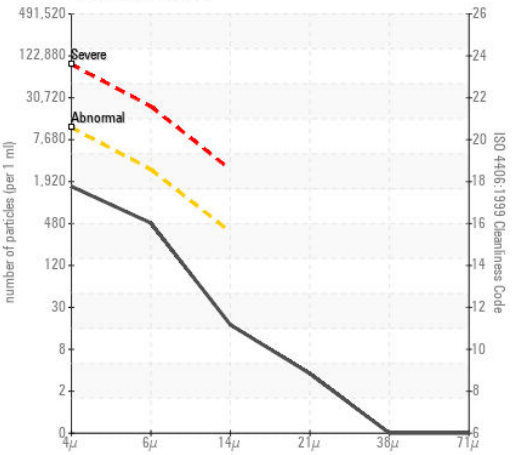

Acid Number

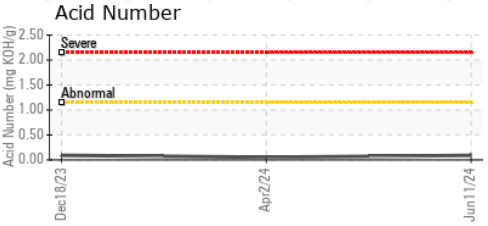

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USP0013370
Lab Number : 06207856
Unique Number : 11075317
Test Package : IND 2

Received : 12 Jun 2024
Tested : 19 Jun 2024
Diagnosed : 19 Jun 2024 - Doug Bogart

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

PILGRIMS
928 MARTIN LUTHER KING JR BLVD
NACOGDOCHES, TX
US 75961
Contact: KERRI SULLIVAN
T:
F: (936)558-6928